



**Alabama Department of Environmental Management**  
[adem.alabama.gov](http://adem.alabama.gov)

1400 Coliseum Blvd. 36110-2400 ■ Post Office Box 301463  
Montgomery, Alabama 36130-1463  
(334) 271-7700 ■ FAX (334) 271-7950

DECEMBER 9, 2022

Mike Oliver, General Manager  
Harvest-Monrovia Water, Sewer and Fire Protection Authority, Inc.  
PO Box 329  
Harvest, AL 35749

RE: Draft Permit  
NPDES Permit No. AL0055158  
Hunter's Crossing WWTP  
Madison County, Alabama

Dear Mr. Oliver:

Transmitted herein is a draft of the referenced permit.

We would appreciate your comments on the permit within **30 days** of the date of this letter. Please direct any comments of a technical or administrative nature to the undersigned.

By copy of this letter and the draft permit, we are also requesting comments within the same time frame from EPA.

Please be aware that Parts I.C.1.c and I.C.2.e of your permit require participation in the Department's Alabama Environmental Permitting and Compliance System (AEPACS) for submittal of DMRs and SSOs upon issuance of this permit unless valid justification as to why you cannot participate is submitted in writing. SSO hotline notifications and hard copy Form 415 SSO reports may be used only with the written approval from the Department. AEPACS allows ADEM to electronically validate and acknowledge receipt of the data. This improves the accuracy of reported compliance data and reduces costs to both the regulated community and ADEM. Please note that all AEPACS users can create the electronic DMRs and SSOs; however, only AEPACS users with certifier permissions will be able to submit the electronic DMRs and SSOs to ADEM.

Our records indicate that you have utilized the Department's web-based electronic environmental (E2) reporting system for submittal of discharge monitoring reports (DMRs) and sanitary sewer overflow (SSO) notifications/reports. The Department transitioned from the E2 Reporting System to the Alabama Environmental Permitting and Compliance System (AEPACS) for the submittal of DMRs and SSOs on November 15, 2021. AEPACS is an electronic system that allows facilities to apply for and maintain permits as well as submit other required applications, registrations, and certifications. In addition, the system allows facilities to submit required compliance reports or other information to the Department. The Department has used the E2 User account information to set up a similar User Profile in AEPACS based on the following criteria:

1. The user has logged in to E2 since October 1, 2019; and
2. The E2 user account is set up using a unique email address.

E2 users that met the above criteria will only need to establish an ADEM Web Portal account (<https://prd.adem.alabama.gov/awp>) under the same email address as their E2 account to have the same permissions in AEPACS as they did in E2. They will also automatically be linked to the same facilities they were in E2.

Please also be aware that Part IV. of your permit requires that you develop, implement, and maintain a Sanitary Sewer Overflow Response Plan.

The Alabama Department of Environmental Management encourages you to voluntarily consider pollution prevention practices and alternatives at your facility. Pollution Prevention may assist you in complying with effluent limitations, and possibly reduce or eliminate monitoring requirements.

Should you have any questions, please contact the undersigned by email at [michael.simmons@adem.alabama.gov](mailto:michael.simmons@adem.alabama.gov) or by phone at (334) 274-4220.

Sincerely,

Michael N. Simmons  
Municipal Section  
Water Division

Enclosure

cc: Environmental Protection Agency Email  
Ms. Elaine Snyder/U.S. Fish and Wildlife Service  
Ms. Elizabeth Brown/Alabama Historical Commission  
Advisory Council on Historic Preservation  
Department of Conservation and Natural Resources



**Birmingham Branch**  
110 Vulcan Road  
Birmingham, AL 35209-4702  
(205) 942-6168  
(205) 941-1603 (FAX)

**Decatur Branch**  
2715 Sandlin Road, S.W.  
Decatur, AL 35603-1333  
(256) 353-1713  
(256) 340-9359 (FAX)

**Mobile Branch**  
2204 Perimeter Road  
Mobile, AL 36615-1131  
(251) 450-3400  
(251) 479-2593 (FAX)

**Mobile-Coastal**  
3664 Dauphin Street, Suite B  
Mobile, AL 36608  
(251) 304-1176  
(251) 304-1189 (FAX)

# NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT

**PERMITTEE:** HARVEST-MONROVIA WATER, SEWER AND FIRE PROTECTION AUTHORITY, INC.  
PO BOX 329  
HARVEST, AL 35749

**FACILITY LOCATION:** HUNTER'S CROSSING WWTP (0.075 MGD)  
195 MARLBORO WAY  
MADISON, ALABAMA  
MADISON COUNTY

**PERMIT NUMBER:** AL0055158

**RECEIVING WATERS:** KNOX CREEK

*In accordance with and subject to the provisions of the Federal Water Pollution Control Act, as amended, 33 U.S.C. §§1251-1388 (the "FWPCA"), the Alabama Water Pollution Control Act, as amended, Code of Alabama 1975, §§ 22-22-1 to 22-22-14 (the "AWPCA"), the Alabama Environmental Management Act, as amended, Code of Alabama 1975, §§22-22A-1 to 22-22A-17, and rules and regulations adopted thereunder, and subject further to the terms and conditions set forth in this permit, the Permittee is hereby authorized to discharge into the above-named receiving waters.*

**ISSUANCE DATE:**

**EFFECTIVE DATE:**

**EXPIRATION DATE:**

**Draft**

---

Alabama Department of Environmental Management

## TABLE OF CONTENTS

|   |           |
|---|-----------|
| <b>PART I: DISCHARGE LIMITATIONS, CONDITIONS, AND REQUIREMENTS .....</b>      | <b>1</b>  |
| A. DISCHARGE LIMITATIONS AND MONITORING REQUIREMENTS.....                     | 1         |
| 1. DSN 0011: Domestic Wastewater.....   | 1         |
| B. DISCHARGE MONITORING AND RECORD KEEPING REQUIREMENTS.....                  | 3         |
| 1. Representative Sampling.....   | 3         |
| 2. Measurement Frequency .....  | 3         |
| 3. Test Procedures.....   | 3         |
| 4. Recording of Results .....   | 4         |
| 5. Records Retention and Production .....                                     | 4         |
| 6. Reduction, Suspension or Termination of Monitoring and/or Reporting.....   | 4         |
| 7. Monitoring Equipment and Instrumentation .....                             | 4         |
| C. DISCHARGE REPORTING REQUIREMENTS.....                                      | 4         |
| 1. Reporting of Monitoring Requirements .....                                 | 4         |
| 2. Noncompliance Notifications and Reports.....                               | 6         |
| D. OTHER REPORTING AND NOTIFICATION REQUIREMENTS.....                         | 8         |
| 1. Anticipated Noncompliance.....   | 8         |
| 2. Termination of Discharge .....   | 8         |
| 3. Updating Information.....  | 8         |
| 4. Duty to Provide Information .....  | 8         |
| E. SCHEDULE OF COMPLIANCE .....   | 9         |
| 1. Compliance with discharge limits .....                                     | 9         |
| 2. Schedule .....   | 9         |
| <b>PART II: OTHER REQUIREMENTS, RESPONSIBILITIES, AND DUTIES .....</b>        | <b>10</b> |
| A. OPERATIONAL AND MANAGEMENT REQUIREMENTS.....                               | 10        |
| 1. Facilities Operation and Maintenance.....                                  | 10        |
| 2. Best Management Practices .....  | 10        |
| 3. Certified Operator .....   | 10        |
| B. OTHER RESPONSIBILITIES.....  | 10        |
| 1. Duty to Mitigate Adverse Impacts .....                                     | 10        |
| 2. Right of Entry and Inspection .....  | 10        |
| C. BYPASS AND UPSET.....  | 10        |
| 1. Bypass.....  | 10        |
| 2. Upset .....  | 11        |
| D. DUTY TO COMPLY WITH PERMIT, RULES, AND STATUTES.....                       | 11        |
| 1. Duty to Comply.....  | 11        |
| 2. Removed Substances.....  | 12        |
| 3. Loss or Failure of Treatment Facilities .....                              | 12        |
| 4. Compliance with Statutes and Rules .....                                   | 12        |
| E. PERMIT TRANSFER, MODIFICATION, SUSPENSION, REVOCATION, AND REISSUANCE..... | 12        |
| 1. Duty to Reapply or Notify of Intent to Cease Discharge .....               | 12        |
| 2. Change in Discharge .....  | 12        |
| 3. Transfer of Permit .....   | 12        |
| 4. Permit Modification and Revocation .....                                   | 13        |
| 5. Termination.....   | 13        |
| 6. Suspension .....   | 14        |
| 7. Stay .....   | 14        |
| F. COMPLIANCE WITH TOXIC POLLUTANT STANDARD OR PROHIBITION .....              | 14        |

|   |           |
|---|-----------|
| G. NOTICE TO DIRECTOR OF INDUSTRIAL USERS .....                             | 14        |
| H. PROHIBITIONS .....   | 14        |
| <b>PART III: ADDITIONAL REQUIREMENTS, CONDITIONS, AND LIMITATIONS .....</b> | <b>16</b> |
| A. CIVIL AND CRIMINAL LIABILITY .....                                       | 16        |
| 1. Tampering .....  | 16        |
| 2. False Statements .....   | 16        |
| 3. Permit Enforcement .....   | 16        |
| 4. Relief from Liability .....  | 16        |
| B. OIL AND HAZARDOUS SUBSTANCE LIABILITY .....                              | 16        |
| C. PROPERTY AND OTHER RIGHTS .....  | 16        |
| D. AVAILABILITY OF REPORTS .....  | 17        |
| E. EXPIRATION OF PERMITS FOR NEW OR INCREASED DISCHARGES .....              | 17        |
| F. COMPLIANCE WITH WATER QUALITY STANDARDS .....                            | 17        |
| G. GROUNDWATER .....  | 17        |
| H. DEFINITIONS .....  | 18        |
| I. SEVERABILITY .....   | 20        |
| <b>PART IV: SPECIFIC REQUIREMENTS, CONDITIONS, AND LIMITATIONS .....</b>    | <b>21</b> |
| A. SLUDGE MANAGEMENT PRACTICES .....  | 21        |
| 1. Applicability .....  | 21        |
| 2. Submitting Information .....   | 21        |
| 3. Reopener or Modification .....   | 21        |
| B. EFFLUENT TOXICITY TESTING REOPENER .....                                 | 21        |
| C. TOTAL RESIDUAL CHLORINE (TRC) REQUIREMENTS .....                         | 21        |
| D. PLANT CLASSIFICATION .....   | 22        |
| E. SANITARY SEWER OVERFLOW RESPONSE PLAN .....                              | 22        |
| 1. SSO Response Plan .....  | 22        |
| 2. SSO Response Plan Implementation .....                                   | 23        |
| 3. Department Review of the SSO Response Plan .....                         | 23        |
| 4. SSO Response Plan Administrative Procedures .....                        | 23        |

## PART I: DISCHARGE LIMITATIONS, CONDITIONS, AND REQUIREMENTS

### A. DISCHARGE LIMITATIONS AND MONITORING REQUIREMENTS

#### 1. DSN 0011: Domestic Wastewater

During the period beginning on the effective date of this permit and lasting through the expiration date of this permit, the Permittee is authorized to discharge from Outfall 0011, which is described more fully in the Permittee's application. Such discharge shall be limited and monitored by the Permittee as specified below:

| Parameter  | Quantity or Loading         |                            | Units   | Quality or Concentration |                             |                            | Units | Sample Freq<br>See note (1) | Sample Type       | Seasonal<br>See note (2) |
|--|-----------------------------|----------------------------|---------|--------------------------|-----------------------------|----------------------------|-------|-----------------------------|-------------------|--------------------------|
| Oxygen, Dissolved (DO) (00300)<br>Effluent Gross Value                   | *****                       | *****                      | *****   | 6.0<br>Minimum Daily     | *****                       | *****                      | mg/l  | Weekly                      | Grab              | Not Seasonal             |
| pH (00400)<br>Effluent Gross Value                                       | *****                       | *****                      | *****   | 6.0<br>Minimum Daily     | *****                       | 8.5<br>Maximum Daily       | S.U.  | Weekly                      | Grab              | Not Seasonal             |
| Solids, Total Suspended (00530)<br>Effluent Gross Value                  | 18.7<br>Monthly Average     | 28.1<br>Weekly Average     | lbs/day | *****                    | 30.0<br>Monthly Average     | 45.0<br>Weekly Average     | mg/l  | Weekly                      | 8-Hr<br>Composite | Not Seasonal             |
| Solids, Total Suspended (00530)<br>Raw Sew/Influent                      | (Report)<br>Monthly Average | (Report)<br>Weekly Average | lbs/day | *****                    | (Report)<br>Monthly Average | (Report)<br>Weekly Average | mg/l  | Weekly                      | 8-Hr<br>Composite | Not Seasonal             |
| Nitrogen, Ammonia Total (As N) (00610)<br>Effluent Gross Value           | 1.3<br>Monthly Average      | 1.9<br>Weekly Average      | lbs/day | *****                    | 2.1<br>Monthly Average      | 3.1<br>Weekly Average      | mg/l  | Weekly                      | 8-Hr<br>Composite | W                        |
| Nitrogen, Ammonia Total (As N) (00610)<br>Effluent Gross Value           | 0.75<br>Monthly Average     | 1.12<br>Weekly Average     | lbs/day | *****                    | 1.2<br>Monthly Average      | 1.8<br>Weekly Average      | mg/l  | Weekly                      | 8-Hr<br>Composite | S                        |
| Nitrogen, Kjeldahl Total (As N) (00625)<br>Effluent Gross Value          | (Report)<br>Monthly Average | (Report)<br>Weekly Average | lbs/day | *****                    | (Report)<br>Monthly Average | (Report)<br>Weekly Average | mg/l  | Monthly                     | 8-Hr<br>Composite | S                        |
| Nitrite Plus Nitrate Total 1 Def. (As N) (00630)<br>Effluent Gross Value | (Report)<br>Monthly Average | (Report)<br>Weekly Average | lbs/day | *****                    | (Report)<br>Monthly Average | (Report)<br>Weekly Average | mg/l  | Monthly                     | 8-Hr<br>Composite | S                        |
| Phosphorus, Total (As P) (00665)<br>Effluent Gross Value                 | (Report)<br>Monthly Average | (Report)<br>Weekly Average | lbs/day | *****                    | (Report)<br>Monthly Average | (Report)<br>Weekly Average | mg/l  | Monthly                     | 8-Hr<br>Composite | S                        |

See Part II.C.1. for Bypass and Part II.C.2. for Upset conditions.

(1) Sample Frequency – See also Part I.B.2

See Permit Requirements for Effluent Toxicity Testing in Part IV.B.

(2) S = Summer (April – October)

W = Winter (November - March)

ECS = E. coli Summer (May - October)

ECW = E. coli Winter (November - April)

(3) See Part IV.C. for Total Residual Chlorine (TRC). Monitoring for TRC is applicable if chlorine is utilized for disinfection purposes. If monitoring is not applicable during the monitoring period, enter “\*9” on the monthly DMR.

(4) A measurement of TRC below 0.05 mg/L shall be considered in compliance with the permit limitations above and should be reported as “\*B” on the monthly DMR.

# 1. DSN 0011 (Continued): Domestic Wastewater

During the period beginning on the effective date of this permit and lasting through the expiration date of this permit, the Permittee is authorized to discharge from Outfall 0011, which is described more fully in the Permittee's application. Such discharge shall be limited and monitored by the Permittee as specified below:

| Parameter  | Quantity or Loading         |                            | Units   | Quality or Concentration           |                             |                            | Units     | Sample Freq<br>See note (1) | Sample Type       | Seasonal<br>See note (2) |
|--|-----------------------------|----------------------------|---------|------------------------------------|-----------------------------|----------------------------|-----------|-----------------------------|-------------------|--------------------------|
| Flow, In Conduit or Thru Treatment Plant (50050)<br>Effluent Gross Value     | (Report)<br>Monthly Average | (Report)<br>Maximum Daily  | MGD     | ****                               | ****                        | ****                       | ****      | Weekly                      | Instantaneous     | Not Seasonal             |
| Chlorine, Total Residual (50060)<br>See notes (3, 4)<br>Effluent Gross Value | ****                        | ****                       | ****    | ****                               | 0.011<br>Monthly Average    | 0.019<br>Maximum Daily     | mg/l      | Weekly                      | Grab              | Not Seasonal             |
| E. Coli (51040)<br>Effluent Gross Value                                      | ****                        | ****                       | ****    | ****                               | 548<br>Monthly Average      | 2507<br>Maximum Daily      | col/100mL | Weekly                      | Grab              | ECW                      |
| E. Coli (51040)<br>Effluent Gross Value                                      | ****                        | ****                       | ****    | ****                               | 126<br>Monthly Average      | 298<br>Maximum Daily       | col/100mL | Weekly                      | Grab              | ECS                      |
| BOD, Carbonaceous 05 Day, 20C (80082)<br>Effluent Gross Value                | 8.7<br>Monthly Average      | 13.1<br>Weekly Average     | lbs/day | ****                               | 14.0<br>Monthly Average     | 21.0<br>Weekly Average     | mg/l      | Weekly                      | 8-Hr<br>Composite | W                        |
| BOD, Carbonaceous 05 Day, 20C (80082)<br>Effluent Gross Value                | 5.6<br>Monthly Average      | 8.4<br>Weekly Average      | lbs/day | ****                               | 9.0<br>Monthly Average      | 13.5<br>Weekly Average     | mg/l      | Weekly                      | 8-Hr<br>Composite | S                        |
| BOD, Carbonaceous 05 Day, 20C (80082)<br>Raw Sew/Influent                    | (Report)<br>Monthly Average | (Report)<br>Weekly Average | lbs/day | ****                               | (Report)<br>Monthly Average | (Report)<br>Weekly Average | mg/l      | Weekly                      | 8-Hr<br>Composite | Not Seasonal             |
| BOD, Carb-5 Day, 20 Deg C, Percent Remvl<br>(80091)<br>Percent Removal       | ****                        | ****                       | ****    | 85.0<br>Monthly Average<br>Minimum | ****                        | ****                       | %         | Monthly                     | Calculated        | Not Seasonal             |
| Solids, Suspended Percent Removal (81011)<br>Percent Removal                 | ****                        | ****                       | ****    | 85.0<br>Monthly Average<br>Minimum | ****                        | ****                       | %         | Monthly                     | Calculated        | Not Seasonal             |

See Part II.C.1. for Bypass and Part II.C.2. for Upset conditions.

- (1) Sample Frequency – See also Part I.B.2  
See Permit Requirements for Effluent Toxicity Testing in Part IV.B.
- (2) S = Summer (April – October)  
W = Winter (November - March)  
ECS = E. coli Summer (May - October)  
ECW = E. coli Winter (November - April)
- (3) See Part IV.C. for Total Residual Chlorine (TRC). Monitoring for TRC is applicable if chlorine is utilized for disinfection purposes. If monitoring is not applicable during the monitoring period, enter “\*9” on the monthly DMR.
- (4) A measurement of TRC below 0.05 mg/L shall be considered in compliance with the permit limitations above and should be reported as “\*B” on the monthly DMR.

## **B. DISCHARGE MONITORING AND RECORD KEEPING REQUIREMENTS**

### **1. Representative Sampling**

Sample collection and measurement actions shall be representative of the volume and nature of the monitored discharge and shall be in accordance with the provisions of this permit. The effluent sampling point shall be at the nearest accessible location just prior to discharge and after final treatment, unless otherwise specified in the permit.

### **2. Measurement Frequency**

Measurement frequency requirements found in Provision I.A. shall mean:

- a. Seven days per week shall mean daily.
- b. Five days per week shall mean any five days of discharge during a calendar weekly period of Sunday through Saturday.
- c. Three days per week shall mean any three days of discharge during a calendar week.
- d. Two days per week shall mean any two days of discharge during a calendar week
- e. One day per week shall mean any day of discharge during a calendar week.
- f. Two days per month shall mean any two days of discharge during the month that are no less than seven days apart. However, if discharges occur only during one seven-day period in a month, then two days per month shall mean any two days of discharge during that seven day period.
- g. One day per month shall mean any day of discharge during the calendar month.
- h. Quarterly shall mean any day of discharge during each calendar quarter.
- i. The Permittee may increase the frequency of sampling, listed in Provisions I.B.2.a through I.B.2.h; however, all sampling results are to be reported to the Department.

### **3. Test Procedures**

For the purpose of reporting and compliance, permittees shall use one of the following procedures:

- a. For parameters with an EPA established Minimum Level (ML), report the measured value if the analytical result is at or above the ML and report "0" or "\*B" for values below the ML. Test procedures for the analysis of pollutants shall conform to 40 CFR Part 136 and guidelines published pursuant to Section 304(h) of the FWPCA, 33 U.S.C. Section 1314(h). If more than one method for analysis of a substance is approved for use, a method having a minimum level lower than the permit limit shall be used. If the minimum level of all methods is higher than the permit limit, the method having the lowest minimum level shall be used and a report of less than the minimum level shall be reported as zero and will constitute compliance, however should EPA approve a method with a lower minimum level during the term of this permit the permittee shall use the newly approved method.
- b. For pollutants parameters without an established ML, an interim ML may be utilized. The interim ML shall be calculated as 3.18 times the Method Detection Level (MDL) calculated pursuant to 40 CFR Part 136, Appendix B.

Permittees may develop an effluent matrix-specific ML, where an effluent matrix prevents attainment of the established ML. However, a matrix specific ML shall be based upon proper laboratory method and technique. Matrix-specific MLs must be approved by the Department, and may be developed by the permittee during permit issuance, reissuance, modification, or during compliance schedule.

In either case the measured value should be reported if the analytical result is at or above the ML and "0" or "\*B" reported for values below the ML.

- c. For parameters without an EPA established ML, interim ML, or matrix-specific ML, a report of less than the detection limit shall constitute compliance if the detection limit of all analytical methods is higher than the permit limit. For the purpose of calculating a monthly average, "0" shall be used for values reported less than the detection limit.

The Minimum Level utilized for procedures a and b above shall be reported on the permittee's DMR. When an EPA approved test procedure for analysis of a pollutant does not exist, the Director shall approve the procedure to be used.



#### 4. Recording of Results

For each measurement or sample taken pursuant to the requirements of this permit, the permittee shall record the following information:

- a. The facility name and location, point source number, date, time and exact place of sampling;
- b. The name(s) of person(s) who obtained the samples or measurements;
- c. The dates and times the analyses were performed;
- d. The name(s) of the person(s) who performed the analyses;
- e. The analytical techniques or methods used, including source of method and method number; and
- f. The results of all required analyses.

#### 5. Records Retention and Production

- a. The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the above reports or the application for this permit, for a period of at least three years from the date of the sample measurement, report or application. This period may be extended by request of the Director at any time. If litigation or other enforcement action, under the AWPCA and/or the FWPCA, is ongoing which involves any of the above records, the records shall be kept until the litigation is resolved. Upon the written request of the Director or his designee, the permittee shall provide the Director with a copy of any record required to be retained by this paragraph. Copies of these records should not be submitted unless requested.
- b. All records required to be kept for a period of three years shall be kept at the permitted facility or an alternate location approved by the Department in writing and shall be available for inspection.

#### 6. Reduction, Suspension or Termination of Monitoring and/or Reporting

- a. The Director may, with respect to any point source identified in Provision I.A. of this permit, authorize the permittee to reduce, suspend or terminate the monitoring and/or reporting required by this permit upon the submission of a written request for such reduction, suspension or termination by the permittee, supported by sufficient data which demonstrates to the satisfaction of the Director that the discharge from such point source will continuously meet the discharge limitations specified in Provision I.A. of this permit.
- b. It remains the responsibility of the permittee to comply with the monitoring and reporting requirements of this permit until written authorization to reduce, suspend or terminate such monitoring and/or reporting is received by the permittee from the Director.

#### 7. Monitoring Equipment and Instrumentation

All equipment and instrumentation used to determine compliance with the requirements of this permit shall be installed, maintained, and calibrated in accordance with the manufacturer's instructions or, in the absence of manufacturer's instructions, in accordance with accepted practices. At a minimum, flow measurement devices shall be calibrated at least once every 12 months.

### C. DISCHARGE REPORTING REQUIREMENTS

#### 1. Reporting of Monitoring Requirements

- a. The permittee shall conduct the required monitoring in accordance with the following schedule:
  - (1) **MONITORING REQUIRED MORE FREQUENTLY THAN MONTHLY AND MONTHLY** shall be conducted during the first full month following the effective date of coverage under this permit and every month thereafter.
  - (2) **QUARTERLY MONITORING** shall be conducted at least once during each calendar quarter. Calendar quarters are the periods of January through March, April through June, July through September, and October through December. The permittee shall conduct the quarterly monitoring during the first complete calendar quarter following the effective date of this permit and is then required to monitor once during each quarter thereafter. Quarterly monitoring should be reported on the last DMR due for the quarter (i.e., March, June, September and December DMRs).



- (3) **SEMIANNUAL MONITORING** shall be conducted at least once during the period of January through June and at least once during the period of July through December. The permittee shall conduct the semiannual monitoring during the first complete calendar semiannual period following the effective date of this permit and is then required to monitor once during each semiannual period thereafter. Semiannual monitoring may be done anytime during the semiannual period, unless restricted elsewhere in this permit, but it should be reported on the last DMR due for the month of the semiannual period (i.e., June and December DMRs).
  - (4) **ANNUAL MONITORING** shall be conducted at least once during the period of January through December. The permittee shall conduct the annual monitoring during the first complete calendar annual period following the effective date of this permit and is then required to monitor once during each annual period thereafter. Annual monitoring may be done anytime during the year, unless restricted elsewhere in this permit, but it should be reported on the December DMR.
- b. The permittee shall submit discharge monitoring reports (DMRs) in accordance with the following schedule:
- (1) **REPORTS OF MORE FREQUENTLY THAN MONTHLY AND MONTHLY TESTING** shall be submitted on a monthly basis. The first report is due on the 28th day of the month following the month the permit becomes effective. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period, unless otherwise directed by the Department.
  - (2) **REPORTS OF QUARTERLY TESTING** shall be submitted on a quarterly basis. The first report is due on the 28th day of the month following the first complete calendar quarter the permit becomes effective. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period, unless otherwise directed by the Department.
  - (3) **REPORTS OF SEMIANNUAL TESTING** shall be submitted on a semiannual basis. The reports are due on the 28th day of JANUARY and the 28th day of JULY. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period, unless otherwise directed by the Department.
  - (4) **REPORTS OF ANNUAL TESTING** shall be submitted on an annual basis. Unless specified elsewhere in the permit, the first report is due on the 28th day of JANUARY. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period, unless otherwise directed by the Department.
- c. Except as allowed by Provision I.C.1.c.(1) or (2), the permittee shall submit all Discharge Monitoring Reports (DMRs) required by Provision I.C.1.b. electronically.
- (1) If the permittee is unable to complete the electronic submittal of DMR data due to technical problems originating with the Department's electronic system (this could include entry/submittal issues with an entire set of DMRs or individual parameters), the permittee is not relieved of their obligation to submit DMR data to the Department by the date specified in Provision I.C.1.b., unless otherwise directed by the Department.

If the Department's electronic system is down on the 28th day of the month in which the DMR is due or is down for an extended period of time, as determined by the Department, when a DMR is required to be submitted, the permittee may submit the data in an alternate manner and format acceptable to the Department. Preapproved alternate acceptable methods include faxing, e-mailing, mailing, or hand-delivery of data such that they are received by the required reporting date. Within five calendar days of the Department's electronic system resuming operation, the permittee shall enter the data into the Department's electronic system, unless an alternate timeframe is approved by the Department. A comment should be included on the electronic DMR submittal verifying the original submittal date (date of the fax, copy of dated e-mail, or hand-delivery stamped date), if applicable.
  - (2) The permittee may submit a request to the Department for a temporary electronic reporting waiver for DMR submittals. The waiver request should include the permit number; permittee name; facility/site name; facility address; name, address, and contact information for the responsible official or duly authorized representative; a detailed statement regarding the basis for requesting such a waiver; and the duration for which the waiver is requested. Approved electronic reporting waivers are not transferrable.
  - (3) A permittee with an approved electronic reporting waiver for DMRs may submit hard copy DMRs for the period that the approved electronic reporting waiver request is effective. The permittee shall submit the Department-approved DMR forms to the address listed in Provision I.C.1.e.

- (4) If a permittee is allowed to submit a hard copy DMR, the DMR must be legible and bear an original signature. Photo and electronic copies of the signature are not acceptable and shall not satisfy the reporting requirements of this permit.
  - (5) If the permittee, using approved analytical methods as specified in Provision I.B.2, monitors any discharge from a point source for a limited substance identified in Provision I.A. of this permit more frequently than required by this permit, the results of such monitoring shall be included in the calculation and reporting of values on the DMR and the increased frequency shall be indicated on the DMR.
  - (6) In the event no discharge from a point source identified in Provision I.A. of this permit and described more fully in the permittee's application occurs during a monitoring period, the permittee shall report "No Discharge" for such period on the appropriate DMR.
- d. All reports and forms required to be submitted by this permit, the AWPCA and the Department's Rules and Regulations, shall be electronically signed (or, if allowed by the Department, traditionally signed) by a "responsible official" of the permittee as defined in ADEM Administrative Code Rule 335-6-6-.09 or a "duly authorized representative" of such official as defined in ADEM Administrative Code Rule 335-6-6-.09 and shall bear the following certification:
- "I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."
- e. Discharge Monitoring Reports required by this permit, the AWPCA, and the Department's Rules that are being submitted in hard copy shall be addressed to:

**Alabama Department of Environmental Management  
Office of Water Services, Water Division  
Post Office Box 301463  
Montgomery, Alabama 36130-1463**

Certified and Registered Mail containing Discharge Monitoring Reports shall be addressed to:

**Alabama Department of Environmental Management  
Office of Water Services, Water Division  
1400 Coliseum Boulevard  
Montgomery, Alabama 36110-2400**

- f. All other correspondence and reports required to be submitted by this permit, the AWPCA, and the Department's Rules shall be addressed to:

**Alabama Department of Environmental Management  
Municipal Section, Water Division  
Post Office Box 301463  
Montgomery, Alabama 36130-1463**

Certified and Registered Mail shall be addressed to:

**Alabama Department of Environmental Management  
Municipal Section, Water Division  
1400 Coliseum Boulevard  
Montgomery, Alabama 36110-2400**

- g. If this permit is a reissuance, then the permittee shall continue to submit DMRs in accordance with the requirements of their previous permit until such time as DMRs are due as discussed in Part I.C.I.b. above.

## 2. Noncompliance Notifications and Reports

- a. The Permittee shall notify the Department if, for any reason, the Permittee's discharge:
  - (1) Does not comply with any daily minimum or maximum discharge limitation for an effluent characteristic specified in Provision I.A. of this permit which is denoted by an "(X)";
  - (2) Potentially threatens human health or welfare;

- (3) Threatens fish or aquatic life;
- (4) Causes an in-stream water quality criterion to be exceeded;
- (5) Does not comply with an applicable toxic pollutant effluent standard or prohibition established under Section 307(a) of the FWPCA, 33 U.S.C. Section 1317(a);
- (6) Contains a quantity of a hazardous substance that may be harmful to public health or welfare under Section 311(b)(4) of the FWPCA, 33 U.S.C. Section 1321(b)(4);
- (7) Exceeds any discharge limitation for an effluent parameter listed in Part I.A. as a result of an unanticipated bypass or upset; or
- (8) Is an unpermitted direct or indirect discharge of a pollutant to a water of the state. (Note that unpermitted discharges properly reported to the Department under any other requirement are not required to be reported under this provision.)

The Permittee shall orally or electronically provide notification of any of the above occurrences, describing the circumstances and potential effects, to the Director or Designee within 24-hours after the Permittee becomes aware of the occurrence of such discharge. In addition to the oral or electronic notification, the Permittee shall submit a report to the Director or Designee, as provided in Provision I.C.2.c. or I.C.2.e., no later than five days after becoming aware of the occurrence of such discharge or occurrence.

- b. If, for any reason, the Permittee's discharge does not comply with any limitation of this permit, then the Permittee shall submit a written report to the Director or Designee, as provided in Provision I.C.2.c below. This report must be submitted with the next Discharge Monitoring Report required to be submitted by Provision I.C.1 of this permit after becoming aware of the occurrence of such noncompliance.

- c. Except for notifications and reports of notifiable SSOs which shall be submitted in accordance with the applicable Provisions of this permit, the Permittee shall submit the reports required under Provisions I.C.2.a. and b. to the Director or Designee on ADEM Form 421, available on the Department's website (<http://www.adem.state.al.us/DeptForms/Form421.pdf>). The completed Form must document the following information:

- (1) A description of the discharge and cause of noncompliance;
- (2) The period of noncompliance, including exact dates, times, and duration of the noncompliance. If the noncompliance is not corrected by the due date of the written report, then the Permittee shall provide an estimated date by which the noncompliance will be corrected; and
- (3) A description of the steps taken by the Permittee and the steps planned to be taken by the Permittee to reduce or eliminate the noncompliant discharge and to prevent its recurrence.

- d. Immediate notification

The Permittee shall provide notification to the Director, the public, the county health department, and any other affected entity such as public water systems, as soon as possible upon becoming aware of any notifiable sanitary sewer overflow. Notification to the Director shall be completed utilizing the Department's web-based electronic environmental SSO reporting system in accordance with Provision I.C.2.e.

- e. The Department is utilizing an electronic system for notification and submittal of SSO reports. Except as noted below, the Permittee must submit all SSO reports electronically in the Department's electronic system. If requested, waivers from utilization of the electronic system shall be submitted in accordance with ADEM Admin. Code 335-6-1-.04(6). The Department's electronic reporting system shall be utilized unless a written waiver has been granted. A waiver is not effective until receipt of written approval from the Department. Utilization of verbal notifications and hard copy SSO report submittals is allowed only if approved in writing by the Department. The Permittee shall include in the SSO reports the information requested by ADEM Form 415. In addition, the Permittee shall include the latitude and longitude of the SSO in the report except when the SSO is a result of an extreme weather event (e.g., hurricane). To participate in the electronic system for SSO reports, an account may be created at <https://aepacs.adem.alabama.gov/nviro/ncore/external/home>. If the electronic system is down (i.e., electronic submittal of SSO data cannot be completed due to technical problems originating with the Department's system), the Permittee is not relieved of its obligation to notify the Department or submit SSO reports to the Department by the required submittal date, and the Permittee shall submit the data in an alternate manner and format acceptable to the Department. Preapproved alternate acceptable methods include verbal reports, reports submitted via the SSO hotline, or reports submitted via fax, e-mail, mail, or hand-delivery such that they are

received by the required reporting date. Within five calendar days of the electronic system resuming operation, the Permittee shall enter the data into the electronic system, unless an alternate timeframe is approved by the Department. For any alternate notification, records of the date, time, notification method, and person submitting the notification should be maintained by the Permittee. If a Permittee is allowed to submit SSO reports via an alternate method, the SSO report must be in a format approved by the Department and must be legible.

- f. The Permittee shall maintain a record of all known wastewater discharge points that are not authorized as permitted outfalls, including but not limited to SSOs. The Permittee shall include this record in its **Municipal Water Pollution Prevention (MWPP) Annual Reports**, which shall be submitted to the Department each year by May 31st for the prior calendar year period beginning January 1st and ending December 31st. The MWPP Annual Reports shall contain a list of all known wastewater discharge points that are not authorized as permitted outfalls and any discharges that occur prior to the headworks of the wastewater treatment plant covered by this permit. The Permittee shall also provide in the MWPP Annual Reports a list of any discharges reported during the applicable time period in accordance with Provision I.C.2.a. The Permittee shall include in its MWPP Annual Reports the following information for each known unpermitted discharge that occurred:
- (1) The cause of the discharge;
  - (2) Date, duration and volume of discharge (estimate if unknown);
  - (3) Description of the source (e.g., manhole, lift station);
  - (4) Location of the discharge, by latitude and longitude (or other appropriate method as approved by the Department);
  - (5) The ultimate destination of the flow (e.g., surface waterbody, municipal separate storm sewer to surface waterbody). Location should be shown on a USGS quad sheet or copy thereof; and
  - (6) Corrective actions taken and/or planned to eliminate future discharges.

#### **D. OTHER REPORTING AND NOTIFICATION REQUIREMENTS**

##### **1. Anticipated Noncompliance**

The permittee shall give the Director written advance notice of any planned changes or other circumstances regarding a facility which may result in noncompliance with permit requirements.

##### **2. Termination of Discharge**

The permittee shall notify the Director, in writing, when all discharges from any point source(s) identified in Provision I. A. of this permit have permanently ceased. This notification shall serve as sufficient cause for instituting procedures for modification or termination of the permit.

##### **3. Updating Information**

- a. The permittee shall inform the Director of any change in the permittee's mailing address or telephone number or in the permittee's designation of a facility contact or office having the authority and responsibility to prevent and abate violations of the AWPCA, the Department's Rules and the terms and conditions of this permit, in writing, no later than ten (10) days after such change. Upon request of the Director or his designee, the permittee shall furnish the Director with an update of any information provided in the permit application.
- b. If the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Director, it shall promptly submit such facts or information with a written explanation for the mistake and/or omission.

##### **4. Duty to Provide Information**

The permittee shall furnish to the Director, within a reasonable time, any information which the Director or his designee may request to determine whether cause exists for modifying, revoking and re-issuing, suspending, or terminating this permit, in whole or in part, or to determine compliance with this permit.

**E. SCHEDULE OF COMPLIANCE**

**1. Compliance with discharge limits**

The permittee shall achieve compliance with the discharge limitations specified in Provision I. A. in accordance with the following schedule:

**COMPLIANCE SHALL BE ATTAINED ON THE EFFECTIVE DATE OF THIS PERMIT**

**2. Schedule**

No later than 14 calendar days following a date identified in the above schedule of compliance, the permittee shall submit either a report of progress or, in the case of specific actions being required by identified dates, a written notice of compliance or noncompliance. In the latter case, the notice shall include the cause of noncompliance, any remedial actions taken, and the probability of meeting the next scheduled requirement.

## **PART II: OTHER REQUIREMENTS, RESPONSIBILITIES, AND DUTIES**

### **A. OPERATIONAL AND MANAGEMENT REQUIREMENTS**

#### **1. Facilities Operation and Maintenance**

The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the conditions of the permit. Proper operation and maintenance includes effective performance, adequate funding, adequate operator staffing and training, and adequate laboratory and process controls, including appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities only when necessary to achieve compliance with the conditions of the permit.

#### **2. Best Management Practices**

- a. Dilution water shall not be added to achieve compliance with discharge limitations except when the Director or his designee has granted prior written authorization for dilution to meet water quality requirements.
- b. The permittee shall prepare, implement, and maintain a Spill Prevention, Control and Countermeasures (SPCC) Plan in accordance with 40 C.F.R. Section 112 if required thereby.
- c. The permittee shall prepare, submit for approval and implement a Best Management Practices (BMP) Plan for containment of any or all process liquids or solids, in a manner such that these materials do not present a significant potential for discharge, if so required by the Director or his designee. When submitted and approved, the BMP Plan shall become a part of this permit and all requirements of the BMP Plan shall become requirements of this permit.

#### **3. Certified Operator**

The permittee shall not operate any wastewater treatment plant unless the competency of the operator to operate such plant has been duly certified by the Director pursuant to AWPCA, and meets the requirements specified in ADEM Administrative Code, Rule 335-10-1.

### **B. OTHER RESPONSIBILITIES**

#### **1. Duty to Mitigate Adverse Impacts**

The permittee shall promptly take all reasonable steps to mitigate and minimize or prevent any adverse impact on human health or the environment resulting from noncompliance with any discharge limitation specified in Provision I. A. of this permit, including such accelerated or additional monitoring of the discharge and/or the receiving waterbody as necessary to determine the nature and impact of the noncomplying discharge.

#### **2. Right of Entry and Inspection**

- a. The permittee shall allow the Director, or an authorized representative, upon the presentation of proper credentials and other documents as may be required by law to:
  - (1) Enter upon the permittee's premises where a regulated facility or activity or point source is located or conducted, or where records must be kept under the conditions of the permit;
  - (2) Have access to and copy, at reasonable times, any records that must be kept under the conditions of the permits;
  - (3) Inspect any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under the permit; and
  - (4) Sample or monitor, for the purposes of assuring permit compliance or as otherwise authorized by the AWPCA, any substances or parameters at any location.

### **C. BYPASS AND UPSET**

#### **1. Bypass**

- a. Any bypass is prohibited except as provided in b. and c. below:
- b. A bypass is not prohibited if:
  - (1) It does not cause any discharge limitation specified in Provision I. A. of this permit to be exceeded;

- (2) It enters the same receiving stream as the permitted outfall; and
  - (3) It is necessary for essential maintenance of a treatment or control facility or system to assure efficient operation of such facility or system.
- c. A bypass is not prohibited and need not meet the discharge limitations specified in Provision I. A. of this permit if:
- (1) It is unavoidable to prevent loss of life, personal injury, or severe property damage;
  - (2) There are no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime (this condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance); and
  - (3) The permittee submits a written request for authorization to bypass to the Director at least ten (10) days prior to the anticipated bypass (if possible), the permittee is granted such authorization, and the permittee complies with any conditions imposed by the Director to minimize any adverse impact on human health or the environment resulting from the bypass.
- d. The permittee has the burden of establishing that each of the conditions of Provision II. C. 1. b. or c. have been met to qualify for an exception to the general prohibition against bypassing contained in a. and an exemption, where applicable, from the discharge limitations specified in Provision I. A. of this permit.

## **2. Upset**

- a. A discharge which results from an upset need not meet the discharge limitations specified in Provision I. A. of this permit if:
- (1) No later than 24-hours after becoming aware of the occurrence of the upset, the Permittee orally reports the occurrence and circumstances of the upset to the Director or his designee; and
  - (2) No later than five (5) days after becoming aware of the occurrence of the upset, the Permittee furnishes the Director with evidence, including properly signed, contemporaneous operating logs, or other relevant evidence, demonstrating that:
    - (i) An upset occurred;
    - (ii) The Permittee can identify the specific cause(s) of the upset;
    - (iii) The Permittee's facility was being properly operated at the time of the upset; and
    - (iv) The Permittee promptly took all reasonable steps to minimize any adverse impact on human health or the environment resulting from the upset.
- b. The permittee has the burden of establishing that each of the conditions of Provision II. C. 2. a. of this permit have been met to qualify for an exemption from the discharge limitations specified in Provision I. A. of this permit.

## **D. DUTY TO COMPLY WITH PERMIT, RULES, AND STATUTES**

### **1. Duty to Comply**

- a. The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the AWPCA and the FWPCA and is grounds for enforcement action, permit termination, revocation and reissuance, suspension, modification, or denial of a permit renewal application.
- b. The necessity to halt or reduce production or other activities in order to maintain compliance with the conditions of the permit shall not be a defense for a permittee in an enforcement action.
- c. The discharge of a pollutant from a source not specifically identified in the permit application for this permit and not specifically included in the description of an outfall in this permit is not authorized and shall constitute noncompliance with this permit.
- d. The permittee shall take all reasonable steps, including cessation of production or other activities, to minimize or prevent any violation of this permit or to minimize or prevent any adverse impact of any permit violation.



- e. Nothing in this permit shall be construed to preclude or negate the Permittee's responsibility to apply for, obtain, or comply with other Federal, State, or Local Government permits, certifications, or licenses or to preclude from obtaining other federal, state, or local approvals, including those applicable to other ADEM programs and regulations.

**2. Removed Substances**

Solids, sludges, filter backwash, or any other pollutant or other waste removed in the course of treatment or control of wastewaters shall be disposed of in a manner that complies with all applicable Department Rules.

**3. Loss or Failure of Treatment Facilities**

Upon the loss or failure of any treatment facilities, including but not limited to the loss or failure of the primary source of power of the treatment facility, the permittee shall, where necessary to maintain compliance with the discharge limitations specified in Provision I. A. of this permit, or any other terms or conditions of this permit, cease, reduce, or otherwise control production and/or all discharges until treatment is restored. If control of discharge during loss or failure of the primary source of power is to be accomplished by means of alternate power sources, standby generators, or retention of inadequately treated effluent, the permittee must furnish to the Director within six months a certification that such control mechanisms have been installed.

**4. Compliance with Statutes and Rules**

- a. This permit has been issued under ADEM Administrative Code, Chapter 335-6-6. All provisions of this chapter, that are applicable to this permit, are hereby made a part of this permit. A copy of this chapter may be obtained for a small charge from the Office of General Counsel, Alabama Department of Environmental Management, 1400 Coliseum Boulevard Montgomery, Alabama 36110-2059.
- b. This permit does not authorize the noncompliance with or violation of any Laws of the State of Alabama or the United States of America or any regulations or rules implementing such laws. FWPCA, 33 U.S.C. Section 1319, and Code of Alabama 1975, Section 22-22-14.

**E. PERMIT TRANSFER, MODIFICATION, SUSPENSION, REVOCATION, AND REISSUANCE**

**1. Duty to Reapply or Notify of Intent to Cease Discharge**

- a. If the permittee intends to continue to discharge beyond the expiration date of this permit, the permittee shall file a complete permit application for reissuance of this permit at least 180 days prior to its expiration. If the permittee does not intend to continue discharge beyond the expiration of this permit, the permittee shall submit written notification of this intent which shall be signed by an individual meeting the signatory requirements for a permit application as set forth in ADEM Administrative Code Rule 335-6-6-.09.
- b. Failure of the permittee to apply for reissuance at least 180 days prior to permit expiration will void the automatic continuation of the expiring permit provided by ADEM Administrative Code Rule 335-6-6-.06 and should the permit not be reissued for any reason any discharge after expiration of this permit will be an unpermitted discharge.

**2. Change in Discharge**

Prior to any facility expansion, process modification or any significant change in the method of operation of the permittee's treatment works, the permittee shall provide the Director with information concerning the planned expansion, modification or change. The permittee shall apply for a permit modification at least 180 days prior to any facility expansion, process modification, significant change in the method of operation of the permittee's treatment works, or other actions that could result in the discharge of additional pollutants or increase the quantity of a discharged pollutant or could result in an additional discharge point. This condition applies to pollutants that are or that are not subject to discharge limitations in this permit. No new or increased discharge may begin until the Director has authorized it by issuance of a permit modification or a reissued permit.

**3. Transfer of Permit**

This permit may not be transferred or the name of the permittee changed without notice to the Director and subsequent modification or revocation and reissuance of the permit to identify the new permittee and to incorporate any other changes as may be required under the FWPCA or AWPCA. In the case of a change in name, ownership or control of the permittee's premises only, a request for permit modification in a format acceptable to the Director is required at least 30 days prior to the change. In the case of a change in name, ownership, or control of the permittee's premises accompanied by a change or proposed change in effluent characteristics, a complete permit application is required to

be submitted to the Director at least 180 days prior to the change. Whenever the Director is notified of a change in name, ownership, or control, he may decide not to modify the existing permit and require the submission of a new permit application.

**4. Permit Modification and Revocation**

- a. This permit may be modified or revoked and reissued, in whole or in part, during its term for cause, including but not limited to, the following:
  - (1) If cause for termination under Provision II. E. 5. of this permit exists, the Director may choose to revoke and reissue this permit instead of terminating the permit;
  - (2) If a request to transfer this permit has been received, the Director may decide to revoke and reissue or to modify the permit; or
  - (3) If modification or revocation and reissuance is requested by the permittee and cause exists, the Director may grant the request.
- b. This permit may be modified during its term for cause, including but not limited to, the following:
  - (1) If cause for termination under Provision II. E. 5. of this permit exists, the Director may choose to modify this permit instead of terminating this permit;
  - (2) There are material and substantial alterations or additions to the facility or activity generating wastewater which occurred after permit issuance which justify the application of permit conditions that are different or absent in the existing permit;
  - (3) The Director has received new information that was not available at the time of permit issuance and that would have justified the application of different permit conditions at the time of issuance;
  - (4) A new or revised requirement(s) of any applicable standard or limitation is promulgated under Sections 301(b)(2)(C), (D), (E), and (F), and 307(a)(2) of the FWPCA;
  - (5) Errors in calculation of discharge limitations or typographical or clerical errors were made;
  - (6) To the extent allowed by ADEM Administrative Code, Rule 335-6-6-.17, when the standards or regulations on which the permit was based have been changed by promulgation of amended standards or regulations or by judicial decision after the permit was issued;
  - (7) To the extent allowed by ADEM Administrative Code, Rule 335-6-6-.17, permits may be modified to change compliance schedules;
  - (8) To agree with a granted variance under 301(c), 301(g), 301(h), 301(k), or 316(a) of the FWPCA or for fundamentally different factors;
  - (9) To incorporate an applicable 307(a) FWPCA toxic effluent standard or prohibition;
  - (10) When required by the reopener conditions in this permit;
  - (11) When required under 40 CFR 403.8(e) (compliance schedule for development of pretreatment program);
  - (12) Upon failure of the state to notify, as required by Section 402(b)(3) of the FWPCA, another state whose waters may be affected by a discharge permitted by this permit;
  - (13) When required to correct technical mistakes, such as errors in calculation, or mistaken interpretations of law made in determining permit conditions; or
  - (14) When requested by the permittee and the Director determines that the modification has cause and will not result in a violation of federal or state law, regulations or rules; or

**5. Termination**

This permit may be terminated during its term for cause, including but not limited to, the following:

- a. Violation of any term or condition of this permit;
- b. The permittee's misrepresentation or failure to disclose fully all relevant facts in the permit application or during the permit issuance process or the permittee's misrepresentation of any relevant facts at any time;
- c. Materially false or inaccurate statements or information in the permit application or the permit;

- d. A change in any condition that requires either a temporary or permanent reduction or elimination of the permitted discharge;
- e. The permittee's discharge threatens human life or welfare or the maintenance of water quality standards;
- f. Permanent closure of the facility generating the wastewater permitted to be discharged by this permit or permanent cessation of wastewater discharge;
- g. New or revised requirements of any applicable standard or limitation that is promulgated under Sections 301(b)(2)(C), (D), (E), and (F), and 307(a)(2) of the FWPCA that the Director determines cannot be complied with by the permittee.
- h. Any other cause allowed by the ADEM Administrative Code, Chapter 335-6-6.

#### **6. Suspension**

This permit may be suspended during its term for noncompliance until the permittee has taken action(s) necessary to achieve compliance.

#### **7. Stay**

The filing of a request by the permittee for modification, suspension, or revocation of this permit, in whole or in part, does not stay any permit term or condition.

### **F. COMPLIANCE WITH TOXIC POLLUTANT STANDARD OR PROHIBITION**

If any applicable effluent standard or prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is established under Section 307(a) of the FWPCA, 33 U.S.C. Section 1317(a), for a toxic pollutant discharged by the permittee and such standard or prohibition is more stringent than any discharge limitation on the pollutant specified in Provision I. A. of this permit, or controls a pollutant not limited in Provision I. A. of this permit, this permit shall be modified to conform to the toxic pollutant effluent standard or prohibition and the permittee shall be notified of such modification. If this permit has not been modified to conform to the toxic pollutant effluent standard or prohibition before the effective date of such standard or prohibition, the permittee shall attain compliance with the requirements of the standard or prohibition within the time period required by the standard or prohibition and shall continue to comply with the standard or prohibition until this permit is modified or reissued.

### **G. NOTICE TO DIRECTOR OF INDUSTRIAL USERS**

- 1. The permittee shall not allow the introduction of wastewater, other than domestic wastewater, from a new direct discharger prior to approval and permitting, if applicable, of the discharge by the Department.
- 2. The permittee shall not allow an existing indirect discharger to increase the quantity or change the character of its wastewater, other than domestic wastewater, prior to approval and permitting, if applicable, of the increased discharge by the Department.
- 3. The permittee shall report to the Department any adverse impact caused or believed to be caused by an indirect discharger on the treatment process, quality of discharged water or quality of sludge. Such report shall be submitted within seven days of the permittee becoming aware of the adverse impacts.

### **H. PROHIBITIONS**

The permittee shall not allow, and shall take effective enforcement action to prevent and terminate, the introduction of any of the following into its treatment works by industrial users:

- 1. Pollutants which create a fire or explosion hazard in the treatment works;
- 2. Pollutants which will cause corrosive structural damage to the treatment works, or dischargers with a pH lower than 5.0 s.u., unless the works are specifically designed to accommodate such discharges;
- 3. Solid or viscous pollutants in amounts which will cause obstruction of flow in sewers, or other interference with the treatment works;
- 4. Pollutants, including oxygen demanding pollutants, released in a discharge of such volume or strength as to cause interference in the treatment works;

5. Heat in amounts which will inhibit biological activity in the treatment plant resulting in interference or in such quantities that the temperature of the treatment plant influent exceeds 40 °C (104 °F) unless the treatment plant is designed to accommodate such heat;
6. Pollutants in amounts which exceed any applicable pretreatment standard under Section 307 of FWPCA or any approved revisions thereof.

## **PART III: ADDITIONAL REQUIREMENTS, CONDITIONS, AND LIMITATIONS**

### **A. CIVIL AND CRIMINAL LIABILITY**

#### **1. Tampering**

Any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained or performed under the permit shall, upon conviction, be subject to penalties as provided by the AWPCA.

#### **2. False Statements**

Any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or noncompliance shall, upon conviction, be subject to penalties as provided by the AWPCA.

#### **3. Permit Enforcement**

- a. Any NPDES permit issued or reissued by the Department is a permit for the purpose of the AWPCA and the FWPCA and as such any terms, conditions, or limitations of the permit are enforceable under state and federal law.
- b. Any person required to have a NPDES permit pursuant to ADEM Administrative Code Chapter 335-6-6 and who discharges pollutants without said permit, who violates the conditions of said permit, who discharges pollutants in a manner not authorized by the permit, or who violates applicable orders of the Department or any applicable rule or standard of the Department, is subject to any one or combination of the following enforcement actions under applicable state statutes:
  - (1) An administrative order requiring abatement, compliance, mitigation, cessation, clean-up, and/or penalties;
  - (2) An action for damages;
  - (3) An action for injunctive relief; or
  - (4) An action for penalties.
- c. If the permittee is not in compliance with the conditions of an expiring or expired permit the Director may choose to do any or all of the following provided the permittee has made a timely and complete application for reissuance of the permit:
  - (1) Initiate enforcement action based upon the permit which has been continued;
  - (2) Issue a notice of intent to deny the permit reissuance. If the permit is denied, the owner or operator would then be required to cease the activities authorized by the continued permit or be subject to enforcement action for operating without a permit;
  - (3) Reissue the new permit with appropriate conditions; or
  - (4) Take other actions authorized by these rules and AWPCA.

#### **4. Relief from Liability**

Except as provided in Provision II. C. 1. (Bypass) and Provision II. C. 2. (Upset), nothing in this permit shall be construed to relieve the permittee of civil or criminal liability under the AWPCA or FWPCA for noncompliance with any term or condition of this permit.

### **B. OIL AND HAZARDOUS SUBSTANCE LIABILITY**

Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities or penalties to which the permittee is or may be subject under Section 311 of the FWPCA, 33 U.S.C. Section 1321.

### **C. PROPERTY AND OTHER RIGHTS**

This permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to persons or property or invasion of other private rights, or any infringement of federal, state, or local laws or regulations, nor does it authorize or approve the construction of any physical structures or facilities or the undertaking of any work in any waters of the state or of the United States.

#### **D. AVAILABILITY OF REPORTS**

Except for data determined to be confidential under Code of Alabama 1975, Section 22-22-9(c), all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Department. Effluent data shall not be considered confidential.

#### **E. EXPIRATION OF PERMITS FOR NEW OR INCREASED DISCHARGES**

1. If this permit was issued for a new discharger or new source, this permit shall expire eighteen months after the issuance date if construction of the facility has not begun during the eighteen-month period.
2. If this permit was issued or modified to allow the discharge of increased quantities of pollutants to accommodate the modification of an existing facility, and if construction of this modification has not begun during the eighteen month period after issuance of this permit or permit modification, this permit shall be modified to reduce the quantities of pollutants allowed to be discharged to those levels that would have been allowed if the modification of the facility had not been planned.
3. Construction has begun when the owner or operator has:
  - a. Begun, or caused to begin as part of a continuous on-site construction program:
    - (1) Any placement, assembly, or installation of facilities or equipment; or
    - (2) Significant site preparation work including clearing, excavation, or removal of existing buildings, structures, or facilities which are necessary for the placement, assembly, or installation of new source facilities or equipment; or
  - b. Entered into a binding contractual obligation for the purpose of placement, assembly, or installation of facilities or equipment which are intended to be used in its operation within a reasonable time. Options to purchase or contracts which can be terminated or modified without substantial loss, and contracts for feasibility, engineering, and design studies do not constitute a contractual obligation under this paragraph.
4. Final plans and specifications for a waste treatment facility at a new source or new discharger, or a modification to an existing waste treatment facility must be submitted to and examined by the Department prior to initiating construction of such treatment facility by the permittee.
5. Upon completion of construction of waste treatment facilities and prior to operation of such facilities, the permittee shall submit to the Department a certification from a registered professional engineer, licensed to practice in the State of Alabama, that the treatment facilities have been built according to plans and specifications submitted to and examined by the Department.

#### **F. COMPLIANCE WITH WATER QUALITY STANDARDS**

1. On the basis of the permittee's application, plans, or other available information, the Department has determined that compliance with the terms and conditions of this permit should assure compliance with the applicable water quality standards.
2. Compliance with permit terms and conditions notwithstanding, if the permittee's discharge(s) from point sources identified in Provision I. A. of this permit cause or contribute to a condition in contravention of state water quality standards, the Department may require abatement action to be taken by the permittee in emergency situations or modify the permit pursuant to the Department's Rules, or both.
3. If the Department determines, on the basis of a notice provided pursuant to this permit or any investigation, inspection or sampling, that a modification of this permit is necessary to assure maintenance of water quality standards or compliance with other provisions of the AWPCA or FWPCA, the Department may require such modification and, in cases of emergency, the Director may prohibit the discharge until the permit has been modified.

#### **G. GROUNDWATER**

Unless specifically authorized under this permit, this permit does not authorize the discharge of pollutants to groundwater. Should a threat of groundwater contamination occur, the Director may require groundwater monitoring to properly assess the degree of the problem, and the Director may require that the permittee undertake measures to abate any such discharge and/or contamination.

## H. DEFINITIONS

1. **Average monthly discharge limitation** - means the highest allowable average of "daily discharges" over a calendar month, calculated as the sum of all "daily discharges" measured during a calendar month divided by the number of "daily discharges" measured during that month (zero discharge days shall not be included in the number of "daily discharges" measured and a less than detectable test result shall be treated as a concentration of zero if the most sensitive EPA approved method was used).
2. **Average weekly discharge limitation** - means the highest allowable average of "daily discharges" over a calendar week, calculated as the sum of all "daily discharges" measured during a calendar week divided by the number of "daily discharges" measured during that week (zero discharge days shall not be included in the number of "daily discharges" measured and a less than detectable test result shall be treated as a concentration of zero if the most sensitive EPA approved method was used).
3. **Arithmetic Mean** – means the summation of the individual values of any set of values divided by the number of individual values.
4. **AWPCA** - means the Alabama Water Pollution Control Act.
5. **BOD** – means the five-day measure of the pollutant parameter biochemical oxygen demand.
6. **Bypass** - means the intentional diversion of waste streams from any portion of a treatment facility.
7. **CBOD** – means the five-day measure of the pollutant parameter carbonaceous biochemical oxygen demand.
8. **Daily discharge** - means the discharge of a pollutant measured during any consecutive 24-hour period in accordance with the sample type and analytical methodology specified by the discharge permit.
9. **Daily maximum** - means the highest value of any individual sample result obtained during a day.
10. **Daily minimum** - means the lowest value of any individual sample result obtained during a day.
11. **Day** - means any consecutive 24-hour period.
12. **Department** - means the Alabama Department of Environmental Management.
13. **Director** - means the Director of the Department.
14. **Discharge** - means "[t]he addition, introduction, leaking, spilling or emitting of any sewage, industrial waste, pollutant or other waste into waters of the state". Code of Alabama 1975, Section 22-22-1(b)(9).
15. **Discharge Monitoring Report (DMR)** - means the form approved by the Director to accomplish reporting requirements of an NPDES permit.
16. **DO** – means dissolved oxygen.
17. **8HC** – means 8-hour composite sample, including any of the following:
  - a. The mixing of at least 8 equal volume samples collected at constant time intervals of not more than 1 hour over a period of not less than 8 hours between the hours of 6:00 a.m. and 6:00 p.m. If the sampling period exceeds 8 hours, sampling may be conducted beyond the 6:00 a.m. to 6:00 p.m. period.
  - b. A sample continuously collected at a constant rate over period of not less than 8 hours between the hours of 6:00 a.m. and 6:00 p.m. If the sampling period exceeds 8 hours, sampling may be conducted beyond the 6:00 a.m. to 6:00 p.m. period.
18. **EPA** - means the United States Environmental Protection Agency.
19. **FC** – means the pollutant parameter fecal coliform.
20. **Flow** – means the total volume of discharge in a 24-hour period.
21. **FWPCA** - means the Federal Water Pollution Control Act.
22. **Geometric Mean** – means the Nth root of the product of the individual values of any set of values where N is equal to the number of individual values. The geometric mean is equivalent to the antilog of the arithmetic mean of the logarithms of the individual values. For purposes of calculating the geometric mean, values of zero (0) shall be considered one (1).



23. **Grab Sample** – means a single influent or effluent portion which is not a composite sample. The sample(s) shall be collected at the period(s) most representative of the discharge.
24. **Indirect Discharger** – means a nondomestic discharger who discharges pollutants to a publicly owned treatment works or a privately owned treatment facility operated by another person.
25. **Industrial User** – means those industries identified in the Standard Industrial Classification manual, Bureau of the Budget 1967, as amended and supplemented, under the category “Division D – Manufacturing” and such other classes of significant waste producers as, by regulation, the Director deems appropriate.
26. **MGD** – means million gallons per day.
27. **Monthly Average** – means the arithmetic mean of all the composite or grab samples taken for the daily discharges collected in one month period. The monthly average for flow is the arithmetic mean of all flow measurements taken in a one month period.
28. **New Discharger** – means a person, owning or operating any building, structure, facility, or installation:
  - a) From which there is or may be a discharge of pollutants;
  - b) That did not commence the discharge of pollutants prior to August 13, 1979, and which is not a new source; and
  - c) Which has never received a final effective NPDES permit for dischargers at that site.
29. **NH3-N** – means the pollutant parameter ammonia, measured as nitrogen.
30. **Notifiable sanitary sewer overflow** - means an overflow, spill, release or diversion of wastewater from a sanitary sewer system that:
  - a) Reaches a surface water of the State; or
  - b) May imminently and substantially endanger human health based on potential for public exposure including but not limited to close proximity to public or private water supply wells or in areas where human contact would be likely to occur.
31. **Permit application** - means forms and additional information that is required by ADEM Administrative Code Rule 335-6-6-.08 and applicable permit fees.
32. **Point source** - means "any discernible, confined and discrete conveyance, including but not limited to any pipe, channel, ditch, tunnel, conduit, well, discrete fissure, container, rolling stock, concentrated animal feeding operation, or vessel or other floating craft, . . . from which pollutants are or may be discharged." Section 502(14) of the FWPCA, 33 U.S.C. Section 1362(14).
33. **Pollutant** - includes for purposes of this permit, but is not limited to, those pollutants specified in Code of Alabama 1975, Section 22-22-1(b)(3) and those effluent characteristics specified in Provision I. A. of this permit.
34. **Privately Owned Treatment Works** – means any devices or system which is used to treat wastes from any facility whose operator is not the operator of the treatment works, and which is not a “POTW”.
35. **Publicly Owned Treatment Works (POTW)** – means a wastewater collection and treatment facility owned by the State, municipality, regional entity composed of two or more municipalities, or another entity created by the State or local authority for the purpose of collecting and treating municipal wastewater.
36. **Receiving Stream** – means the “waters” receiving a “discharge” from a “point source”.
37. **Severe property damage** - means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
38. **Significant Source** – means a source which discharges 0.025 MGD or more to a POTW or greater than five percent of the treatment work’s capacity, or a source which is a primary industry as defined by the U.S. EPA or which discharges a priority or toxic pollutant.
39. **TKN** – means the pollutant parameter Total Kjeldahl Nitrogen.
40. **TON** – means the pollutant parameter Total Organic Nitrogen.
41. **TRC** – means Total Residual Chlorine.

42. **TSS** – means the pollutant parameter Total Suspended Solids.
43. **24HC** – means 24-hour composite sample, including any of the following:
- a) The mixing of at least 8 equal volume samples collected at constant time intervals of not more than 2 hours over a period of 24 hours;
  - b) A sample collected over a consecutive 24-hour period using an automatic sampler composite to one sample. As a minimum, samples shall be collected hourly and each shall be no more than one twenty-fourth (1/24) of the total sample volume collected;
  - c) A sample collected over a consecutive 24-hour period using an automatic composite sampler composited proportional to flow.
44. **Upset** - means an exceptional incident in which there is an unintentional and temporary noncompliance with technology-based permit discharge limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
45. **Waters** - means "[a]ll waters of any river, stream, watercourse, pond, lake, coastal, ground or surface water, wholly or partially within the state, natural or artificial. This does not include waters which are entirely confined and retained completely upon the property of a single individual, partnership or corporation unless such waters are used in interstate commerce." Code of Alabama 1975, Section 22-22-1(b)(2). Waters "include all navigable waters" as defined in Section 502(7) of the FWPCA, 22 U.S.C. Section 1362(7), which are within the State of Alabama.
46. **Week** - means the period beginning at twelve midnight Saturday and ending at twelve midnight the following Saturday.
47. **Weekly (7-day and calendar week) Average** – is the arithmetic mean of all samples collected during a consecutive 7-day period or calendar week, whichever is applicable. The calendar week is defined as beginning on Sunday and ending on Saturday. Weekly averages shall be calculated for all calendar weeks with Saturdays in the month. If a calendar week overlaps two months (i.e., the Sunday is in one month and the Saturday in the following month), the weekly average calculated for the calendar week shall be included in the data for the month that contains the Saturday.

## **I. SEVERABILITY**

The provisions of this permit are severable, and if any provision of this permit or the application of any provision of this permit to any circumstance is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

## **PART IV: SPECIFIC REQUIREMENTS, CONDITIONS, AND LIMITATIONS**

### **A. SLUDGE MANAGEMENT PRACTICES**

#### **1. Applicability**

- a. Provisions of Provision IV.A. apply to a sewage sludge generated or treated in treatment works that is applied to agricultural and non-agricultural land, or that is otherwise distributed, marketed, incinerated, or disposed in landfills or surface disposal sites.
- b. Provisions of Provision IV.A. do not apply to:
  - (1) Sewage sludge generated or treated in a privately owned treatment works operated in conjunction with industrial manufacturing and processing facilities and which receive no domestic wastewater.
  - (2) Sewage sludge that is stored in surface impoundments located at the treatment works prior to ultimate disposal.

#### **2. Submitting Information**

- a. If applicable, the Permittee must submit annually with its Municipal Water Pollution Prevention (MWPP) report the following:
  - (1) Type of sludge stabilization/digestion method;
  - (2) Daily or annual sludge production (dry weight basis);
  - (3) Ultimate sludge disposal practice(s).
- b. The Permittee shall provide sludge inventory data to the Director as requested. These data may include, but are not limited to, sludge quantity and quality reported in Provision IV.A.2.a as well as other specific analyses required to comply with State and Federal laws regarding solid and hazardous waste disposal.
- c. The Permittee shall give prior notice to the Director of at least 30 days of any change planned in the Permittee's sludge disposal practices.

#### **3. Reopener or Modification**

- a. Upon review of information provided by the Permittee as required by Provision IV.A.2. or, based on the results of an on-site inspection, the permit shall be subject to modification to incorporate appropriate requirements.
- b. If an applicable "acceptable management practice" or if a numerical limitation for a pollutant in sewage sludge promulgated under Section 405 of FWPCA is more stringent than the sludge pollutant limit or acceptable management practice in this permit. This permit shall be modified or revoked or reissued to conform to requirements promulgated under Section 405. The Permittee shall comply with the limitations no later than the compliance deadline specified in applicable regulations as required by Section 405 of FWPCA.

### **B. EFFLUENT TOXICITY TESTING REOPENER**

Upon notification under Part II.G. of any newly introduced toxic industrial wastewaters, the Director may reopen the permit to include effluent toxicity limitations and testing requirements.

### **C. TOTAL RESIDUAL CHLORINE (TRC) REQUIREMENTS**

1. If chlorine is not utilized for disinfection purposes, TRC monitoring under Part I of this Permit is not required. If TRC monitoring is not required (conditional monitoring), "\*9" should be reported on the DMR forms.
2. Testing for TRC shall be conducted according to either the amperometric titration method or the DPD colorimetric method as specified in Section 408(C) or (E), Standards Methods for the Examination of Water and Wastewater, 18th edition. If chlorine is not detected prior to actual discharge to the receiving stream using one of these methods (i.e., the analytical result is less than the detection level), the Permittee shall report on the DMR form "\*B" or "0". The Permittee shall then be considered to be in compliance with the daily maximum concentration limit for TRC.
3. This permit contains a maximum allowable TRC level in the effluent. The Permittee is responsible for determining the minimum TRC level needed in the chlorine contact chamber to comply with E.coli limits. The effluent shall be dechlorinated if necessary to meet the maximum allowable effluent TRC level.

4. The sample collection point for effluent TRC shall be at a point downstream of the chlorine contact chamber (downstream of dechlorination, if applicable). The exact location is to be approved by the Director.

#### **D. PLANT CLASSIFICATION**

The Permittee shall report to the Director within 30 days of the effective date of this permit, the name, address and operator number of the certified wastewater operator in responsible charge of the facility. Unless specified elsewhere in this permit, this facility shall be classified in accordance with ADEM Admin. Code R. 335-10-1-.03.

#### **E. SANITARY SEWER OVERFLOW RESPONSE PLAN**

##### **1. SSO Response Plan**

Within 120 days of the effective date of this Permit, the Permittee shall develop a Sanitary Sewer Overflow (SSO) Response Plan to establish timely and effective methods for responding to notifiable sanitary sewer overflows. The SSO Response Plan shall address each of the following:

##### **a. General Information**

- (1) Approximate population of City/Town, if applicable
- (2) Approximate number of customers served by the Permittee
- (3) Identification of any subbasins designated by the Permittee, if applicable
- (4) Identification of estimated linear feet of sanitary sewers
- (5) Number of Pump/Lift Stations in the collection system

##### **b. Responsibility Information**

- (1) The title(s) and contact information of key position(s) who will coordinate the SSO response, including information for a backup coordinator in the event that the primary SSO coordinator is unavailable. The SSO coordinator is the person responsible for assessing the SSO and initiating a series of response actions based on the type, severity, and destination of the SSO, except for routine SSOs for which the coordinator may pre-approve written procedures. Routine SSOs are those for which the corrective action procedures are generally consistent.
- (2) The title(s), and contact information of key position(s) who will respond to SSOs, including information for backup responder(s) in the event the primary responder(s) are unavailable (i.e., position(s) who provide notification to the Department, the public, the county health department, and other affected entities such as public water systems; position(s) responsible for organizing crews for response; position(s) responsible for addressing public inquiries)

##### **c. SSO and Surface Water Assessment**

- (1) Identification of locations within the collection system at which an SSO is likely to occur (e.g., based upon historical SSOs, lift stations where electricity may be lost, etc.)
- (2) A map of the general collection system area, including identification of surface waterbodies and the location(s) of public drinking water source(s). Mapping of all collection system piping, pump stations, etc. is not required; however, if this information is already available, it should be included.
- (3) Identification of surface waterbodies within the collection system area which are classified as Swimming according to ADEM Admin. Code chap. 335-6-11. References available to assist in this requirement include the following: <http://adem.alabama.gov/alEnviroRegLaws/files/Division6Vol1.pdf> and <http://adem.alabama.gov/wqmap>.
- (4) Identification of surface waterbodies within the collection system area which are not classified as Swimming as indicated in paragraph c above, but are known locally as areas where swimming occurs or as areas that are heavily recreated

##### **d. Public Reporting of SSOs**

- (1) Contact information for the public to report an SSO to the Permittee, during both normal and outside of normal business hours (e.g., telephone number, website, email address, etc.)

- (2) Information requested from the person reporting an SSO to assist the Permittee in identifying the SSO (e.g., date, time, location, contact information)
- (3) Procedures for communication of the SSO report to the appropriate positions for follow-up investigation and response, if necessary
- e. Procedures to immediately notify the Department, the county health department, and other affected entities (such as public water systems) upon becoming aware of notifiable SSOs
- f. Public Notification Methods for SSOs
  - (1) A listing of methods that are feasible, as determined by the Permittee, for public notifications (e.g., flyers distributed to nearby residents; signs posted at the location of the SSO, where the SSO enters a water of the state, and/or at a central public location; signs posted at fishing piers, boat launches, parks, swimming waterbodies, etc.; website and/or social media notifications; local print or radio and broadcast media notifications; "opt in" email, text message, or automated phone message notifications)
    - (i) If signage is a feasible method for public notification, procedures for use and removal of signage (e.g., availability and maintenance of signs, appropriate duration of postings)
  - (2) Minimum information to be included in public notifications (e.g., identification that an SSO has occurred, date, duration if known, estimated volume if known, location of the SSO by street address or other appropriate method, initial destination of the SSO)
  - (3) Procedures developed by the Permittee for determining the appropriate public notification method(s) based upon the potential for public exposure to health risks associated with the SSO
- g. Standard Procedures shall be developed by the Permittee and shall include, at a minimum
  - (1) General SSO Response Procedures (e.g., procedures for dispatching staff to assess/correct an SSO; procedures for routine SSO corrective actions such as those for sewer blockages, overflowing manholes, line breakages, pump station power failure, etc.; procedures for disinfection of affected area, if applicable);
  - (2) Procedures for collection and proper disposal of the SSO, if feasible.
  - (3) General procedures for coordinating instream water quality monitoring, including, but not limited to, procedures for mobilizing staff, collecting samples, and typical test methods should the Department or the Permittee determine monitoring is appropriate following an SSO. Identification of a contractor who will collect and analyze the sample(s) may be listed in lieu of the procedures.
  - (4) References to other documents (such as Standard Operating Procedures for SSO Responses) may be acceptable for this section; however, the referenced document shall be identified and shall be reviewed at a frequency of at least that required by the Administrative Procedures Section.
- h. Date of the SSO Response Plan, dates of all modifications and/or reviews, the title and signature of the reviewer(s) for each date and the signature of the responsible official or the appropriate designee.

## **2. SSO Response Plan Implementation**

Except as otherwise required by this Permit, the Permittee shall fully implement the SSO Response Plan as soon as practicable, but no later than 180 days after the effective date of this Permit.

## **3. Department Review of the SSO Response Plan**

- a. When requested by the Director or his designee, the Permittee shall make the SSO Response Plan available for review by the Department.
- b. Upon review, the Director or his designee may notify the Permittee that the SSO Response Plan is deficient and require modification of the Plan.
- c. Within thirty days of receipt of notification, or an alternate timeframe as approved by the Department, the Permittee shall modify any SSO Response Plan deficiency identified by the Director or his designee and shall certify to the Department that the modification has been made.

## **4. SSO Response Plan Administrative Procedures**

- a. The Permittee shall maintain a copy of the SSO Response Plan at the permitted facility or an alternate location approved by the Department in writing and shall make it available for inspection by the Department.

- b. The Permittee shall make a copy of the SSO Response Plan available to the public upon written request within 30 days of such request. The Permittee may redact information which may present security issues, such as location of public water supplies, identification of specific details of vulnerabilities, employee information, etc.
- c. The Permittee shall provide training for any personnel required to implement the SSO Response Plan and shall retain at the facility documentation of such training. This documentation shall be available for inspection by the Department. Training shall be provided for existing personnel prior to the date by which implementation of the SSO Response Plan is required and for new personnel as soon as possible. Should significant revisions be made to the SSO Response Plan, training regarding the revisions shall be conducted as soon as possible.
- d. The Permittee shall complete a review and evaluation of the SSO Response Plan at least once every three years. Documentation of the SSO Response Plan review and evaluation shall be signed and dated by the responsible official or the appropriate designee as part of the SSO Response Plan.

## NPDES PERMIT RATIONALE

NPDES Permit No: **AL0055158** Date: December 8, 2022

Permit Applicant: Harvest-Monrovia Water, Sewer and Fire Protection Authority, Inc.  
PO Box 329  
Harvest, AL 35749

Location: **Hunter's Crossing WWTP**  
195 Marlboro Way  
Madison, AL 35757

Draft Permit is: Initial Issuance:  
Reissuance due to expiration: **X**  
Modification of existing permit:  
Revocation and Reissuance:

Basis for Limitations: Water Quality Model: CBOD<sub>5</sub>, DO, NH<sub>3</sub>-N,  
Reissuance with no modification: CBOD<sub>5</sub>, CBOD<sub>5</sub> % Removal, DO, E. Coli,  
NH<sub>3</sub>-N, pH, TRC, TSS, TSS % Removal  
Instream calculation at 7Q10: 100%  
Toxicity based: TRC  
Secondary Treatment Levels: CBOD<sub>5</sub> % Removal, TSS, TSS % Removal  
Other (described below): E. Coli, pH

Design Flow in Million Gallons per Day: 0.075 MGD

Major: No

Description of Discharge:

| Feature ID | Description         | Receiving Water | WBC               | 303(d) | TMDL |
|------------|---------------------|-----------------|-------------------|--------|------|
| 0011       | Domestic Wastewater | Knox Creek      | Fish and Wildlife | No     | No   |

Discussion:

This is a permit reissuance due to expiration. The Permittee name is being updated in this reissuance.

Limits for Five Day Carbonaceous Biochemical Oxygen Demand (CBOD<sub>5</sub>), Dissolved Oxygen (DO), and Total Ammonia-Nitrogen (NH<sub>3</sub>-N), were developed based on a Waste Load Allocation (WLA) model that was completed by ADEM's Water Quality Branch (WQB) on November 21, 2022. The monthly average limits for CBOD<sub>5</sub> summer (April-October) and winter (November-March) are 9.0 mg/L and 14.0 mg/L, respectively. The monthly average limits for NH<sub>3</sub>-N summer (April-October) and winter (November-March) are 1.2 mg/L and 2.1 mg/L, respectively. The daily minimum DO limit is 6.0 mg/L.

The pH daily minimum and daily maximum limits of 6.0 and 8.5 S.U, respectively, were developed to be supportive of the water-use classification of the receiving stream. The Total Residual Chlorine (TRC) limits of 0.011 mg/L (monthly average) and 0.019 mg/L (daily maximum) are based on EPA's recommended water quality values and on the current Toxicity Rationale, which considers the available dilution in the receiving stream. In accordance with a letter dated August 11, 1998 from EPA Headquarters and a 1991 memorandum from EPA Region 4's Environmental Services Division (ESD), due to testing and method detection limitations, a Total Residual Chlorine measurement below 0.05 mg/L shall be considered below detection for compliance purposes. Monitoring for TRC is only applicable



if chlorine is utilized for disinfection purposes. . If monitoring is not applicable during the monitoring period, enter “\*9” on the monthly DMR.

The imposed E. coli limits were determined based on the water-use classification of the receiving stream. Since Knox Creek is classified as Fish & Wildlife, the limits for May – October are 126 col/100ml (monthly average) and 298 col/100ml (daily maximum), while the limits for November – April are 548 col/100ml (monthly average) and 2507 col/100ml (daily maximum).

The Total Suspended Solids (TSS) and TSS % removal limits of 30.0 mg/L monthly average and 85.0%, respectively, are based on the requirements of 40 CFR part 133.102 regarding Secondary Treatment. A minimum percent removal limit of 85.0% is imposed for CBOD<sub>5</sub> also in accordance with 40 CFR 133.102 regarding Secondary Treatment.

This permit requires the Permittee to monitor and report during the summer (April-October) the nutrient-related parameters of Nitrate plus Nitrite Nitrogen (NO<sub>2</sub>+NO<sub>3</sub>-N), Total Kjeldahl Nitrogen (TKN), and Total Phosphorus (TP). Monitoring for these nutrient related parameters is imposed so that sufficient information will be available regarding the nutrient contribution from this point source, should it be necessary at some later time to impose nutrient limits on this discharge.

Because this is a minor facility (design capacity less than 1 MGD) treating only domestic wastewater with no industrial wastewater contributions, no potential toxicity concerns are anticipated and thus there is no need to impose chronic or acute bioassay testing under this permit.

The monitoring frequency for CBOD<sub>5</sub>, DO, E. Coli, NH<sub>3</sub>-N, pH, TRC and TSS is once per week. The monitoring frequency for nutrient-related parameters NO<sub>2</sub>+NO<sub>3</sub>-N, TKN, and TP is once per month during the April through October summer growing season. CBOD<sub>5</sub> % removal and TSS % removal are to be calculated once per month. Flow is to be measured instantaneously once per week.

Knox Creek is a Tier I stream and is not listed on the most recent 303(d) list. There are no TMDLs affecting this discharge.

ADEM Administrative Rule 335-6-10-.12 requires applicants for new or expanded discharges to Tier II waters demonstrate that the proposed discharge is necessary for important economic or social development in the area in which the waters are located. The application submitted by the facility is not for a new or expanded discharge to a Tier II water body, so the applicant is not required to demonstrate that the discharge is necessary for economic and social development.

The permit language in Parts I.C.1.c and I.C.2.e has been updated to reflect the electronic discharge monitoring reporting and sanitary sewer overflow reporting requirements due to the transition to the Department’s new Alabama Environmental Permitting and Compliance System (AEPACS) from the E2 Reporting System.

Prepared by: Michael N. Simmons

## TOXICITY AND DISINFECTION RATIONALE

|  |                               |   |
|--|-------------------------------|---|
| Facility Name:                                 | <b>Hunter's Crossing WWTP</b> |   |
| NPDES Permit Number:                           | <b>AL0055158</b>              |   |
| Receiving Stream:                              | <b>Knox Creek</b>             |   |
| Facility Design Flow (Q <sub>w</sub> ):        | <b>0.075 MGD</b>              |   |
| Receiving Stream 7Q <sub>10</sub> :            | <b>0.000 cfs</b>              |   |
| Receiving Stream 1Q <sub>10</sub> :            | <b>0.000 cfs</b>              |   |
| Winter Headwater Flow (WHF):                   | <b>0.00 cfs</b>               |   |
| Summer Temperature for CCC:                    | <b>28 deg. Celsius</b>        |   |
| Winter Temperature for CCC:                    | <b>18 deg. Celsius</b>        |   |
| Headwater Background NH <sub>3</sub> -N Level: | <b>0.11 mg/l</b>              |   |
| Receiving Stream pH:                           | <b>7.0 s.u.</b>               |   |
| Headwater Background FC Level (summer):        | <b>N./A.</b>                  | <b>(Only applicable for facilities with diffusers.)</b> |
| (winter)                                       | <b>N./A.</b>                  |   |

The Stream Dilution Ratio (SDR) is calculated using the 7Q10 for all stream classifications.

$$\text{Stream Dilution Ratio (SDR)} = \frac{Q_w}{7Q_{10} + Q_w} = 100.00\%$$

### AMMONIA TOXICITY LIMITATIONS

Toxicity-based ammonia limits are calculated in accordance with the *Ammonia Toxicity Protocol* and the *General Guidance for Writing Water Quality Based Toxicity Permits*.

If the Limiting Dilution is less than 1%, the waterbody is considered stream-dominated and the CMC applies.

If the Limiting Dilution is greater than 1%, the waterbody is considered effluent-dominated and the CCC applies.

$$\begin{aligned} \text{Limiting Dilution} &= \frac{Q_w}{7Q_{10} + Q_w} \\ &= 100.00\% \quad \text{Effluent-Dominated, CCC Applies} \end{aligned}$$

$$\begin{aligned} \text{Criterion Maximum Concentration (CMC):} & \quad \text{CMC} = 0.411 / (1 + 10^{(7.204 - \text{pH})}) + 58.4 / (1 + 10^{(\text{pH} - 7.204)}) \\ \text{Criterion Continuous Concentration (CCC):} & \quad \text{CCC} = [0.0577 / (1 + 10^{(7.688 - \text{pH})}) + 2.487 / (1 + 10^{(\text{pH} - 7.688)})] * \text{Min}[2.85, 1.45 * 10^{(0.028 * (25 - T))}] \end{aligned}$$

|   | <u>CMC</u>        | <u>CCC</u>       |
|---|-------------------|------------------|
| Allowable Summer Instream NH <sub>3</sub> -N: | <b>36.09 mg/l</b> | <b>2.48 mg/l</b> |
| Allowable Winter Instream NH <sub>3</sub> -N: | <b>36.09 mg/l</b> | <b>4.72 mg/l</b> |

$$\begin{aligned} \text{Summer NH}_3\text{-N Toxicity Limit} &= \frac{[(\text{Allowable Instream NH}_3\text{-N}) * (7Q_{10} + Q_w)] - [(\text{Headwater NH}_3\text{-N}) * (7Q_{10})]}{Q_w} \\ &= 2.5 \text{ mg/l NH}_3\text{-N at 7Q}_{10} \end{aligned}$$

$$\begin{aligned} \text{Winter NH}_3\text{-N Toxicity Limit} &= \frac{[(\text{Allowable Instream NH}_3\text{-N}) * (\text{WHF} + Q_w)] - [(\text{Headwater NH}_3\text{-N}) * (\text{WHF})]}{Q_w} \\ &= 4.8 \text{ mg/l NH}_3\text{-N at Winter Flow} \end{aligned}$$

The ammonia limits established in the permit will be the lesser of the DO-based ammonia limit (from the wasteload allocation model) or the toxicity limits calculated above.

|        | <u>DO-based NH<sub>3</sub>-N limit</u> | <u>Toxicity-based NH<sub>3</sub>-N limit</u> |
|--------|--|--|
| Summer | <b>1.20 mg/l NH<sub>3</sub>-N</b>      | <b>2.50 mg/l NH<sub>3</sub>-N</b>            |
| Winter | <b>2.10 mg/l NH<sub>3</sub>-N</b>      | <b>4.80 mg/l NH<sub>3</sub>-N</b>            |

**Summer: The DO based limit of 1.20 mg/l NH<sub>3</sub>-N applies.**

**Winter: The DO based limit of 2.10 mg/l NH<sub>3</sub>-N applies.**

## TOXICITY TESTING REQUIREMENTS (REFERENCE: MUNICIPAL BRANCH TOXICITY PERMITTING STRATEGY)

The following factors trigger toxicity testing requirements:

1. Facility design flow is equal to or greater than 1.0 MGD (major facility).
2. There are significant industrial contributors (SID permits).

Acute toxicity testing is specified for A&I receiving streams, or for stream dilution ratios of 1% or less.

Chronic toxicity testing is specified for all other situations requiring toxicity testing.

**This is a minor facility (Qw < 1.0 MGD) with no SID permits. No toxicity testing is required.**

$$\text{Instream Waste Concentration (IWC)} = \frac{Q_w}{7Q_{10} + Q_w} = 100.00\% \quad \text{Note: This number will be rounded up for toxicity testing purposes.}$$

## DISINFECTION REQUIREMENTS

Bacteria limits are required, and will be the water quality limit for the receiving stream, except where diffusers are used the limit may be adjusted for the dilution provided by the diffuser.

See the attached Disinfection Guidance for applicable stream standards.

**(Non-coastal limits apply)**

Applicable Stream Classification: **Fish & Wildlife**

Disinfection Type: **Chlorination**

Limit calculation method: **Limits based on meeting stream standards at the point of discharge.**

|   | Stream Standard<br>(colonies/100ml) | Effluent Limit<br>(colonies/100ml) |
|---|-------------------------------------|------------------------------------|
| <b><u>E. Coli (applies to Non-coastal and Shellfish Harvesting Coastal)</u></b> |                                     |                                    |
| Monthly limit as monthly average (November through April):                      | 548                                 | <b>548</b>                         |
| Monthly limit as monthly average (May through October):                         | 126                                 | <b>126</b>                         |
| Daily Max (November through April):   | 2507                                | <b>2507</b>                        |
| Daily Max (May through October):  | 298                                 | <b>298</b>                         |
| <b><u>Enterococci (applies to Coastal)</u></b>                                  |                                     |                                    |
| Monthly limit as geometric mean (November through April):                       | Not applicable                      | <b>Not applicable</b>              |
| Monthly limit as geometric mean (May through October):                          | Not applicable                      | <b>Not applicable</b>              |
| Daily Max (November through April):   | Not applicable                      | <b>Not applicable</b>              |
| Daily Max (May through October):  | Not applicable                      | <b>Not applicable</b>              |

## MAXIMUM ALLOWABLE CHLORINATION LIMITS

Toxicity-based chlorine limits are calculated in accordance with the General Guidance for Writing Water Quality Based Toxicity Permits.

Chlorine has been shown to be acutely toxic at 0.019 mg/l and chronically toxic at 0.011 mg/l.

|                                    |                      |               |
|------------------------------------|----------------------|---------------|
| Maximum allowable TRC in effluent: | 0.011 mg/l (chronic) | (0.011)/(SDR) |
| Maximum allowable TRC in effluent: | 0.019 mg/l (acute)   | (0.019)/(SDR) |

NOTE: A maximum chlorine limit will be imposed such that the instream concentration will not exceed acutely toxic concentrations in A & I streams and chronically toxic concentrations in all other streams, but may not exceed 1.0 mg/l.

Prepared By:

Michael Simmons

Date:

11/28/2022

# Waste Load Allocation Summary

Page 1

## REQUEST INFORMATION

Request Number: 3900

|  |                        |   |                              |
|--|------------------------|---|------------------------------|
| From:  | Michael Simmons        | In Branch/Section   | Municipal                    |
| Date Submitted                                       | 9/8/2022               | Date Required   | 10/8/2022                    |
| FUND Code  | 605                    |   |                              |
| Date Permit application received by NPDES program    |                        | 8/4/2022  |                              |
| Receiving Waterbody                                  | Knox Creek             |   |                              |
| Previous Stream Name                                 |                        |   |                              |
| Facility Name  | Hunter's Crossing WWTP | (Name of Discharger-WQ will use to file)                            |                              |
|  |                        | Previous Discharger Name  |                              |
| River Basin  | Tennessee              | Outfall Latitude  | 34.772632 (decimal degrees)  |
| *County  | Madison                | Outfall Longitude   | -86.755294 (decimal degrees) |
| Permit Number  | AL0055158              | Permit Type   | Permit Reissuance            |
|  |                        | Permit Status   | Active                       |
|  |                        | Type of Discharger  | MUNICIPAL                    |
| Do other discharges exist that may impact the model? |                        | <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No |                              |

If yes, impacting dischargers names.

Impacting dischargers permit numbers.

Existing Discharge Design Flow 0.075 MGD

Proposed Discharge Design Flow MGD

Note: The flow rates given should be those requested for modeling.

Comments included

☒ Yes ☐ No

Information Verified By JJM

Year File Was Created 1987

Response ID Number 1920

Lat/Long Method GPS

12 Digit HUC Code 060300020702

Use Classification F&amp;W

Site Visit Completed? ☒ Yes ☐ NoWaterbody Impaired? ☐ Yes ☒ NoAntidegradation ☐ Yes ☒ No

Waterbody Tier Level Tier I

Use Support Category 3

Date of Site Visit 11/10/2022

Date of WLA Response 11/21/2022

Approved TMDL?

☐ Yes ☒ No

Approval Date of TMDL

## Waste Load Allocation Information

Modeled Reach Length 4.17

Miles

Date of Allocation 11/21/2022

Name of Model Used SWQM

Allocation Type 2 Seasons

Model Completed by James Mooney

Type of Model Used Desk-top

Allocation Developed by Water Quality Branch



# Waste Load Allocation Summary

Page 2

| Annual Effluent Limits | Conventional Parameters |         |        |         | Other Parameters |         |      |     |  |
|------------------------|-------------------------|---------|--------|---------|------------------|---------|------|-----|--|
|                        | Qw                      | 0.075   | MGD    |         | Qw               | 0.075   | MGD  |     |  |
| Season                 | Summer                  | Season  | Winter | Season  |                  | Season  |      |     |  |
| From                   | Apr                     | From    | Nov    | From    |                  | From    |      |     |  |
| Through                | Oct                     | Through | Mar    | Through |                  | Through |      |     |  |
| CBOD5                  |                         | CBOD5   | 9      | mg/L    | CBOD5            | 14      | mg/L | TP  |  |
| NH3-N                  |                         | NH3-N   | 1.2    | mg/L    | NH3-N            | 2.1     | mg/L | TN  |  |
| TKN                    |                         | TKN     |        |         | TKN              |         |      | TSS |  |
| D.O.                   |                         | D.O.    | 6      | mg/L    | D.O.             | 6       | mg/L |     |  |

| "Monitor Only" Parameters for Effluent: |  | Parameter | Frequency        | Parameter | Frequency |
|---|--|-----------|------------------|-----------|-----------|
|   |  | TP        | Monthly(Apr-Oct) |           |           |
|   |  | TKN       | Monthly(Apr-Oct) |           |           |
|   |  | NO2+NO3-N | Monthly(Apr-Oct) |           |           |

## Water Quality Characteristics Immediately Upstream of Discharge

| Parameter   | Summer |      | Winter |      |
|-------------|--------|------|--------|------|
| CBODu       | 2      | mg/l | 2      | mg/l |
| NH3-N       | 0.11   | mg/l | 0.11   | mg/l |
| Temperature | 28     | °C   | 18     | °C   |
| pH          | 7      | su   | 7      | su   |

## Hydrology at Discharge Location

| Drainage Area Qualifier | Drainage Area  | 1.15 | sq mi | Method Used to Calculate       |
|-------------------------|----------------|------|-------|--------------------------------|
| Exact                   | Stream 7Q10    | 0    | cfs   | <5.0 sq mi - Bingham Equation  |
|                         | Stream 1Q10    | 0    | cfs   | <5.0 sq mi - Bingham Equation  |
|                         | Stream 7Q2     | 0    | cfs   | <5.0 sq mi - Bingham Equation  |
|                         | Annual Average | 1.97 | cfs   | ADEM Estimate w/USGS Gage Data |

Comments and/or Notations: NH3N effluent limits are not toxicity based.

# NPDES Individual Permit - Modification/Reissuance - Municipal (Form 188)

version 1.9

(Submission #: HPK-9SCS-2V0NN, version 1)

Digitally signed by:  
GlobalSign RSA OV SSL CA 2018  
Date: 2022.08.04 16:05:23 -05:00  
Reason: Submission Data  
Location: State of Alabama

## Details

---

Submission ID HPK-9SCS-2V0NN

## Form Input

---

### General Instructions

NPDES Individual Permit Modification and Reissuance Form ♦ Publicly-Owned Treatment Works (POTW), Other Treatment Works Treating Domestic Sewage (TWTDS), and Public Water Supply Treatment Plants

IF YOU ARE APPLYING FOR A PERMIT MODIFICATION, PLEASE CONTACT YOUR ASSIGNED PERMIT CONTACT TO DISCUSS THE TYPE OF MODIFICATION YOU SHOULD APPLY FOR BEFORE COMPLETING THIS FORM.

This form should be used to submit the following permit requests for permitted Publicly-Owned Treatment Works (POTW), Other Treatment Works Treating Domestic Sewage (TWTDS), and Public Water Supply Treatment Plants:

- (1) Permit Transfers
- (2) Permittee/Facility Name Changes
- (3) Minor Modifications  
This modification may not be used for changes that would result in changes to permit conditions
- (4) Major Modifications (No Effluent Limit Change)
- (5) Major Modifications (Effluent Limit Change)
- (6) Reissuances  
Reissuance of a permit due to approaching expiration  
Revocation and Reissuance of permit prior to its scheduled expiration

Please complete all questions and attach all necessary documentation as prompted throughout the application process. Incomplete or incorrect information will delay processing.

Applicable Fees:

Permit Transfers and/or Permittee/Facility Name Changes  
\$800  
Minor Modifications  
\$800  
Major Modifications (No Effluent Limit Change)  
\$3,140 (Major Sources)  
\$2,250 (Minor Sources or Public Water Supply Treatment Plants)  
Major Modifications (Effluent Limit Change)  
\$7,060 (Major Sources)  
\$4,290 (Minor Sources or Public Water Supply Treatment Plants)  
Reissuances  
\$7,060 (Major Sources)  
\$4,290 (Minor Sources or Public Water Supply Treatment Plants)  
For assistance, please click here to determine the permit engineer responsible for the site or call (334) 271-7810.

RECEIVED  
AUG 04 2022  
MUNICIPAL SECTION

### Processing Information

#### Purpose of Application

Reissuance of Permit Due to Approaching Expiration

Please indicate if the Permittee is applying for a permit transfer and/or name change in addition to permit modification or reissuance:

None

**Action Type**

Reissuance

Briefly describe any planned changes at the facility that are included in this reissuance application:

No changes planned at this time

Do you have additional contacts associated with this site?

Yes

**Permit Information**

**Permit Number**

AL0055158

**Current Permittee Name**

Harvest-Monrovia Water, Sewer, and Fire Authority

**Permittee**

**Permittee Name**

Harvest-Monrovia Water, Sewer, and Fire Protection Authority

**Mailing Address**

PO BOX 329

HARVEST, AL 35749

Is the Operator the same as the Permittee?

Yes

Has the Operator's scope of responsibility changed?

No

**Responsible Official**

**Prefix**

Mr.

**First Name**

Mike

**Last Name**

Oliver

**Title**

General Manager

**Organization Name**

Harvest-Monrovia Water, Sewer, and Fire Protection Authority

**Phone Type**

Business

**Number**

256-837-1132

**Extension**

**Email**

mikeo@hmwater.org

**Mailing Address**

PO BOX 329

HARVEST, AL 35749

**Existing Permit Contacts**

| Affiliation Type  | Contact Information   | Remove? |
|-------------------|---|---------|
| DMR Contact       | Brent Kulivich, Harvest-Monrovia Water, Sewer, and Fire Authority | Keep    |
| Permittee         | Harvest-Monrovia Water, Sewer, and Fire Authority                 | Keep    |
| Emergency Contact | Michael Oliver, HM Water  | Keep    |



| Affiliation Type                            | Contact Information  | Remove? |
|---|--|---------|
| Notification Recipient,Responsible Official | Mike Oliver, Harvest-Monrovia Water, Sewer, and Fire Authority | Keep    |

## Facility/Site Information

### Facility/Site Name

Hunter's Crossing WWTP

### Organization/Ownership Type

Water/Sewer/Utility District or Board

The Facility/Site Address is the physical location of the treatment plant. Do not enter a PO Box. Do not enter the address of the office of the Permittee if different from the treatment plant.

### Facility/Site Physical Location Address

195 Marlboro Way  
Madison, AL 35757

### Facility/Site County

Madison

### Facility/Site Contact

#### Prefix

Mr.

#### First Name

Brent

#### Last Name

Kulivich

#### Title

Chief Waste Water Operator

#### Organization Name

Harvest-Monrovia Water, Sewer, and Fire Protection Authority

#### Phone Type

Business

#### Number

2566567385

#### Extension

#### Email

bkulivich@hmwater.org

### Note

Detailed directions should be included if a street address is not available.

### Detailed Directions to the Facility/Site

NONE PROVIDED

Please refer to the link below for Lat/Long map instruction help.

[Map Instruction Help](#)

### Facility/Site Front Gate Latitude and Longitude

34.77810000000001,-86.75270000000000

### Primary SIC Code

4952-Sewerage Systems

### Primary NAICS Code

221320-Sewage Treatment Facilities

**Emergency Contact****Prefix***Mr.***First Name      Last Name***Mike                  Oliver***Title***General Manager***Phone Type      Number                  Extension***Business                  256-837-1132***Email***mikeo@hmwater.org*

**Does the facility have a designated Environmental Contact who is different than the Facility Contact or Emergency Contact listed above?**

*Yes***Environmental Contact****Prefix***Mr.***First Name      Last Name***Brent                  Kulivich***Title***Chief Waste Water Operator***Phone Type      Number                  Extension***Business                  256-656-7385***Email***bkulivich@hmwater.org***Additional Contacts (1 of 1)****Additional Contacts: DMR Contact****Contact Type***DMR Contact***Contact****Prefix***Mr.***First Name                  Last Name***Brent                  Kulivich***Title***Chief Waste Water Operator***Organization Name***Harvest-Monrovia Water, Sewer, and Fire Protection Authority***Phone Type                  Number                  Extension***Business                  2566567385***Email***bkulivich@hmwater.org***Address***PO BOX 329**HARVEST, AL 35749*

## Enforcement History

Has the applicant been issued any Notices of Violation, Orders (Consent or Administrative/Unilateral), or Judicial Actions (Complaint, Settlement Agreement, Consent Decree, or Court Order) concerning water pollution or other permit violations within the State of Alabama in the past five years?

No

## Wastewater Treatment & Discharge Information

Please indicate which type of operations occur at this facility:

Treatment Works Treating Domestic Sewage

What treatment type is used at this facility:

Mechanical (WWTP)

What discharge options are used at this facility:

Surface Water

What is the Total Design Flow (in millions of gallons per day, MGD) for this facility?

0.075

What is the facility's total 2-Year Actual Average Flow (in millions of gallons per day, MGD)?

0.069004

### Process Flow Schematic

[Hunters Crossing Flow Diagram.pdf - 07/21/2022 02:21 PM](#)

[Hunters Crossing Topographic Map.pdf - 07/21/2022 02:25 PM](#)

#### Comment

NONE PROVIDED

Do you share an outfall with another facility?

No

Indicate if automatic sampling equipment or continuous wastewater flow metering equipment is being operated at this facility:

| Current                                       | Yes/No |
|---|--------|
| Continuous Wastewater Flow Metering Equipment | Yes    |
| Automatic Sampling Equipment                  | Yes    |

Indicate if installation of automatic sampling equipment or continuous wastewater flow metering equipment is planned at this facility:

| Planned                                       | Yes/No |
|---|--------|
| Continuous Wastewater Flow Metering Equipment | N/A    |
| Automatic Sampling Equipment                  | N/A    |

### Schematic Diagram

[Hunters Crossing Collection System.pdf - 07/21/2022 11:12 AM](#)

#### Comment

NONE PROVIDED

Are any wastewater collection or treatment modifications or expansions planned during the next three years that could alter wastewater volumes or characteristics (Note: Permit Modification may be required)?

No

## Treatment Methods (TWTDS)

### Treatment Level

Secondary Treatment [e.g., suspended growth biological treatment; attached growth and combined biological treatment].

## Wastewater Disinfection Technology Information

Ultraviolet Light Disinfection

**Please select all POTW Treatment Categories that apply.**

Activated Sludge Process & Modifications  
Attached Growth Biological Treatment  
Disinfection  
Aeration  
Clarification  
Equalization  
Nitrogen Control (Biological)

**Please select all unit operations that apply for Activated Sludge Process & Modifications:**

Activated Sludge, Complete Mix  
Activated Sludge, Extended Aeration  
Growth Process, Other Suspended

**Please select all unit operations that apply for Aeration:**

Aeration (post-treatment)  
Aeration (general)  
Aeration (pre-treatment)  
Aerobic Unit

**Please select all unit operations that apply for Attached Growth Biological Treatment:**

Growth Process, Other Attached

**Please select all unit operations that apply for Clarification:**

Clarification, Secondary

**Please select all unit operations that apply for Disinfection:**

Disinfection, Ultraviolet

**Please select all unit operations that apply for Equalization:**

Equalization, At POTW

**Please select all unit operations that apply for Nitrogen Control (Biological):**

Nitrification, Biological (Combined and BOD Reduction)

## Waste Storage & Disposal Information

**Any storage of solids or liquids at the facility that have any potential for accidental discharge to a water of the state?**

Yes

**Describe the location of all sites used for the storage of solids or liquids that have any potential for accidental discharge to a water of the state, either directly or indirectly via storm sewer, municipal sewer, municipal wastewater treatment plants, or other collection or distribution systems that are located at or operated by the subject existing or proposed NPDES- permitted facility. Indicate the location of any potential release areas and provide a map or detailed narrative description of the areas of concern as an attachment to this app**

| Description of Waste | Description of Storage Location | Disposal Location |
|----------------------|---------------------------------|-------------------|
| 1% waste sludge      | 14000 gallon steel basin        | On-site           |

## Collection System Information

### Collection Systems

| Collection System ID | Collection System Name | Owner Type of Collection System | Population of Collection System |
|----------------------|------------------------|---------------------------------|---------------------------------|
| NA                   | NA                     | NONE PROVIDED                   | NONE PROVIDED                   |

## Industrial Indirect Discharge Contributors

Does this wastewater treatment system receive or plan to receive industrial source wastewater contributions?  
No

## **Coastal Zone Information**

Is the discharge(s) located within the 10-foot elevation contour and within the limits of Mobile or Baldwin County?  
No

## **Anti-Degradation Evaluation**

Does this modification/reissuance include a new or increased discharge that began after April 3, 1991?  
No

Has an Anti-Degradation Analysis been previously conducted and submitted to the Department for the new or increased discharge referenced above?  
No

## **EPA Application Forms**

All Applicants must submit certain EPA permit application forms. More than one application form may be required from a POTW or other TWTDS depending on the number and types of discharges or outfalls.

The EPA application forms must be submitted as follows:

1. Applicants for new or existing discharges of sanitary wastewater from Publicly-Owned Treatment Works (POTW) and Other Treatment Works Treating Domestic Sewage (TWTDS) must submit Form 2A. If the facility design capacity is equal to or greater than 1 MGD, Form 2F is also required.
2. Applicants for new or existing land application of sanitary wastewater must submit Form 2A and Form 2F.
3. Applicants for new and existing discharges of process wastewater from water treatment facilities (i.e. public water supply treatment plants) must submit Form 1 and Form 2C.
4. Applicants that generate sewage sludge, derive a material from sewage sludge, or dispose of sewage sludge must submit Part 2 of Form 2S.

The EPA application forms are found on the Department's website [here](#).

### **EPA Form 2A**

Hunters Crossing\_EPA FORM 2A.pdf - 08/04/2022 03:33 PM

#### **Comment**

NONE PROVIDED

### **EPA form 2S**

Hunters Crossing\_EPA Form 2S.pdf - 08/04/2022 03:34 PM

#### **Comment**

NONE PROVIDED

### **Other attachments (as needed)**

Sludge Line Diagram.pdf - 08/02/2022 12:45 PM

Hunters Crossing Topographic Map.pdf - 08/04/2022 03:35 PM

Hunters Crossing Flow Diagram.pdf - 08/04/2022 03:35 PM

HUNTERS SOLIDS HAULING FORM.pdf - 08/04/2022 03:37 PM

#### **Comment**

NONE PROVIDED

## **Engineering Report/BMP Plan Requirements**

### **Engineering Report/BMP Plan Requirements**

NONE PROVIDED

#### **Comment**

NONE PROVIDED

## **Outfalls (1 of 1)**

**Outfall: 001**

**Do you want to remove this outfall from the modified/reissued permit?**

No

**Outfall Identifier**

001

**Is this Outfall equipped with a diffuser?**

No

**What is this Outfall's 2-Year Average Flow (in millions of gallons per day, MGD)?**

0.069004

**Receiving Water**

Knox Creek

**Does the discharge enter the named receiving water via an unnamed tributary?**

NONE PROVIDED

**Please refer to the link below for Lat/Long map instruction help.**

[Map Instruction Help](#)

**Location of Outfall or Discharge Point/Receiving Water**

34.77262000000000, -86.75532000000000

[A list of the 303\(d\) impaired waters can be found here.](#)

**303(d) Segment?**

No

[A list of waters subject to a TMDL can be found here.](#)

**TMDL Segment?**

No

## **Fee**

**Fee**

4290

**Note: Additional Fees may be assessed after the review of the application is complete. These fees may include any of the following:**

Modeling with Data Collection (10 Stations) - \$60,390

Modeling with Data Collection (5 Stations) - \$49,315

Modeling - desktop - \$4,855

Review of Model Performed by Others - \$2,705

Seasonal Limits - \$4,855/additional season

Biomonitoring & Toxicity Limits - \$1,015

Please contact your area engineer if you have any questions about which additional fees may be assessed for this application.

## **Application Preparer**

**Application Preparer**

**Prefix**

*NONE PROVIDED*

**First Name**

Brent

**Last Name**

*Kulivich*

**Title**

*Chief Waste Water Operator*

**Organization Name**

*Harvest-Monrovia Water, Sewer, and Fire Authority*

**Phone Type**

Business

**Number**

2566567385

**Extension**

**Email**

bkulivich@hmwater.org

**Address**

PO BOX 329

HARVEST, AL 35749

## Agreements and Signature(s)

---

### **SUBMISSION AGREEMENTS**

- ☒ I am the owner of the account used to perform the electronic submission and signature.
- ☒ I have the authority to submit the data on behalf of the facility I am representing.
- ☒ I agree that providing the account credentials to sign the submission document constitutes an electronic signature equivalent to my written signature.
- ☒ I have reviewed the electronic form being submitted in its entirety, and agree to the validity and accuracy of the information contained within it to the best of my knowledge.

*The information contained in this form must be certified by a responsible official as defined in ADEM Administrative Code r. 335-6-6-.09 "signatories to permit applications and reports" (see below).*

*I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information including the possibility of fine and imprisonment for knowing violations.*

### **335-6-6-.09 SIGNATORIES TO PERMIT APPLICATIONS AND REPORTS.**

*(1) The application for an NPDES permit shall be signed by a responsible official, as indicated below*

- (a) In the case of a corporation, by a principal executive officer of at least the level of vice president, or a manager assigned or delegated in accordance with corporate procedures, with such delegation submitted in writing if required by the Department, who is responsible for manufacturing, production, or operating facilities and is authorized to make management decisions which govern the operation of the regulated facility;*
- (b) In the case of a partnership, by a general partner;*
- (c) In the case of a sole proprietorship, by the proprietor; or*
- (d) In the case of a municipal, state, federal, or other public entity, by either a principal executive officer, or ranking elected official.*

**Signed**  
**By** Michael Oliver on 08/04/2022 at 3:53 PM




NPDES Permit Application Map

Hunter's Crossing WWTP

Owner: Harvest-Monrovia Water, Sewer  
and Fire Protection Authority

Capshaw Quadrangle  
Madison County, AL  
Section 17,  
Township 3, South, Range 2 West

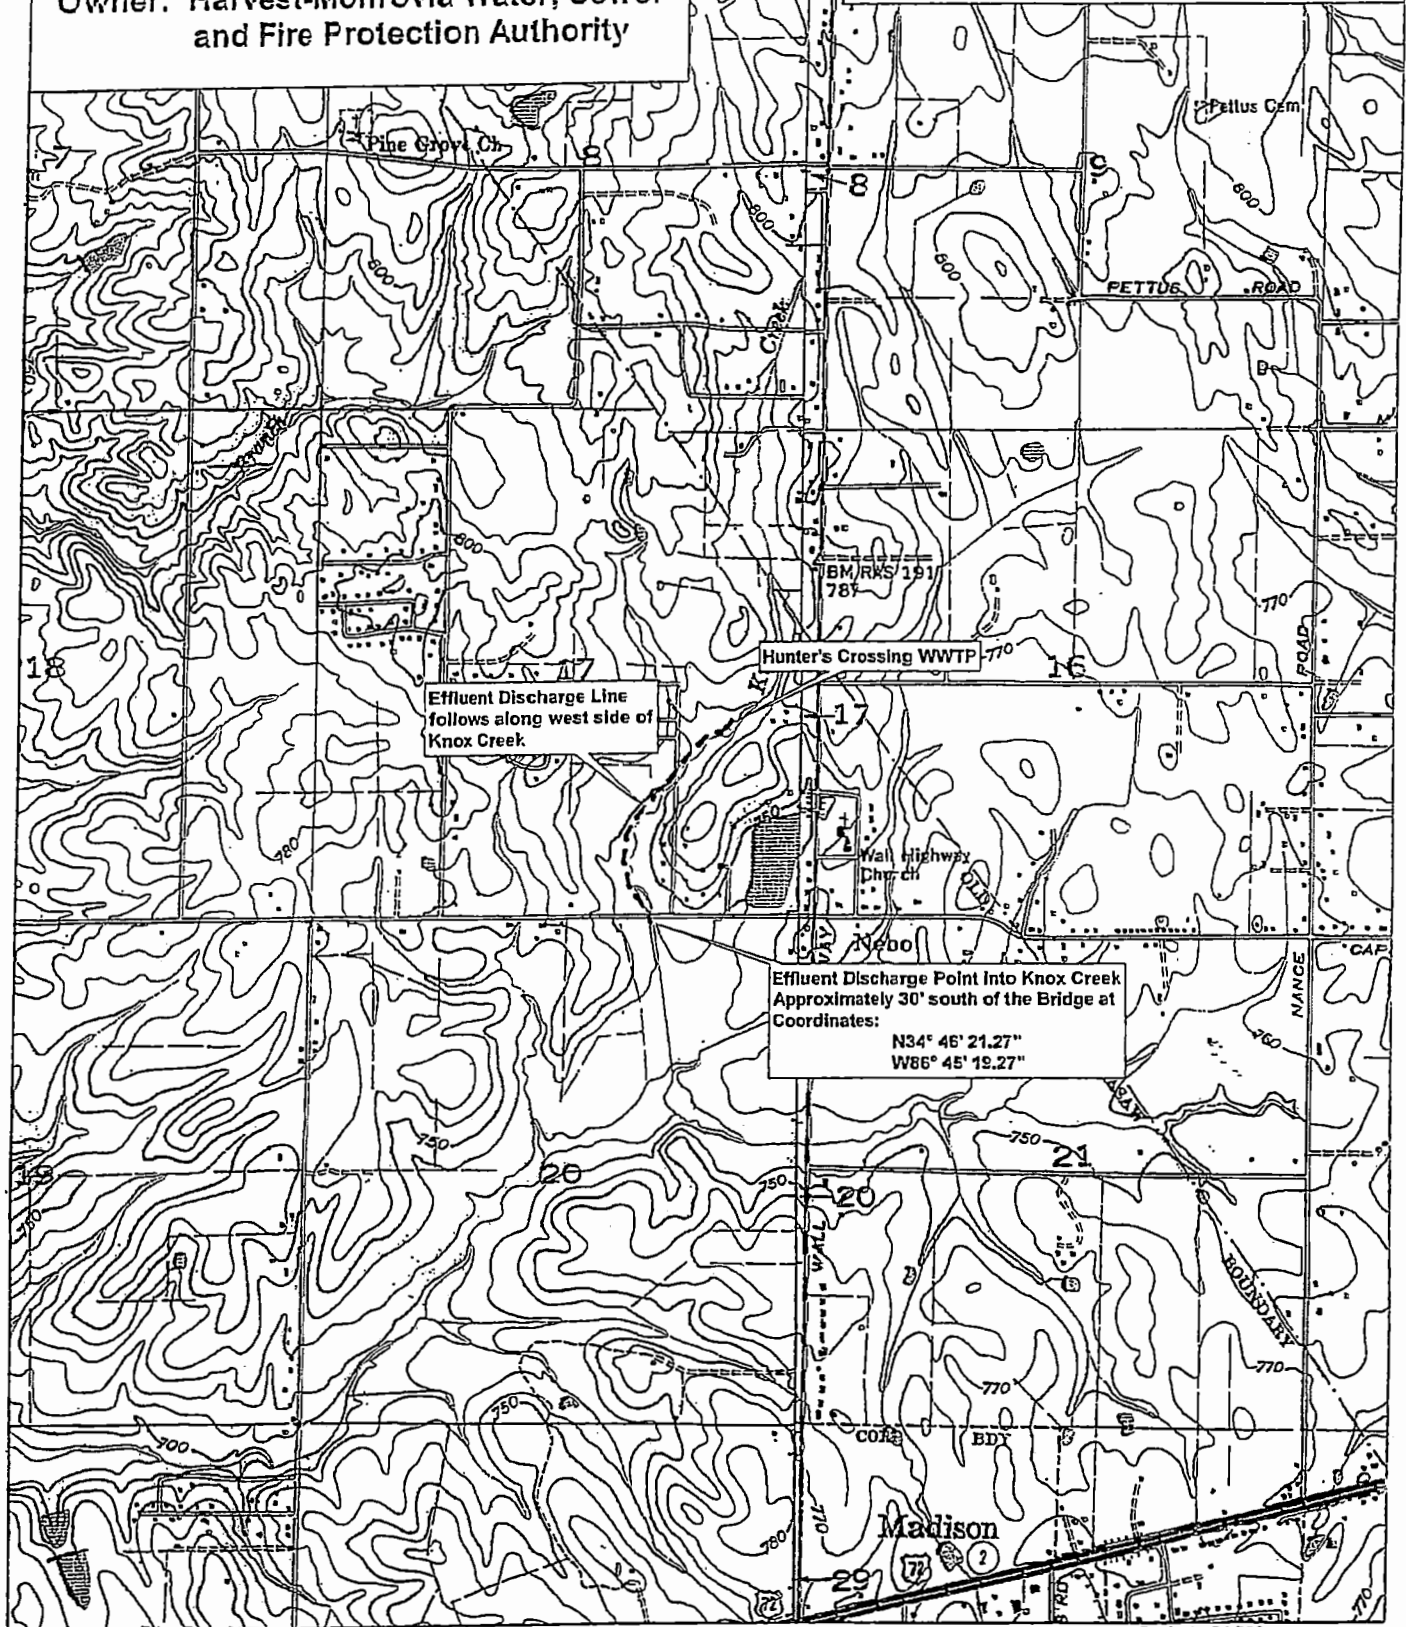

Effluent Discharge Line  
follows along west side of  
Knox Creek.

Hunter's Crossing WWTP

Effluent Discharge Point Into Knox Creek  
Approximately 30' south of the Bridge at  
Coordinates:  
N34° 45' 21.27"  
W86° 45' 19.27"


Data use subject to license.  
© 2004 DeLorme. XMap® 4.5.  
www.delorme.com

TN  
NN (2.5" W)

RECEIVED

AUG 04 2022

MUNICIPAL SECTION






# Hunter's Crossing WWP

RECEIVED

AUG 04 2022

MUNICIPAL SEC

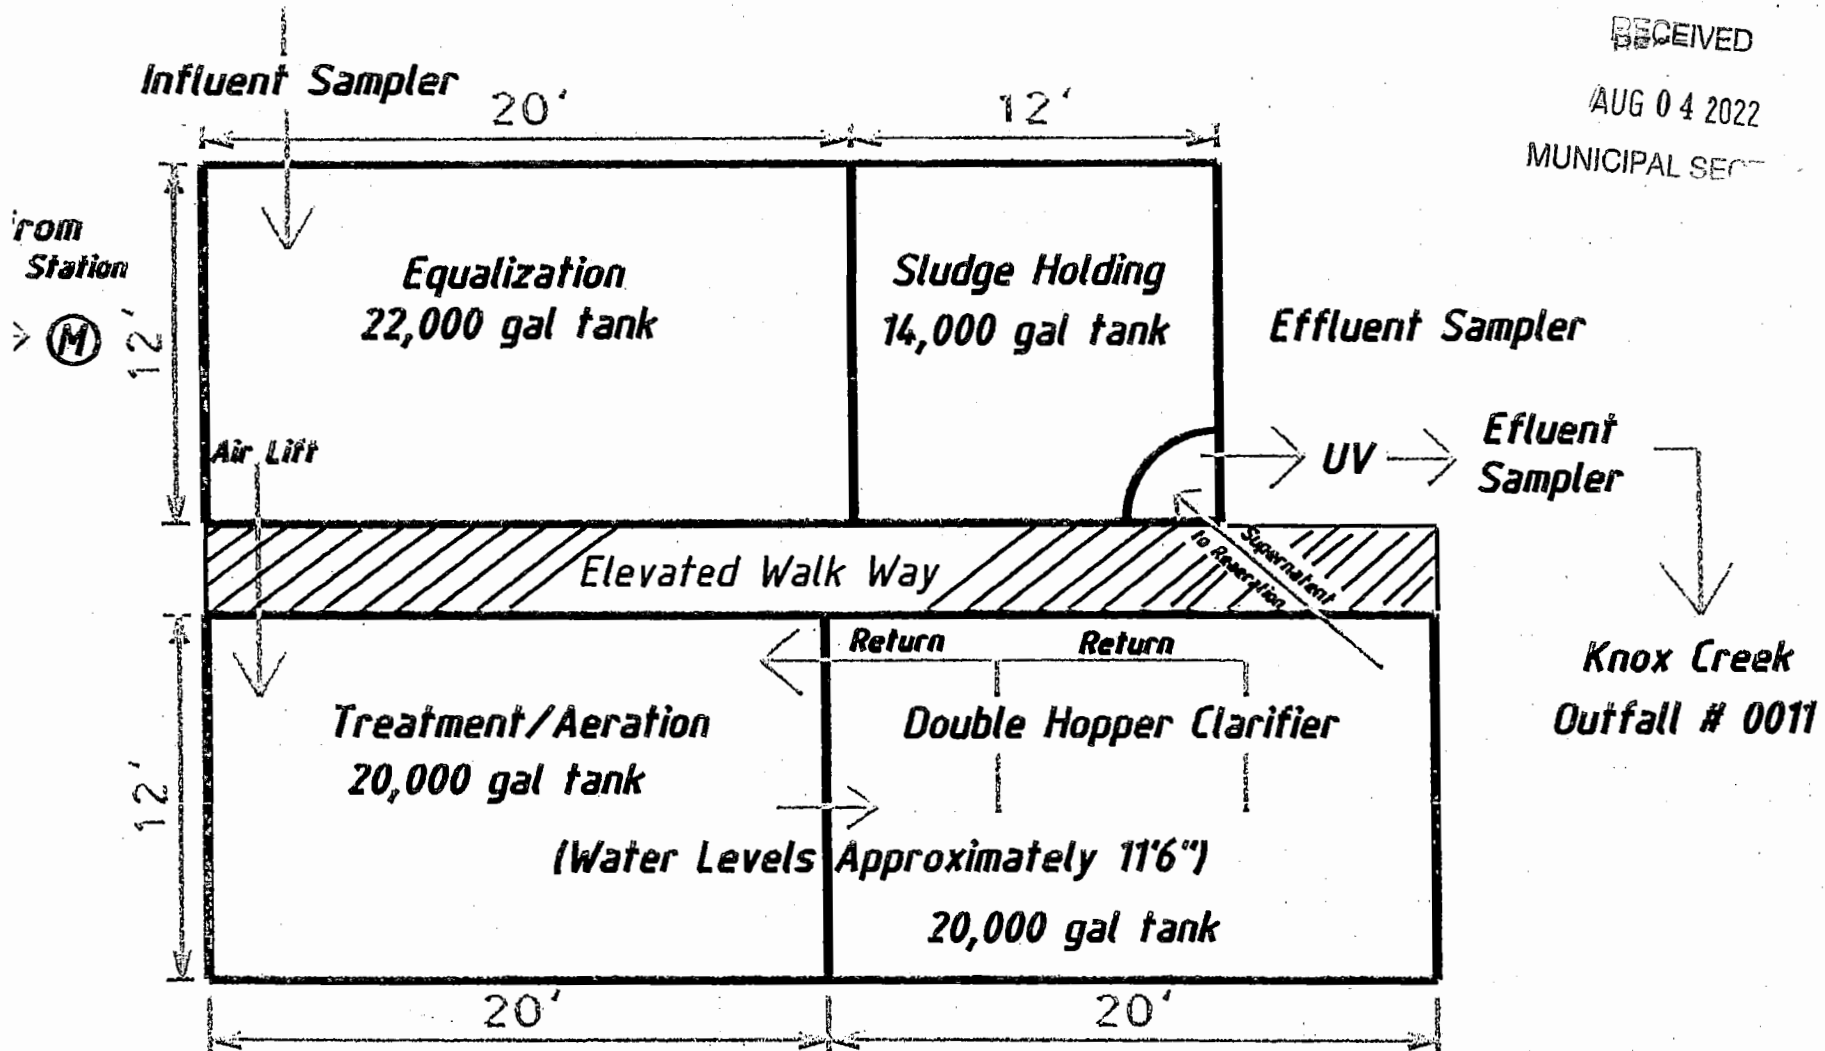

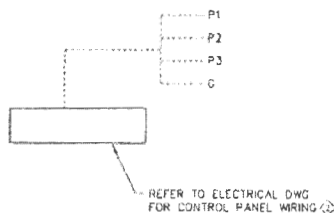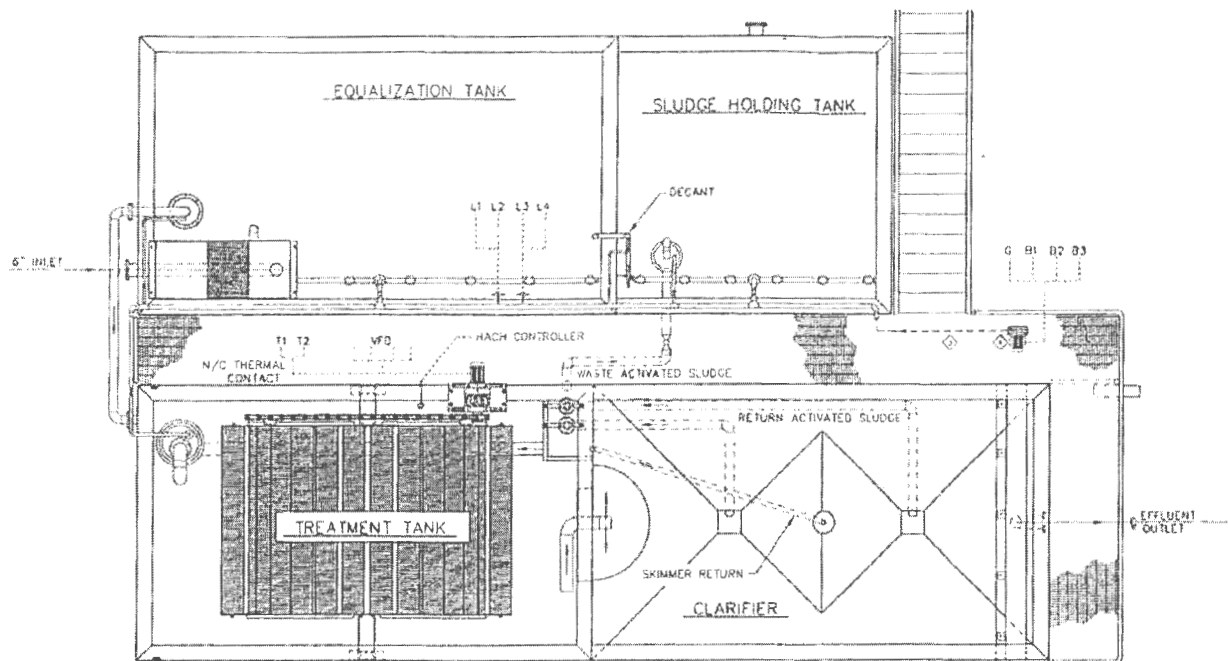

- NOTE:
1. FIELD WIRING IS NOT BY WESTECH
  2. WORK THIS DWG WITH ELECTRICAL PANEL DWGS
  3. PIPING FROM BLOWER TO 2 1/2" AIR PIPING IS NOT BY WESTECH
  4. CUSTOMER TO LOCATE BLOWER TO SUIT.

RECEIVED  
DEC 02 2022  
MUNICIPAL SECTION

PLANT DESIGN SUMMARY

DESIGN FLOW: 75,000 GAL PER DAY

EQUALIZATION TANK  
VOLUME: 21,700 GAL  
HRT (PEAK): 7 HR.

STM-AERATOR BASIN  
VOLUME: 20,150 GAL  
O<sub>2</sub> AT DESIGN SPEED: 271 LBS/DAY  
O<sub>2</sub> AT MAX SPEED: 406 LBS/DAY  
SRT: 10 DAYS

CLARIFIER  
SOR: 312 GAL/DAY/SQ FT  
SLR: 4.5 LBS/DAY/SQ FT  
WEIR LOADING RATE: 3100 GAL/DAY/LINEAR FT

RAS: 100%-150%

|   |  |                      |           |
|---|--|----------------------|-----------|
| PREPARED FOR:   | HUNTERS CROSSING WWTP<br>MADISON, ALABAMA            |                      |           |
| ENGINEER:   | HARVEST-MONROVIA WATER AUTHORITY<br>HARVEST, ALABAMA |                      |           |
| <u>STM-AERATOR PACKAGE PLANT - PROCESS FLOW &amp; FIELD WIRING</u>  |  |                      |           |
| DESCRIPTION   |  | 3.2M DIA x 2.5M + 6A |           |
| DATE  | 1/07   | MS                   | 11.7 - 11 |
| BY  | 1/07   | MS                   | 11.7 - 11 |
| This drawing is property of WESTECH ENGINEERING, INC. and is loaned to customer for use only. It is not to be reproduced, stored, or used in any way without the written permission of WESTECH ENGINEERING, INC. All other drawings are the property of WESTECH ENGINEERING, INC. |  |                      |           |
| DRAWING NUMBER  |  | PROJECT NUMBER       |           |
| D104  |  | 20106A               |           |
| WESTECH   |  |                      |           |

15396

**RESOLUTION BY THE BOARD OF DIRECTORS OF  
HARVEST-MONROVIA WATER AND FIRE PROTECTION AUTHORITY, INC.**

The following resolution was duly adopted by the Board of Directors of the Harvest-Monrovia Water and Fire Protection Authority, Inc. at a regular monthly meeting held in the offices of the Authority at 9131 Wall Triana Highway, Harvest, Alabama 35749; on the 12<sup>th</sup> day of November, 2002. There was present in person at the meeting, Scott Schrimsher, James E. Raby, Gerald D. Dupree, constituting all the directors of the Authority. Scott Schrimsher presiding over the meeting as Chairman and James E. Raby acted as Secretary thereof. The Chairman announced that a quorum was present and the meeting was open for transaction of business.

The following resolution was presented and duly adopted:

1. Be it resolved that the Articles of Incorporation of the Authority be restated since they have been amended on various occasions. In the amended and restated certificate, provisions be made for the Authority to engage in the operation of a public sewer system.

2. The said amendment will promote the public health, convenience, and welfare of the subscribers in the service area.

3. There is no public sewer system at all in the service area of the Authority.

4. The Madison County Commission adopt a resolution declaring that it has reviewed the contents of the Authority's application and has found and determined as a matter of fact that the statements contained in the application are true.

5. The amendment to the certificate of authority read as follows:

**AMENDED DECLARATION OF INCORPORATION**

The undersigned, Scott Schrimsher, James E. Raby, and Gerald D. Dupree, as all of the directors of the Harvest-Monrovia Water & Fire Protection Authority, do hereby adopt and file this amended declaration of incorporation, the same to constitute and become its charter for carrying on the business and purposes herein specified pursuant to Act number 107 of the first special session of the 1965 Legislature of the State of Alabama, as amended.

Article I. The names of the current directors of the Authority, together with their residence, are as follows:

Scott Schrimsher  
501 Jeff Road  
Huntsville, AL 35806

RECEIVED  
DEC 02 2002  
MUNICIPAL SECTION

COPIES - 3  
NOV 10 10:55  
TAX  
SECRETARY

James E. Raby  
639 Harvest Road  
Harvest, AL 35749

Gerald D. Dupree  
335 Dupree Drive  
Huntsville, AL 35806

Each one of the directors is a resident of Madison County, Alabama, and is the owner of real property in the service area of the Harvest-Monrovia Water & Fire Protection Authority and is a duly qualified elector of Madison County, Alabama.

Article II. The name of the corporation is hereby changed from the Harvest-Monrovia Water & Fire Protection Authority, Inc. to Harvest-Monrovia Water, Sewer & Fire Protection Authority, Inc.

Article III. The period of duration of the Authority or corporation shall be perpetual pursuant to the provisions of Section 18 of Act No. 107 of First Special Session of the 1965 Legislature of the State of Alabama.

Article IV. The name of the determining county as provided in said Act is Madison County. The original articles of incorporation were filed on the 2<sup>nd</sup> day of August, 1965, in Corporate Book 18, at Page 634, in the Office of the Judge of Probate of Madison County, Alabama, pursuant to a resolution duly adopted by the governing body of Madison County, Alabama.

Article V. The location of principal office of the Authority shall be at 9131 Wall Triana Highway, Harvest, Alabama 35749, or such other place in Madison County, Alabama, as may from time to time be determined by the Board of Directors of the Authority.

Article VI. A concise legal description of the area in which the Authority is rendering water and fire protection authority and will operate a sewer system that will and does promote the public health and the convenience and welfare of the community as follows:

(a) the South one-half of Sections 7, 8, 9 and 10; the Southwest one-quarter of Section 11; the West one-half of Section 14, Sections 15, 16, 17, 18, 19, 20, 21 and 22; the West one-half of Sections 23 and 26; Sections 27, 28, 29, 30, 31, 32, 33 and 34; the West one-half of Section 35, all in Township 2 South, Range 2 West; (b) the West one-half of the Southeast one-quarter of Section 7; the Southwest one-quarter of Section 7; the West one-half of the Northeast one-quarter of Section 18; the West one-half of the Southeast one-quarter

of Section 18; the Northwest one-quarter of Section 18; the southwest one-quarter of Section 18; the West one-half of the Northeast one-quarter of Section 19; the Northwest one-quarter of Section 19; and the Southwest one-quarter of Section 19, all in Township 3 South, Range 1 West; and (c) the West one-half of Section 2; Sections 3, 4, 5, 6, 7, 8, 9 and 10; the West one-half and the Southeast one-quarter of Section 11; the South one-half of Section 12; and Sections 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23 and 24, all in Township 3 South, Range 2 West, AND a tract of land described as being all that part of Section 25, Township 3 South, Range 2 West, Madison County, Alabama, that lies West of the centerline of Johns Road and North of the centerline of Old Monrovia Road, all within Madison County, Alabama.

Article VII. (a) The purposes for which this corporation, Authority, is formed are: To own by purchase or otherwise lease, rent, or in any other manner, lawfully acquire and to sell, rent, lease or assign to any other person, firm, corporation, county, or municipality, pipe lines and mains, for the transportation, delivery, distribution and sale of water and the operation of a sewer system; and to construct, build, maintain and operate a water system and sewer system for the supplying of water and sewer for domestic, commercial, agricultural, industrial, and other purposes, to persons, firms, or corporations, located in the area described in the above Article VI hereof, and to engage in any activity relating to the ownership, purchase, or other acquisition of pipe lines and mains and the water system and sewer system including, but not limiting to, the acquisition of water by appropriation, drilling, pumping or purchase, and the ownership or other acquisition or disposition of such property, real, personal, or mixed, including wells, pumps, pumping equipment, water mains, pipe lines, valves, meters, and other equipment necessary to the construction, maintenance, and operation of a water and fire protection system and sewer system that are necessary to the conduct of any of the business of this corporation, and necessary to the law of the State of Alabama.

(b) To borrow money from any source, and from time to time, may accept, endorse, execute and issue bonds, debentures, promissory notes, bills of exchange, or other obligations of the Authority or corporation for monies borrowed or in payment for property acquired, or for any of the other objects or purposes of the Authority or corporation, or its business, and to secure the payment of any such obligations by mortgage, pledge, deed, indenture, agreement, or other instrument of trust, or other lien upon, assignment of, or agreements in regard to all or any part of the property rights or pledges of the Authority or corporation wherever situated, whether now owned or hereafter to be acquired.

Article VIII. This Authority or public corporation shall be governed

by a Board of Directors as provided for in Section 6 of Act No. 107, of the First Special Session of the 1965 of the Legislature of the State of Alabama and each such Director may be compensated for his services and reimbursed for expenses actually incurred by such person in and about the performance of their duties as provided for in said Section 6.

Article IX. Pursuant to the provisions of Section 4 and Section 5 of said Act No. 107, there is attached hereto a certified copy of the Resolution adopted by the governing body of Madison County, Alabama, as provided for in Section 3 of said Act.

IN WITNESS WHEREOF, the above mentioned individuals as Directors of the Authority have hereunto set their hands and seals on this the \_\_\_\_ day \_\_\_\_\_, 2002.

\_\_\_\_\_  
**SCOTT SCHRIMSHER**

\_\_\_\_\_  
**JAMES E. RABY**

\_\_\_\_\_  
**GERALD D. DUPREE**

STATE OF ALABAMA     )

COUNTY OF MADISON    )

I, the undersigned, a Notary Public in and for said County in said State, hereby certify that **SCOTT SCHRIMSHER**, whose name as a **Director of Harvest-Monrovia Water & Fire Protection Authority, Inc.**, is signed to the foregoing Amendment to the Certificate of Incorporation of Harvest-Monrovia Water & Fire Protection Authority, Inc., and who is known to me, acknowledged before me on this day that, being informed of the contents of the conveyance, he, as such Director and with full authority, executed the same voluntarily for and as the act of said corporation.

**GIVEN** under my hand and official seal this the \_\_\_\_ day of \_\_\_\_\_, 2002.

\_\_\_\_\_  
NOTARY PUBLIC

My commission expires: \_\_\_\_\_

STATE OF ALABAMA     )

COUNTY OF MADISON    )

I, the undersigned, a Notary Public in and for said County in said State, hereby certify that **JAMES E. RABY**, whose name as a **Director of Harvest-Monrovia Water & Fire Protection Authority, Inc.**, is signed to the foregoing Amendment to the Certificate of Incorporation of Harvest-Monrovia Water & Fire Protection Authority, Inc., and who is known to me, acknowledged before me on this day that, being informed of the contents of the conveyance, he, as such Director and with full authority, executed the same voluntarily for and as the act of said corporation.

GIVEN under my hand and official seal this the \_\_\_\_\_ day of \_\_\_\_\_, 2002.

\_\_\_\_\_  
NOTARY PUBLIC

My commission expires: \_\_\_\_\_

STATE OF ALABAMA     )

COUNTY OF MADISON    )

I, the undersigned, a Notary Public in and for said County in said State, hereby certify that **GERALD D. DUPREE**, whose name as a **Director of Harvest-Monrovia Water & Fire Protection Authority, Inc.**, is signed to the foregoing Amendment to the Certificate of Incorporation of Harvest-Monrovia Water & Fire Protection Authority, Inc., and who is known to me, acknowledged before me on this day that, being informed of the contents of the conveyance, he, as such Director and with full authority, executed the same voluntarily for and as the act of said corporation.

GIVEN under my hand and official seal this the \_\_\_\_\_ day of \_\_\_\_\_, 2002.

\_\_\_\_\_  
NOTARY PUBLIC

My commission expires: \_\_\_\_\_



6. The Board recommends to the Madison County Commission that the proposed additional authority to engage in the sewer treatment within the service area will promote the public health, convenience, and welfare of the citizens of the service area.

7. The Harvest-Monrovia Water & Fire Protection Authority, Inc., through its Board, requests that the Madison County Commission adopt a resolution declaring that it has reviewed the contents of the application, found and determined as a matter of fact that the statement contained in the application is true and that attached to the application is a certified copy of the resolution adopted by the Authority requesting the Amendment to the Articles of Incorporation including the authority to engage in the sewer treatment business.

8. The Harvest-Monrovia Water & Fire Protection Authority further requests that the Commission will find and make the determination that such amendment extending to the Authority the authorization and power to engage in the sewer treatment business will promote the public health, convenience, and welfare of the citizens of Madison County, Alabama.

9. Within Forty (40) days following adoption by the Madison County Commission with which the application has been filed, a resolution shall be presented declaring the statements in the application to be true and the Chairmen of the Board will then, together with the Secretary sign and file of record in the Office of the Judge of Probate of Madison County, Alabama, a certificate in the name and in behalf of the Authority, under the seal of the Authority, reciting the adoption of the respective resolution by the Board of Directors of the Harvest-Monrovia Water & Fire Protection Authority, Inc. and by the Madison County, Alabama, Commission setting forth the proposed amendment and file the same with the Judge of Probate of Madison County, Alabama, that the Judge of Probate will enter and sign an order setting forth its findings requiring each certificate be recorded together with his order pursuant to §11-88-5 of the 1975 Code of Alabama, as amended.

10. It was resolved that the application be made for permission to amend the Charter or Articles of Incorporation pursuant to the provisions of §11-88-5 of the 1975 Code of Alabama, as amended.

Dated this the 12<sup>th</sup> day of November, 2002.

  
\_\_\_\_\_  
SCOTT SCHRIMSHER, Director  
\_\_\_\_\_  
JAMES E. RABY, Director  
\_\_\_\_\_  
GERALD D. DUPREE, Director

STATE OF ALABAMA     )

COUNTY OF MADISON    )

**APPLICATION FOR PERMISSION TO AMEND CHARTER OF  
HARVEST-MONROVIA WATER AND FIRE PROTECTION AUTHORITY, INC.**

TO THE BOARD OF COUNTY COMMISSIONERS OF MADISON COUNTY, ALABAMA:

1.

Comes now Scott Schrimsher, James E. Raby and Gerald D. Dupree, being all the members of Harvest-Monrovia Water & Fire Protection Authority, Inc., respectfully files this their written application with the governing body of Madison County, Alabama, pursuant to Act 107 of the First Special Session of the 1965 Legislature of the State of Alabama, as amended to amend the charter of the Authority, which charter has been previously approved by resolution of the Board of County Commissioners of Madison County, Alabama, and resulted in the corporation being authorized by the Board of County Commissioners and approved by the Probate Judge of Madison County, Alabama; said Certificate of Incorporation being recorded in Volume 18, Page 632, Probate Records of Madison County, Alabama.

2.

The Board of Directors of Harvest-Monrovia Water and Fire Protection Authority, Inc., in a meeting held on the 12<sup>th</sup> day of November, 2002, adopted a resolution that the Authority engage in providing a public sewer system for the service area for which it provides water and also that its name be changed to the Harvest-Monrovia Water, Sewer, and Fire Protection Authority, Inc.; that the Board of County Commissioners, Madison County, Alabama, shall review the application and find and determine whether the statements in said application are true. Said application being made for the purposes of allowing the Authority to engage in the providing of a public sewer system in the territory in which it serves water within Madison County, Alabama, and to also change the name from the Harvest-Monrovia Water & Fire Protection Authority, Inc. to the Harvest-Monrovia Water, Sewer, & Fire Protection Authority, Inc.

3.

The concise legal description for which the Authority is now providing water and which it proposes to provide a public sewer system is as follows:

The South one-half of Sections 7, 8, 9 and 10; the Southwest one-quarter of Section 11; the West one-half of Section 14, Sections 15, 16, 17, 18, 19, 20, 21 and 22; the West one-half of Sections 23 and 26; Sections 27, 28, 29, 30, 31, 32, 33 and 34; the West one-half of Section 35, all in Township 2 South, Range 2 West; (b) the West one-half of the Southeast one-quarter of Section 7; the Southwest one-quarter of Section 7; the West one-half of the Northeast one-quarter of Section 18; the West one-half of the Southeast one-quarter of Section 18; the Northwest one-quarter of

Section 18; the southwest one-quarter of Section 18; the West one-half of the Northeast one-quarter of Section 19; the Northwest one-quarter of Section 19; and the Southwest one-quarter of Section 19, all in Township 3 South, Range 1 West; and (c) the West one-half of Section 2; Sections 3, 4, 5, 6, 7, 8, 9 and 10; the West one-half and the Southeast one-quarter of Section 11; the South one-half of Section 12; and Sections 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23 and 24, all in Township 3 South, Range 2 West, AND a tract of land described as being all that part of Section 25, Township 3 South, Range 2 West, Madison County, Alabama, that lies West of the centerline of Johns Road and North of the centerline of Old Monrovia Road, all within Madison County, Alabama.

4.

There is no public sewer system provided within the service area and Authority proposes to commence to render that service.

5.

The providing of a public sewer system will promote the public health, convenience, and welfare of the residents of Madison County, Alabama, residing within the service area.

6.

The Board requests that the Madison County Commission adopt a resolution declaring that it has reviewed the contents of the application, found and determined as a matter of fact that the statements contained in the application are true.

7.

The Directors would respectfully represent unto the Board of County Commissioners of Madison County, Alabama, that the Board of Directors of Harvest-Monrovia Water and Fire Protection Authority, Inc. all live within the area of the territory to be served and that there are Three (3) Directors of the corporation.

8.

The Directors would respectfully represent unto the Board of County Commissioners of Madison County, Alabama, that it would be in the best interest of all concerned that the Articles of Incorporation of the Authority be completely restated as set forth in the Board's resolution of November 12, 2002.

Dated this the 12<sup>th</sup> day of November, 2002.

  
SCOTT SCHRIMSHER

  
JAMES E. RABY

  
GERALD D. DUPREE

Submitted to the Board of County Commissioners of Madison County, Alabama, on this 10 day  
of December, 2002.

HARVEST-MONROVIA WATER & FIRE  
PROTECTION AUTHORITY, INC.

By: 

SCOTT SCHRIMSHER

Its:

Chairman

0

CERTIFICATE OF AMENDMENT TO THE CERTIFICATE OF INCORPORATION  
OF HARVEST-MONROVIA WATER AND FIRE PROTECTION AUTHORITY, INC.

The undersigned, as Chairman of the Board of Directors and as Secretary, respectively, of the Harvest-Monrovia Water and Fire Protection Authority, Inc. (the "Authority"), a public corporation under the laws of Alabama, hereby certify on behalf of Authority under its seal as follows:

1. The Board of Directors of Authority heretofore adopted a resolution, a true and correct copy of which is attached hereto and marked Exhibit "A" and made a part hereof as if fully set out herein. On the 12 day of November, 2002, the Madison County Commission adopted a resolution, a certified copy which is attached and marked Exhibit "B" as if fully set out herein.

2. Each of the aforesaid resolutions are still in full force and effect and neither have been amended altered or appealed. It is proposed that the Certificate of Incorporation of the Authority which was filed of record in the Office of the Judge of Probate of Madison County, Alabama, on August 2, 1965, and recorded in Volume 18, Page 632, of the corporate record books and as amended, be and the same is further amended as follows:

AMENDED DECLARATION OF INCORPORATION

The undersigned, Scott Schrimsher, James E. Raby, and Gerald D. Dupree, as all of the directors of the Harvest-Monrovia Water & Fire Protection Authority, do hereby adopt and file this amended declaration of incorporation, the same to constitute and become its charter for carrying on the business and purposes herein specified pursuant to Act number 107 of the first special session of the 1965 Legislature of the State of Alabama, as amended.

Article I. The names of the current directors of the Authority, together with their residence, are as follows:

Scott Schrimsher  
501 Jeff Road  
Huntsville, AL 35806

James E. Raby  
639 Harvest Road  
Harvest, AL 35749

Gerald D. Dupree  
335 Dupree Drive  
Huntsville, AL 35806

Each one of the directors is a resident of Madison County, Alabama, and is the owner of real property in the service area of the

Harvest-Monrovia Water & Fire Protection Authority and is a duly qualified elector of Madison County, Alabama.

Article II. The name of the corporation is hereby changed from the Harvest-Monrovia Water & Fire Protection Authority, Inc. to Harvest-Monrovia Water, Sewer & Fire Protection Authority, Inc.

Article III. The period of duration of the Authority or corporation shall be perpetual pursuant to the provisions of Section 18 of Act No. 107 of First Special Session of the 1965 Legislature of the State of Alabama.

Article IV. The name of the determining county as provided in said Act is Madison County. The original articles of incorporation were filed on the 2<sup>nd</sup> day of August, 1965, in Corporate Book 18, at Page 634, in the Office of the Judge of Probate of Madison County, Alabama, pursuant to a resolution duly adopted by the governing body of Madison County, Alabama.

Article V. The location of principal office of the Authority shall be at 9131 Wall Triana Highway, Harvest, Alabama 35749, or such other place in Madison County, Alabama, as may from time to time be determined by the Board of Directors of the Authority.

Article VI. A concise legal description of the area in which the Authority is rendering water and fire protection authority and will operate a sewer system that will and does promote the public health and the convenience and welfare of the community as follows:

(a) the South one-half of Sections 7, 8, 9 and 10; the Southwest one-quarter of Section 11; the West one-half of Section 14, Sections 15, 16, 17, 18, 19, 20, 21 and 22; the West one-half of Sections 23 and 26; Sections 27, 28, 29, 30, 31, 32, 33 and 34; the West one-half of Section 35, all in Township 2 South, Range 2 West; (b) the West one-half of the Southeast one-quarter of Section 7; the Southwest one-quarter of Section 7; the West one-half of the Northeast one-quarter of Section 18; the West one-half of the Southeast one-quarter of Section 18; the Northwest one-quarter of Section 18; the southwest one-quarter of Section 18; the West one-half of the Northeast one-quarter of Section 19; the Northwest one-quarter of Section 19; and the Southwest one-quarter of Section 19, all in Township 3 South, Range 1 West; and (c) the West one-half of Section 2; Sections 3, 4, 5, 6, 7, 8, 9 and 10, the West one-half and the Southeast one-quarter of Section 11; the South one-half of Section 12; and Sections 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23 and 24, all in Township 3 South, Range 2 West, AND a tract of land described as being all that part of Section 25, Township 3 South, Range 2 West, Madison County, Alabama, that lies West of the centerline of Johns Road and North of

the centerline of Old Monrovia Road, all within Madison County, Alabama.

Article VII. (a) The purposes for which this corporation, Authority, is formed are: To own by purchase or otherwise lease, rent, or in any other manner, lawfully acquire and to sell, rent, lease or assign to any other person, firm, corporation, county, or municipality, pipe lines and mains, for the transportation, delivery, distribution and sale of water and the operation of a sewer system; and to construct, build, maintain and operate a water system and sewer system for the supplying of water and sewer for domestic, commercial, agricultural, industrial, and other purposes, to persons, firms, or corporations, located in the area described in the above Article VI hereof, and to engage in any activity relating to the ownership, purchase, or other acquisition of pipe lines and mains and the water system and sewer system including, but not limiting to, the acquisition of water by appropriation, drilling, pumping or purchase, and the ownership or other acquisition or disposition of such property, real, personal, or mixed, including wells, pumps, pumping equipment, water mains, pipe lines, valves, meters, and other equipment necessary to the construction, maintenance, and operation of a water and fire protection system and sewer system that are necessary to the conduct of any of the business of this corporation, and necessary to the law of the State of Alabama.


(b) To borrow money from any source, and from time to time, may accept, endorse, execute and issue bonds, debentures, promissory notes, bills of exchange, or other obligations of the Authority or corporation for monies borrowed or in payment for property acquired, or for any of the other objects or purposes of the Authority or corporation, or its business, and to secure the payment of any such obligations by mortgage, pledge, deed, indenture, agreement, or other instrument of trust, or other lien upon, assignment of, or agreements in regard to all or any part of the property rights or pledges of the Authority or corporation wherever situated, whether now owned or hereafter to be acquired.

Article VIII. This Authority or public corporation shall be governed by a Board of Directors as provided for in Section 6 of Act No. 107, of the First Special Session of the 1965 of the Legislature of the State of Alabama and each such Director may be compensated for his services and reimbursed for expenses actually incurred by such person in and about the performance of their duties as provided for in said Section 6.

Article IX. Pursuant to the provisions of Section 4 and Section 5 of said Act No. 107, there is attached hereto a certified copy of the Resolution adopted by the governing body of Madison County, Alabama, as provided for in Section 3 of said Act.

IN WITNESS WHEREOF, the above mentioned individuals  
as Directors of the Authority have hereunto set their hands and seals  
on this the 10 day December, 2002.

  
SCOTT SCHRIMSHER

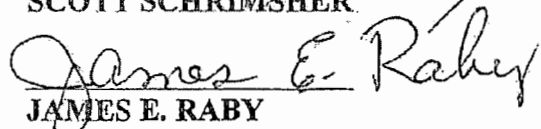  
JAMES E. RABY

  
GERALD D. DUPREE

STATE OF ALABAMA )

COUNTY OF MADISON )

I, the undersigned, a Notary Public in and for said County in  
said State, hereby certify that **SCOTT SCHRIMSHER**, whose name  
as a **Director of Harvest-Monrovia Water & Fire Protection  
Authority, Inc.**, is signed to the foregoing Amendment to the  
Certificate of Incorporation of Harvest-Monrovia Water & Fire  
Protection Authority, Inc., and who is known to me, acknowledged  
before me on this day that, being informed of the contents of the  
conveyance, he, as such Director and with full authority, executed the  
same voluntarily for and as the act of said corporation.

GIVEN under my hand and official seal this the 10 day  
of December, 2002.


  
NOTARY PUBLIC

My commission expires: 3-23-05

STATE OF ALABAMA )

COUNTY OF MADISON )


I, the undersigned, a Notary Public in and for said County in  
said State, hereby certify that **JAMES E. RABY**, whose name as a  
**Director of Harvest-Monrovia Water & Fire Protection  
Authority, Inc.**, is signed to the foregoing Amendment to the  
Certificate of Incorporation of Harvest-Monrovia Water & Fire  
Protection Authority, Inc., and who is known to me, acknowledged  
before me on this day that, being informed of the contents of the

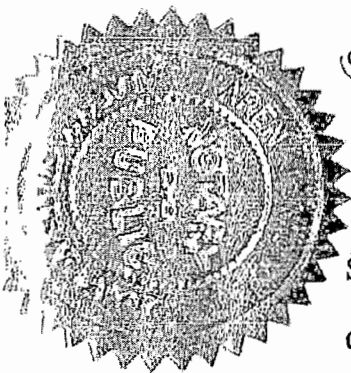



conveyance, he, as such Director and with full authority, executed the same voluntarily for and as the act of said corporation.

GIVEN under my hand and official seal this the 10 day of December, 2002.

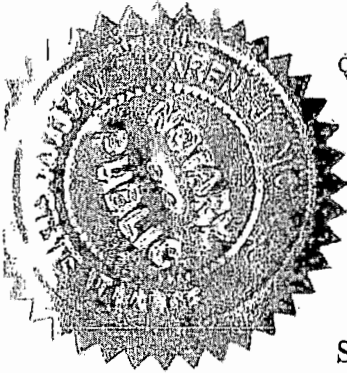

Tara J. Nicholas

NOTARY PUBLIC


My commission expires: 3-23-05

STATE OF ALABAMA )

COUNTY OF MADISON )

I, the undersigned, a Notary Public in and for said County in said State, hereby certify that **GERALD D. DUPREE**, whose name as a **Director of Harvest-Monrovia Water & Fire Protection Authority, Inc.**, is signed to the foregoing Amendment to the Certificate of Incorporation of Harvest-Monrovia Water & Fire Protection Authority, Inc., and who is known to me, acknowledged before me on this day that, being informed of the contents of the conveyance, he, as such Director and with full authority, executed the same voluntarily for and as the act of said corporation.

GIVEN under my hand and official seal this the 10 day of December, 2002.

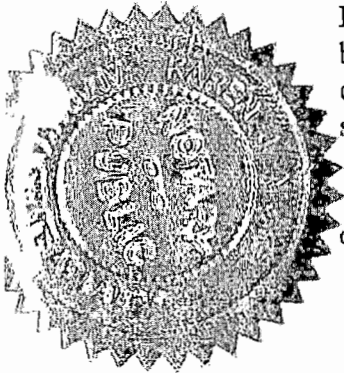

Tara J. Nicholas

NOTARY PUBLIC

My commission expires: 3-23-05

**HARVEST-MONROVIA WATER AND FIRE  
PROTECTION AUTHORITY, INC)**

By: Scott Schrimsher

**SCOTT SCHRIMSHER, Chairman**

ATTEST:

By: James E. Rabey

**JAMES E. RABY, Secretary**

STATE OF ALABAMA     )

COUNTY OF MADISON    )

CERTIFICATE

IN THE MATTER OF THE AMENDMENT OF THE CERTIFICATE OF HARVEST-MONROVIA WATER AND FIRE PROTECTION AUTHORITY, INC.


BEFORE THE HONORABLE TOMMY RAGLAND, JUDGE OF PROBATE OF MADISON COUNTY, ALABAMA.

The foregoing Amendment to the Certificate of Incorporation having been filed with the undersigned Judge of Probate of Madison County, Alabama, in accordance with the terms and provisions of Act 107 of the First Special Session of the 1965 Legislature of the State of Alabama, and it appearing to the Court that the Amendment is complete and regular on its face and that the form and content comply with the provisions of said Act, it is, therefore

ORDERED, ADJUDGED and DECREED that the heretofore issued Certificate of Incorporation in Volume 18, Page 632, Probate Records of Madison County, Alabama, be and the same is hereby amended as provided for herein.

IN WITNESS WHEREOF, I, the said Tommy Ragland, Judge of Probate of Madison County, Alabama, hereunto set my hand and affix my seal of said Probate Court this 3rd day of March, 2002. 2003

Tommy Ragland  
Tommy Ragland, Judge of Probate

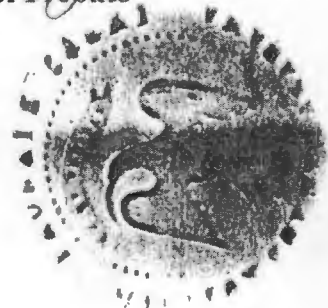

This instrument was prepared by:  
ABLES, BAXTER, PARKER & HALL, P.C.  
Attorneys at Law  
By: L. Bruce Ables, Esq.  
315 Franklin Street, S.E.  
Post Office Box 165  
Huntsville, Alabama 35804-0165  
(256) 533-3740  
FAX (256) 533-3751  
Real Estate FAX (256) 533-0554  
E-Mail: bables@abphlaw.com

F:\WPDOCS\Harvest-Monrovia\certificateamendment\_HarvestMonrovia.wpd

STATE OF ALABAMA

MADISON COUNTY

**RESOLUTION OF THE MADISON COUNTY COMMISSION**

The Madison County Commission of Madison County, Alabama, at its regular meeting on the 21st day of February, 2003, did at said meeting adopt a resolution herein as set out changing the name of the corporation from the Harvest-Monrovia Water and Fire Protection Authority, Inc. to Harvest-Monrovia Water, Sewer, and Fire Protection Authority, Inc., and also, authorizing and giving permission for the Authority to engage in the construction and maintenance of a public sewer system within its service area; the Commission did find that there is no public sewer system serving the area serviced by the Authority and that said amendment allowing and authorizing a public sewer system will promote the public health, convenience and welfare of the residents within the service area and that further, it would be in the best interest of all parties that the articles of Incorporation be amended and restated as set forth in the resolution of Harvest-Monrovia Water and Fire Protection Authority, Inc. dated the 12th day of November, 2002.


Be It resolved by the Madison County Commission of Madison County, Alabama that it has reviewed the contents of the application and found and determined as a matter of fact that the statements contained in the application are true and that the application is accompanied by a certified copy of the resolution adopted by the Board of Directors of Harvest-Monrovia Water and Fire Protection Authority, Inc. proposing the amendment to the Certificate of Incorporation and that said proposed amendment is granted; and

It is, therefore, resolved that the name of the corporation shall be changed from Harvest-Monrovia Water and Fire Protection Authority, Inc. to Harvest-Monrovia Water, Sewer, and Fire Protection Authority, Inc. and it is further resolved that the Authority be and is hereby given permission and authorization to develop, maintain, and engage in a public sewer system within its service area as soon as proper documents have been recorded in the Office of the Judge of Probate of Madison County, Alabama,


including the resolution of this, the Madison County Commission of Madison County,  
Alabama.

DONE this the 21st day of February, 2003

MADISON COUNTY COMMISSION

  
Mike Gillespie, Chairman


ATTEST:


  
Howard Bailes  
County Administrator

STATE OF ALABAMA )

COUNTY OF MADISON )

I, the undersigned, MIKE GILLESPIE, Chairman of the Madison County  
Commission of Madison County, Alabama, do hereby certify that the above and  
foregoing is a true and correct copy of the Resolution adopted by the Madison County  
Commission at its regular meeting on the 21st day of February, 2003.

  
Mike Gillespie, Chairman

|  |  |  |   |   |  |   |  |
|--|--|--|---|---|--|---|--|
| EPA Identification Number  |  | NPDES Permit Number<br>AL0055158   |   | Facility Name<br>Hunter's Crossing WWTP |  | Form Approved 03/05/19<br>OMB No. 2040-0004 |  |
| Form<br>2A<br>NPDES  |   | <b>U.S. Environmental Protection Agency</b><br><b>Application for NPDES Permit to Discharge Wastewater</b><br><b>NEW AND EXISTING PUBLICLY OWNED TREATMENT WORKS</b> |   |   |  |   |  |
| <b>SECTION 1. BASIC APPLICATION INFORMATION FOR ALL APPLICANTS (40 CFR 122.21(j)(1) and (9))</b> |  |  |   |   |  |   |  |
| <b>Facility Information</b>  | 1.1 Facility name<br>Hunter's Crossing WWTP  |  |   |   |  |   |  |
|  | Mailing address (street or P.O. box)<br>PO Box 329   |  |   |   |  |   |  |
|  | City or town<br>Harvest  |  |   |   | State<br>AL  | ZIP code<br>35749                           |  |
|  | Contact name (first and last)<br>Michael Oliver  |  | Title<br>General Manager                                  |   | Phone number<br>(256) 837-1132                               | Email address<br>mikeo@hmwater.org          |  |
|  | Location address (street, route number, or other specific identifier) <input type="checkbox"/> Same as mailing address<br>195 Marlboro Way   |  |   |   |  |   |  |
|  | City or town<br>Madison  |  |   |   | State<br>AL  | ZIP code<br>35757                           |  |
|  | 1.2 Is this application for a facility that has yet to commence discharge?<br><input type="checkbox"/> Yes → See instructions on data submission requirements for new dischargers. <input checked="" type="checkbox"/> No  |  |   |   |  |   |  |
| <b>Applicant Information</b>   | 1.3 Is applicant different from entity listed under Item 1.1 above?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 1.4.   |  |   |   |  |   |  |
|  | Applicant name   |  |   |   |  |   |  |
|  | Applicant address (street or P.O. box)   |  |   |   |  |   |  |
|  | City or town   |  | State   |   | ZIP code   |   |  |
|  | Contact name (first and last)  |  | Title   |   | Phone number   | Email address                               |  |
| <b>Existing Environmental Permits</b>  | 1.4 Is the applicant the facility's owner, operator, or both? (Check only one response.)<br><input type="checkbox"/> Owner <input type="checkbox"/> Operator <input checked="" type="checkbox"/> Both  |  |   |   |  |   |  |
|  | 1.5 To which entity should the NPDES permitting authority send correspondence? (Check only one response.)<br><input type="checkbox"/> Facility <input checked="" type="checkbox"/> Applicant <input type="checkbox"/> Facility and applicant (they are one and the same) |  |   |   |  |   |  |
| <b>Existing Environmental Permits</b>  | 1.6 Indicate below any existing environmental permits. (Check all that apply and print or type the corresponding permit number for each.)  |  |   |   |  |   |  |
|  | <b>Existing Environmental Permits</b>  |  |   |   |  |   |  |
|  | <input checked="" type="checkbox"/> NPDES (discharges to surface water)<br>AL0055158   |  | <input type="checkbox"/> RCRA (hazardous waste)           |   | <input type="checkbox"/> UIC (underground injection control) |   |  |
|  | <input type="checkbox"/> PSD (air emissions)   |  | <input type="checkbox"/> Nonattainment program (CAA)      |   | <input type="checkbox"/> NESHAPs (CAA)                       |   |  |
|  | <input type="checkbox"/> Ocean dumping (MPRSA)   |  | <input type="checkbox"/> Dredge or fill (CWA Section 404) |   | <input type="checkbox"/> Other (specify)                     |   |  |

|   |      |  |                              |   |   |   |  |
|---|------|--|------------------------------|---|---|---|--|
| EPA Identification Number               |      | NPDES Permit Number<br>AL0055158   |                              | Facility Name<br>Hunter's Crossing WWTP   |   | Form Approved 03/05/19<br>OMB No. 2040-0004   |  |
| Collection System and Population Served | 1.7  | Provide the collection system information requested below for the treatment works.   |                              |   |   |   |  |
|   |      | <b>Municipality Served</b>   | <b>Population Served</b>     | <b>Collection System Type</b><br>(indicate percentage)  |   | <b>Ownership Status</b>   |  |
|   |      | Harvest-Monrovia   | 200 Homes<br>(600 Customers) | <input checked="" type="checkbox"/> 100<br><input type="checkbox"/> 0<br><input type="checkbox"/> | % separate sanitary sewer<br>% combined storm and sanitary sewer<br>Unknown | <input checked="" type="checkbox"/> Own<br><input type="checkbox"/> Own<br><input type="checkbox"/> Own | <input checked="" type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain |
|   |      |  |                              | <input type="checkbox"/>  | % separate sanitary sewer<br>% combined storm and sanitary sewer<br>Unknown | <input type="checkbox"/> Own<br><input type="checkbox"/> Own<br><input type="checkbox"/> Own            | <input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain            |
|   |      |  |                              | <input type="checkbox"/>  | % separate sanitary sewer<br>% combined storm and sanitary sewer<br>Unknown | <input type="checkbox"/> Own<br><input type="checkbox"/> Own<br><input type="checkbox"/> Own            | <input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain            |
|   |      |  |                              | <input type="checkbox"/>  | % separate sanitary sewer<br>% combined storm and sanitary sewer<br>Unknown | <input type="checkbox"/> Own<br><input type="checkbox"/> Own<br><input type="checkbox"/> Own            | <input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain            |
|   |      |  |                              | <input type="checkbox"/>  | % separate sanitary sewer<br>% combined storm and sanitary sewer<br>Unknown | <input type="checkbox"/> Own<br><input type="checkbox"/> Own<br><input type="checkbox"/> Own            | <input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain<br><input type="checkbox"/> Maintain            |
|   |      | <b>Total Population Served</b>   | 200 Homes<br>(600 Customers) |   |   |   |  |
|   |      |  |                              | <b>Separate Sanitary Sewer System</b>   |   | <b>Combined Storm and Sanitary Sewer</b>  |  |
|   |      | Total percentage of each type of sewer line (in miles)   |                              | 100 %   |   | 0 %   |  |
| Indian Country                          | 1.8  | Is the treatment works located in Indian Country?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No                                   |                              |   |   |   |  |
|   | 1.9  | Does the facility discharge to a receiving water that flows through Indian Country?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No |                              |   |   |   |  |
| Design and Actual Flow Rates            | 1.10 | Provide design and actual flow rates in the designated spaces.   |                              |   |   | <b>Design Flow Rate</b>   |  |
|   |      |  |                              |   |   | 0.075 mgd   |  |
|   |      | <b>Annual Average Flow Rates (Actual)</b>  |                              |   |   |   |  |
|   |      | <b>Two Years Ago</b>   |                              | <b>Last Year</b>  |   | <b>This Year</b>  |  |
|   |      | 0.062 mgd  |                              | 0.076 mgd   |   | 0.082 mgd   |  |
|   |      | <b>Maximum Daily Flow Rates (Actual)</b>   |                              |   |   |   |  |
| <b>Two Years Ago</b>                    |      | <b>Last Year</b>   |                              | <b>This Year</b>  |   |   |  |
| 0.168 mgd                               |      | 0.168 mgd  |                              | 0.161 mgd   |   |   |  |
| Discharge Points by Type                | 1.11 | Provide the total number of effluent discharge points to waters of the United States by type.  |                              |   |   |   |  |
|   |      | <b>Total Number of Effluent Discharge Points by Type</b>   |                              |   |   |   |  |
|   |      | <b>Treated Effluent</b>  | <b>Untreated Effluent</b>    | <b>Combined Sewer Overflows</b>   | <b>Bypasses</b>   | <b>Constructed Emergency Overflows</b>  |  |
|   |      | 1  | 0                            | 0   | 0   | 0   |  |

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|   |   |   |   |  |  |
|---|---|---|---|--|--|
| <b>Outfalls and Other Discharge or Disposal Methods</b> | <b>Outfalls Other Than to Waters of the United States</b>   |   |   |  |  |
|   | 1.12  | Does the POTW discharge wastewater to basins, ponds, or other surface impoundments that do not have outlets for discharge to waters of the United States?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 1.14. |   |  |  |
|   | 1.13  | Provide the location of each surface impoundment and associated discharge information in the table below.   |   |  |  |
|   | <b>Surface Impoundment Location and Discharge Data</b>  |   |   |  |  |
|   |   | <b>Location</b>   | <b>Average Daily Volume Discharged to Surface Impoundment</b> | <b>Continuous or Intermittent (check one)</b>                                |  |
|   |   |   | gpd   | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |  |
|   |   |   | gpd   | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |  |
|   |   |   | gpd   | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |  |
|   | 1.14  | Is wastewater applied to land?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 1.16.  |   |  |  |
|   | 1.15  | Provide the land application site and discharge data requested below.   |   |  |  |
|   | <b>Land Application Site and Discharge Data</b>   |   |   |  |  |
|   |   | <b>Location</b>   | <b>Size</b>   | <b>Average Daily Volume Applied</b>  | <b>Continuous or Intermittent (check one)</b>                                |
|   |   |   | acres   | gpd  | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |
|   |   |   | acres   | gpd  | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |
|   |   |   | acres   | gpd  | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |
| 1.16  | Is effluent transported to another facility for treatment prior to discharge?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 1.21. |   |   |  |  |
| 1.17  | Describe the means by which the effluent is transported (e.g., tank truck, pipe).   |   |   |  |  |
| 1.18  | Is the effluent transported by a party other than the applicant?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 1.20.                         |   |   |  |  |
| 1.19  | Provide information on the transporter below.   |   |   |  |  |
| <b>Transporter Data</b>                                 |   |   |   |  |  |
| Entity name   |   | Mailing address (street or P.O. box)  |   |  |  |
| City or town  |   | State   | ZIP code  |  |  |
| Contact name (first and last)                           |   | Title   |   |  |  |
| Phone number  |   | Email address   |   |  |  |



|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|   |   |   |  |  |
|---|---|---|--|--|
| <b>Outfalls and Other Discharge or Disposal Methods Continued</b> | 1.20  | In the table below, indicate the name, address, contact information, NPDES number, and average daily flow rate of the receiving facility.   |  |  |
|   | <b>Receiving Facility Data</b>  |   |  |  |
|   | Facility name   |   | Mailing address (street or P.O. box)         |  |
|   | City or town  |   | State  | ZIP code   |
|   | Contact name (first and last)   |   | Title  |  |
|   | Phone number  |   | Email address                                |  |
|   | NPDES number of receiving facility (if any) <input type="checkbox"/> None |   | Average daily flow rate mgd                  |  |
|   | 1.21  | Is the wastewater disposed of in a manner other than those already mentioned in Items 1.14 through 1.21 that do not have outlets to waters of the United States (e.g., underground percolation, underground injection)?<br><br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 1.23. |  |  |
|   | 1.22  | Provide information in the table below on these other disposal methods.   |  |  |
|   | <b>Information on Other Disposal Methods</b>                              |   |  |  |
| <b>Disposal Method Description</b>                                | <b>Location of Disposal Site</b>  | <b>Size of Disposal Site</b>  | <b>Annual Average Daily Discharge Volume</b> | <b>Continuous or Intermittent (check one)</b>                                |
|   |   | acres   | gpd  | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |
|   |   | acres   | gpd  | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |
|   |   | acres   | gpd  | <input type="checkbox"/> Continuous<br><input type="checkbox"/> Intermittent |

|                          |      |   |
|--------------------------|------|---|
| <b>Variance Requests</b> | 1.23 | Do you intend to request or renew one or more of the variances authorized at 40 CFR 122.21(n)? (Check all that apply. Consult with your NPDES permitting authority to determine what information needs to be submitted and when.)<br><br><input type="checkbox"/> Discharges into marine waters (CWA Section 301(h)) <input type="checkbox"/> Water quality related effluent limitation (CWA Section 302(b)(2))<br><input checked="" type="checkbox"/> Not applicable |
|--------------------------|------|---|

|  |                                      |  |                     |                     |
|--|--------------------------------------|--|---------------------|---------------------|
| <b>Contractor Information</b>                              | 1.24                                 | Are any operational or maintenance aspects (related to wastewater treatment and effluent quality) of the treatment works the responsibility of a contractor?<br><br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Section 2. |                     |                     |
|  | 1.25                                 | Provide location and contact information for each contractor in addition to a description of the contractor's operational and maintenance responsibilities.  |                     |                     |
|  | <b>Contractor Information</b>        |  |                     |                     |
|  |                                      | <b>Contractor 1</b>  | <b>Contractor 2</b> | <b>Contractor 3</b> |
|  | Contractor name (company name)       |  |                     |                     |
|  | Mailing address (street or P.O. box) |  |                     |                     |
|  | City, state, and ZIP code            |  |                     |                     |
|  | Contact name (first and last)        |  |                     |                     |
|  | Phone number                         |  |                     |                     |
|  | Email address                        |  |                     |                     |
| Operational and maintenance responsibilities of contractor |                                      |  |                     |                     |

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

**SECTION 2. ADDITIONAL INFORMATION (40 CFR 122.21(j)(1) and (2))**

|   |  |   |  |  |                                      |  |   |
|---|--|---|--|--|--------------------------------------|--|---|
| <b>Design Flow</b>  | <b>Outfalls to Waters of the United States</b>   |   |  |  |                                      |  |   |
|   | 2.1  | Does the treatment works have a design flow greater than or equal to 0.1 mgd?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Section 3.   |  |  |                                      |  |   |
| <b>Inflow and Infiltration</b>                                | 2.2  | Provide the treatment works' current average daily volume of inflow and infiltration.   |  |  |                                      | <b>Average Daily Volume of Inflow and Infiltration</b> |   |
|   |  |   |  |  |                                      | gpd  |   |
| <b>Topographic Map</b>  | 2.3  | Have you attached a topographic map to this application that contains all the required information? (See instructions for specific requirements.)<br><input type="checkbox"/> Yes <input type="checkbox"/> No                   |  |  |                                      |  |   |
|   | 2.4  | Have you attached a process flow diagram or schematic to this application that contains all the required information? (See instructions for specific requirements.)<br><input type="checkbox"/> Yes <input type="checkbox"/> No |  |  |                                      |  |   |
| <b>Scheduled Improvements and Schedules of Implementation</b> | 2.5  | Are improvements to the facility scheduled?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Section 3.  |  |  |                                      |  |   |
|   |  | Briefly list and describe the scheduled improvements.   |  |  |                                      |  |   |
|   |  | 1.  |  |  |                                      |  |   |
|   |  | 2.  |  |  |                                      |  |   |
|   |  | 3.  |  |  |                                      |  |   |
|   |  | 4.  |  |  |                                      |  |   |
|   | 2.6  | Provide scheduled or actual dates of completion for improvements.   |  |  |                                      |  |   |
|   |  | <b>Scheduled or Actual Dates of Completion for Improvements</b>   |  |  |                                      |  |   |
|   |  | <b>Scheduled Improvement (from above)</b>   | <b>Affected Outfalls (list outfall number)</b> | <b>Begin Construction (MM/DD/YYYY)</b> | <b>End Construction (MM/DD/YYYY)</b> | <b>Begin Discharge (MM/DD/YYYY)</b>                    | <b>Attainment of Operational Level (MM/DD/YYYY)</b> |
|   |  | 1.  |  |  |                                      |  |   |
|   | 2.   |   |  |  |                                      |  |   |
|   | 3.   |   |  |  |                                      |  |   |
|   | 4.   |   |  |  |                                      |  |   |
| 2.7   | Have appropriate permits/clearances concerning other federal/state requirements been obtained? Briefly explain your response.<br><input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> None required or applicable |   |  |  |                                      |  |   |
|   | Explanation:   |   |  |  |                                      |  |   |

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

**SECTION 3. INFORMATION ON EFFLUENT DISCHARGES (40 CFR 122.21(j)(3) to (5))**

|  |  |  |                             |                             |                      |
|--|--|--|-----------------------------|-----------------------------|----------------------|
| <b>Description of Outfalls</b>             | 3.1  | Provide the following information for each outfall. (Attach additional sheets if you have more than three outfalls.)   |                             |                             |                      |
|  |  | <b>Outfall Number</b> 011  | <b>Outfall Number</b> _____ | <b>Outfall Number</b> _____ |                      |
|  | State  | Alabama  |                             |                             |                      |
|  | County   | Madison  |                             |                             |                      |
|  | City or town                                       | Madison  |                             |                             |                      |
|  | Distance from shore                                | 0.00 ft.   |                             |                             | ft. RECEIVED         |
|  | Depth below surface                                | 0.00 ft.   |                             |                             | ft. AUG 25 2022      |
|  | Average daily flow rate                            | 0.082 mgd  |                             |                             | mgd MUNICIPAL SECTOR |
|  | Latitude   | 34° 46' 21.3" N  |                             |                             |                      |
|  | Longitude  | 86° 45' 19.3" W  |                             |                             |                      |
| <b>Seasonal or Periodic Discharge Data</b> | 3.2  | Do any of the outfalls described under Item 3.1 have seasonal or periodic discharges?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 3.4.   |                             |                             |                      |
|  | 3.3  | If so, provide the following information for each applicable outfall.  |                             |                             |                      |
|  |  | <b>Outfall Number</b> _____  | <b>Outfall Number</b> _____ | <b>Outfall Number</b> _____ |                      |
|  | Number of times per year discharge occurs          |  |                             |                             |                      |
|  | Average duration of each discharge (specify units) |  |                             |                             |                      |
|  | Average flow of each discharge                     |  | mgd                         | mgd                         | mgd                  |
| Months in which discharge occurs           |  |  |                             |                             |                      |
| <b>Diffuser Type</b>                       | 3.4  | Are any of the outfalls listed under Item 3.1 equipped with a diffuser?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 3.6.   |                             |                             |                      |
|  | 3.5  | Briefly describe the diffuser type at each applicable outfall.   |                             |                             |                      |
|  |  | <b>Outfall Number</b> _____  | <b>Outfall Number</b> _____ | <b>Outfall Number</b> _____ |                      |
| <b>Waters of the U.S.</b>                  | 3.6  | Does the treatment works discharge or plan to discharge wastewater to waters of the United States from one or more discharge points?<br><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Section 6. |                             |                             |                      |

|                             |  |   |   |   |                           |   |                           |
|-----------------------------|--|---|---|---|---------------------------|---|---------------------------|
| EPA Identification Number   |  | NPDES Permit Number<br>AL0055158  |   | Facility Name<br>Hunter's Crossing WWTP   |                           | Form Approved 03/05/19<br>OMB No. 2040-0004 |                           |
| Receiving Water Description | 3.7  | Provide the receiving water and related information (if known) for each outfall.  |   |   |                           |   |                           |
|                             |  |   | Outfall Number <u>011</u>   | Outfall Number _____  | Outfall Number _____      |   |                           |
|                             | Receiving water name   | Knox Creek  |   |   |                           |   |                           |
|                             | Name of watershed, river, or stream system                     | Middle Limestone Creek  |   |   |                           |   |                           |
|                             | U.S. Soil Conservation Service 14-digit watershed code         |   |   |   |                           |   |                           |
|                             | Name of state management/river basin                           |   |   |   |                           |   |                           |
|                             | U.S. Geological Survey 8-digit hydrologic cataloging unit code | Wheeler Lake 06030002   |   |   |                           |   |                           |
|                             | Critical low flow (acute)                                      |   | cfs   |   | cfs                       |   | cfs                       |
|                             | Critical low flow (chronic)                                    |   | cfs   |   | cfs                       |   | cfs                       |
|                             | Total hardness at critical low flow                            |   | mg/L of CaCO <sub>3</sub>   |   | mg/L of CaCO <sub>3</sub> |   | mg/L of CaCO <sub>3</sub> |
| Treatment Description       | 3.8  | Provide the following information describing the treatment provided for discharges from each outfall.   |   |   |                           |   |                           |
|                             |  |   | Outfall Number <u>011</u>   | Outfall Number _____  | Outfall Number _____      |   |                           |
|                             | Highest Level of Treatment (check all that apply per outfall)  | <input checked="" type="checkbox"/> Primary<br><input type="checkbox"/> Equivalent to secondary<br><input checked="" type="checkbox"/> Secondary<br><input type="checkbox"/> Advanced<br><input type="checkbox"/> Other (specify) _____ | <input type="checkbox"/> Primary<br><input type="checkbox"/> Equivalent to secondary<br><input type="checkbox"/> Secondary<br><input type="checkbox"/> Advanced<br><input type="checkbox"/> Other (specify) _____ | <input type="checkbox"/> Primary<br><input type="checkbox"/> Equivalent to secondary<br><input type="checkbox"/> Secondary<br><input type="checkbox"/> Advanced<br><input type="checkbox"/> Other (specify) _____ |                           |   |                           |
|                             | Design Removal Rates by Outfall                                |   |   |   |                           |   |                           |
|                             | BOD <sub>5</sub> or CBOD <sub>5</sub>                          | 85  | %   |   | %                         | %   |                           |
|                             | TSS  | 85  | %   |   | %                         | %   |                           |
|                             | Phosphorus   | <input checked="" type="checkbox"/> Not applicable  | %   | <input type="checkbox"/> Not applicable   | %                         | <input type="checkbox"/> Not applicable     |                           |
|                             | Nitrogen   | <input checked="" type="checkbox"/> Not applicable  | %   | <input type="checkbox"/> Not applicable   | %                         | <input type="checkbox"/> Not applicable     |                           |
|                             | Other (specify) _____  | <input checked="" type="checkbox"/> Not applicable  | %   | <input type="checkbox"/> Not applicable   | %                         | <input type="checkbox"/> Not applicable     |                           |
|                             |  |   |   |   |                           |   |                           |

Page 8

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|  |  |   |   |
|--|--|---|---|
| <b>Effluent Testing Data Continued</b>   | 3.19   | Has the POTW conducted either (1) minimum of four quarterly WET tests for one year preceding this permit application or (2) at least four annual WET tests in the past 4.5 years? |   |
|  | <input type="checkbox"/> Yes   |   | <input type="checkbox"/> No → Complete tests and Table E and SKIP to Item 3.26. |
|  | 3.20   | Have you previously submitted the results of the above tests to your NPDES permitting authority?  |   |
|  | <input type="checkbox"/> Yes   |   | <input type="checkbox"/> No → Provide results in Table E and SKIP to Item 3.26. |
|  | 3.21   | Indicate the dates the data were submitted to your NPDES permitting authority and provide a summary of the results.   |   |
|  | <b>Date(s) Submitted</b><br>(MM/DD/YYYY)   |   | <b>Summary of Results</b>   |
|  |  |   |   |
|  | 3.22   | Regardless of how you provided your WET testing data to the NPDES permitting authority, did any of the tests result in toxicity?  |   |
|  | <input type="checkbox"/> Yes   |   | <input type="checkbox"/> No → SKIP to Item 3.26.                                |
| 3.23   | Describe the cause(s) of the toxicity:   |   |   |
|  |  |   |   |
| 3.24   | Has the treatment works conducted a toxicity reduction evaluation?   |   |   |
| <input type="checkbox"/> Yes   |  | <input type="checkbox"/> No → SKIP to Item 3.26.  |   |
| 3.25   | Provide details of any toxicity reduction evaluations conducted.   |   |   |
|  |  |   |   |
| 3.26   | Have you completed Table E for all applicable outfalls and attached the results to the application package?  |   |   |
| <input type="checkbox"/> Yes   |  | <input type="checkbox"/> Not applicable because previously submitted information to the NPDES permitting authority.   |   |
| <b>SECTION 4. INDUSTRIAL DISCHARGES AND HAZARDOUS WASTES (40 CFR 122.21(j)(6) and (7))</b> |  |   |   |
| <b>Industrial Discharges and Hazardous Wastes</b>  | 4.1  | Does the POTW receive discharges from SIUs or NSCIUs?   |   |
|  | <input type="checkbox"/> Yes   |   | <input checked="" type="checkbox"/> No → SKIP to Item 4.7.                      |
|  | 4.2  | Indicate the number of SIUs and NSCIUs that discharge to the POTW.  |   |
|  | <b>Number of SIUs</b>  |   | <b>Number of NSCIUs</b>   |
|  |  |   |   |
|  | 4.3  | Does the POTW have an approved pretreatment program?  |   |
|  | <input type="checkbox"/> Yes   |   | <input type="checkbox"/> No   |
| 4.4  | Have you submitted either of the following to the NPDES permitting authority that contains information substantially identical to that required in Table F: (1) a pretreatment program annual report submitted within one year of the application or (2) a pretreatment program? |   |   |
| <input type="checkbox"/> Yes   |  | <input type="checkbox"/> No → SKIP to Item 4.6.   |   |
| 4.5  | Identify the title and date of the annual report or pretreatment program referenced in Item 4.4. SKIP to Item 4.7.   |   |   |
|  |  |   |   |
| 4.6  | Have you completed and attached Table F to this application package?   |   |   |
| <input type="checkbox"/> Yes   |  | <input type="checkbox"/> No   |   |

|                           |                                  |   |   |  |
|---------------------------|----------------------------------|---|---|--|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |  |
|---------------------------|----------------------------------|---|---|--|

|   |                               |   |   |  |              |
|---|-------------------------------|---|---|--|--------------|
| <b>Industrial Discharges and Hazardous Wastes Continued</b> | 4.7                           | Does the POTW receive, or has it been notified that it will receive, by truck, rail, or dedicated pipe, any wastes that are regulated as RCRA hazardous wastes pursuant to 40 CFR 261?<br><br><input type="checkbox"/> Yes <span style="margin-left: 150px;"><input checked="" type="checkbox"/> No → SKIP to Item 4.9.</span>  |   |  |              |
|   | 4.8                           | If yes, provide the following information:  |   |  |              |
|   | <b>Hazardous Waste Number</b> | <b>Waste Transport Method</b><br>(check all that apply)   |   | <b>Annual Amount of Waste Received</b> | <b>Units</b> |
|   |                               | <input type="checkbox"/> Truck<br><input type="checkbox"/> Dedicated pipe   | <input type="checkbox"/> Rail<br><input type="checkbox"/> Other (specify) _____ |  |              |
|   |                               | <input type="checkbox"/> Truck<br><input type="checkbox"/> Dedicated pipe   | <input type="checkbox"/> Rail<br><input type="checkbox"/> Other (specify) _____ |  |              |
|   |                               | <input type="checkbox"/> Truck<br><input type="checkbox"/> Dedicated pipe   | <input type="checkbox"/> Rail<br><input type="checkbox"/> Other (specify) _____ |  |              |
|   |                               |   |   |  |              |
|   | 4.9                           | Does the POTW receive, or has it been notified that it will receive, wastewaters that originate from remedial activities, including those undertaken pursuant to CERCLA and Sections 3004(7) or 3008(h) of RCRA?<br><br><input type="checkbox"/> Yes <span style="margin-left: 150px;"><input checked="" type="checkbox"/> No → SKIP to Section 5.</span>   |   |  |              |
|   | 4.10                          | Does the POTW receive (or expect to receive) less than 15 kilograms per month of non-acute hazardous wastes as specified in 40 CFR 261.30(d) and 261.33(e)?<br><br><input type="checkbox"/> Yes → SKIP to Section 5. <span style="margin-left: 150px;"><input type="checkbox"/> No</span>   |   |  |              |
|   | 4.11                          | Have you reported the following information in an attachment to this application: identification and description of the site(s) or facility(ies) at which the wastewater originates; the identities of the wastewater's hazardous constituents; and the extent of treatment, if any, the wastewater receives or will receive before entering the POTW?<br><br><input type="checkbox"/> Yes <span style="margin-left: 150px;"><input type="checkbox"/> No</span> |   |  |              |

| SECTION 5. COMBINED SEWER OVERFLOWS (40 CFR 122.21(j)(8)) |     |   |
|---|-----|---|
| <b>CSO Map and Diagram</b>                                | 5.1 | Does the treatment works have a combined sewer system?<br><br><input type="checkbox"/> Yes <span style="margin-left: 150px;"><input checked="" type="checkbox"/> No → SKIP to Section 6.</span>                   |
|   | 5.2 | Have you attached a CSO system map to this application? (See instructions for map requirements.)<br><br><input type="checkbox"/> Yes <span style="margin-left: 150px;"><input type="checkbox"/> No</span>         |
|   | 5.3 | Have you attached a CSO system diagram to this application? (See instructions for diagram requirements.)<br><br><input type="checkbox"/> Yes <span style="margin-left: 150px;"><input type="checkbox"/> No</span> |

|                           |     |   |   |   |   |   |   |  |
|---------------------------|-----|---|---|---|---|---|---|--|
| EPA Identification Number |     | NPDES Permit Number<br>AL0055158  |   | Facility Name<br>Hunter's Crossing WWTP |   | Form Approved 03/05/19<br>OMB No. 2040-0004 |   |  |
| CSO Outfall Description   | 5.4 | For each CSO outfall, provide the following information. (Attach additional sheets as necessary.) |   |   |   |   |   |  |
|                           |     |   | CSO Outfall Number _____  |   | CSO Outfall Number _____  |   | CSO Outfall Number _____  |  |
|                           |     | City or town  |   |   |   |   |   |  |
|                           |     | State and ZIP code  |   |   |   |   |   |  |
|                           |     | County  |   |   |   |   |   |  |
|                           |     | Latitude  | ° ' "   |   | ° ' "   |   | ° ' "   |  |
|                           |     | Longitude   | ° ' "   |   | ° ' "   |   | ° ' "   |  |
|                           |     | Distance from shore   | ft.   |   | ft.   |   | ft.   |  |
|                           |     | Depth below surface   | ft.   |   | ft.   |   | ft.   |  |
| CSO Monitoring            | 5.5 | Did the POTW monitor any of the following items in the past year for its CSO outfalls?            |   |   |   |   |   |  |
|                           |     |   | CSO Outfall Number _____  |   | CSO Outfall Number _____  |   | CSO Outfall Number _____  |  |
|                           |     | Rainfall  | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |  |
|                           |     | CSO flow volume   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |  |
|                           |     | CSO pollutant concentrations  | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |  |
|                           |     | Receiving water quality   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |  |
|                           |     | CSO frequency   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |  |
|                           |     | Number of storm events  | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |   | <input type="checkbox"/> Yes <input type="checkbox"/> No                                    |  |
| CSO Events in Past Year   | 5.6 | Provide the following information for each of your CSO outfalls.                                  |   |   |   |   |   |  |
|                           |     |   | CSO Outfall Number _____  |   | CSO Outfall Number _____  |   | CSO Outfall Number _____  |  |
|                           |     | Number of CSO events in the past year   | events  |   | events  |   | events  |  |
|                           |     | Average duration per event  | hours<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated              |   | hours<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated              |   | hours<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated              |  |
|                           |     | Average volume per event  | million gallons<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated    |   | million gallons<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated    |   | million gallons<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated    |  |
|                           |     | Minimum rainfall causing a CSO event in last year   | inches of rainfall<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated |   | inches of rainfall<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated |   | inches of rainfall<br><input type="checkbox"/> Actual or <input type="checkbox"/> Estimated |  |



|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|                             |   |   |                                  |                                  |
|-----------------------------|---|---|----------------------------------|----------------------------------|
| <b>CSO Receiving Waters</b> | <b>5.7</b>  | Provide the information in the table below for each of your CSO outfalls. |                                  |                                  |
|                             |   | <b>CSO Outfall Number</b> _____   | <b>CSO Outfall Number</b> _____  | <b>CSO Outfall Number</b> _____  |
|                             | Receiving water name  |   |                                  |                                  |
|                             | Name of watershed/<br>stream system   |   |                                  |                                  |
|                             | U.S. Soil Conservation<br>Service 14-digit<br>watershed code<br>(if known)  | <input type="checkbox"/> Unknown  | <input type="checkbox"/> Unknown | <input type="checkbox"/> Unknown |
|                             | Name of state<br>management/river basin   |   |                                  |                                  |
|                             | U.S. Geological Survey<br>8-Digit Hydrologic Unit<br>Code (if known)  | <input type="checkbox"/> Unknown  | <input type="checkbox"/> Unknown | <input type="checkbox"/> Unknown |
|                             | Description of known<br>water quality impacts on<br>receiving stream by CSO<br>(see instructions for<br>examples) |   |                                  |                                  |


  

|  |  |
|--|--|
| <b>SECTION 6. CHECKLIST AND CERTIFICATION STATEMENT (40 CFR 122.22(a) and (d))</b> |  |
|--|--|

|  |                                     |   |   |
|--|-------------------------------------|---|---|
| <b>Checklist and Certification Statement</b> | <b>6.1</b>                          | In Column 1 below, mark the sections of Form 2A that you have completed and are submitting with your application. For each section, specify in Column 2 any attachments that you are enclosing to alert the permitting authority. Note that not all applicants are required to provide attachments. |   |
|  |                                     | <b>Column 1</b>   | <b>Column 2</b>   |
|  | <input checked="" type="checkbox"/> | Section 1: Basic Application Information for All Applicants   | <input type="checkbox"/> w/ variance request(s) <input type="checkbox"/> w/ additional attachments  |
|  | <input checked="" type="checkbox"/> | Section 2: Additional Information   | <input checked="" type="checkbox"/> w/ topographic map <input checked="" type="checkbox"/> w/ process flow diagram<br><input type="checkbox"/> w/ additional attachments  |
|  | <input checked="" type="checkbox"/> | Section 3: Information on Effluent Discharges   | <input checked="" type="checkbox"/> w/ Table A <input type="checkbox"/> w/ Table D<br><input type="checkbox"/> w/ Table B <input type="checkbox"/> w/ Table E<br><input type="checkbox"/> w/ Table C <input type="checkbox"/> w/ additional attachments |
|  | <input checked="" type="checkbox"/> | Section 4: Industrial Discharges and Hazardous Wastes   | <input type="checkbox"/> w/ SIU and NSCIU attachments <input type="checkbox"/> w/ Table F<br><input type="checkbox"/> w/ additional attachments   |
|  | <input checked="" type="checkbox"/> | Section 5: Combined Sewer Overflows   | <input type="checkbox"/> w/ CSO map <input type="checkbox"/> w/ additional attachments<br><input type="checkbox"/> w/ CSO system diagram  |
|  | <input checked="" type="checkbox"/> | Section 6: Checklist and Certification Statement  | <input type="checkbox"/> w/ attachments   |

|            |  |                       |
|------------|--|-----------------------|
| <b>6.2</b> | <b>Certification Statement</b><br><br><i>I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.</i> |                       |
|            | Name (print or type first and last name)   | Official title        |
|            | Michael Oliver   | General Manager       |
|            | Signature<br>   | Date signed<br>8-4-22 |

|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

**TABLE A. EFFLUENT PARAMETERS FOR ALL POTWS**

| Pollutant   | Maximum Daily Discharge |           | Average Daily Discharge |           |                   | Analytical Method <sup>1</sup> | ML or MDL<br>(include units)  |
|---|-------------------------|-----------|-------------------------|-----------|-------------------|--------------------------------|---|
|   | Value                   | Units     | Value                   | Units     | Number of Samples |                                |   |
| Biochemical oxygen demand<br><input type="checkbox"/> BOD <sub>5</sub> or <input checked="" type="checkbox"/> CBOD <sub>5</sub><br>(report one) | 14                      | mg/l      | 2.29                    | mg/l      | 150               | SM 5210 b-2011                 | 2.0 mg/l <input type="checkbox"/> ML<br><input checked="" type="checkbox"/> MDL   |
| Fecal coliform  | 800                     | col/100ml | 5                       | col/100ml | 150               | SM 9223b-04                    | 0 col/100l <input type="checkbox"/> ML<br><input checked="" type="checkbox"/> MDL |
| Design flow rate  | 0.173970                | MGD       | 0.076336                | MGD       | 1095              |                                |   |
| pH (minimum)  | 7.0                     | ph        |                         |           |                   |                                |   |
| pH (maximum)  | 7.63                    | ph        |                         |           |                   |                                |   |
| Temperature (winter)  | 12                      |           | 16                      |           | 4                 |                                |   |
| Temperature (summer)  | 22                      |           | 19                      |           | 4                 |                                |   |
| Total suspended solids (TSS)  | 19.5                    | mg/l      | 1.9                     | mg/l      | 150               | USGS I-3765-85                 | 1.0 mg/l <input type="checkbox"/> ML<br><input checked="" type="checkbox"/> MDL   |

<sup>1</sup> Sampling shall be conducted according to sufficiently sensitive test procedures (i.e., methods) approved under 40 CFR 136 for the analysis of pollutants or pollutant parameters or required under 40 CFR chapter I, subchapter N or O. See instructions and 40 CFR 122.21(e)(3).

---

This page intentionally left blank.

|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

**TABLE B. EFFLUENT PARAMETERS FOR ALL POTWS WITH A FLOW EQUAL TO OR GREATER THAN 0.1 MGD**

| Pollutant                                      | Maximum Daily Discharge |       | Average Daily Discharge |       |                   | Analytical Method <sup>1</sup> | ML or MDL<br>(include units)                                |
|--|-------------------------|-------|-------------------------|-------|-------------------|--------------------------------|---|
|  | Value                   | Units | Value                   | Units | Number of Samples |                                |   |
| Ammonia (as N)                                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Chlorine<br>(total residual, TRC) <sup>2</sup> |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Dissolved oxygen                               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Nitrate/nitrite                                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Kjeldahl nitrogen                              |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Oil and grease                                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Phosphorus                                     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Total dissolved solids                         |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |

<sup>1</sup> Sampling shall be conducted according to sufficiently sensitive test procedures (i.e., methods) approved under 40 CFR 136 for the analysis of pollutants or pollutant parameters or required under 40 CFR chapter I, subchapter N or O. See instructions and 40 CFR 122.21(e)(3).

<sup>2</sup> Facilities that do not use chlorine for disinfection, do not use chlorine elsewhere in the treatment process, and have no reasonable potential to discharge chlorine in their effluent are not required to report data for chlorine.

This page intentionally left blank.

|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

**TABLE C. EFFLUENT PARAMETERS FOR SELECTED POTWS**

| Pollutant                                 | Maximum Daily Discharge |       | Average Daily Discharge |       |                   | Analytical Method <sup>1</sup> | ML or MDL (include units)                                   |
|---|-------------------------|-------|-------------------------|-------|-------------------|--------------------------------|---|
|   | Value                   | Units | Value                   | Units | Number of Samples |                                |   |
| <b>Metals, Cyanide, and Total Phenols</b> |                         |       |                         |       |                   |                                |   |
| Hardness (as CaCO <sub>3</sub> )          |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Antimony, total recoverable               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Arsenic, total recoverable                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Beryllium, total recoverable              |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Cadmium, total recoverable                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Chromium, total recoverable               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Copper, total recoverable                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Lead, total recoverable                   |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Mercury, total recoverable                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Nickel, total recoverable                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Selenium, total recoverable               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Silver, total recoverable                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Thallium, total recoverable               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Zinc, total recoverable                   |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Cyanide                                   |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Total phenolic compounds                  |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| <b>Volatile Organic Compounds</b>         |                         |       |                         |       |                   |                                |   |
| Acrolein                                  |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Acrylonitrile                             |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Benzene                                   |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Bromoform                                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |

|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

**TABLE C. EFFLUENT PARAMETERS FOR SELECTED POTWS**

| Pollutant                  | Maximum Daily Discharge |       | Average Daily Discharge |       |                   | Analytical Method <sup>1</sup> | ML or MDL<br>(include units)                                |
|----------------------------|-------------------------|-------|-------------------------|-------|-------------------|--------------------------------|---|
|                            | Value                   | Units | Value                   | Units | Number of Samples |                                |   |
| Carbon tetrachloride       |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Chlorobenzene              |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Chlorodibromomethane       |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Chloroethane               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2-chloroethylvinyl ether   |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Chloroform                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Dichlorobromomethane       |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,1-dichloroethane         |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,2-dichloroethane         |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| trans-1,2-dichloroethylene |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,1-dichloroethylene       |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,2-dichloropropane        |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,3-dichloropropylene      |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Ethylbenzene               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Methyl bromide             |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Methyl chloride            |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Methylene chloride         |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,1,2,2-tetrachloroethane  |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Tetrachloroethylene        |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Toluene                    |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,1,1-trichloroethane      |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,1,2-trichloroethane      |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |

|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

**TABLE C. EFFLUENT PARAMETERS FOR SELECTED POTWS**

| Pollutant                         | Maximum Daily Discharge |       | Average Daily Discharge |       |                   | Analytical Method <sup>1</sup> | ML or MDL<br>(include units)                                |
|-----------------------------------|-------------------------|-------|-------------------------|-------|-------------------|--------------------------------|---|
|                                   | Value                   | Units | Value                   | Units | Number of Samples |                                |   |
| Trichloroethylene                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Vinyl chloride                    |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| <b>Acid-Extractable Compounds</b> |                         |       |                         |       |                   |                                |   |
| p-chloro-m-cresol                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2-chlorophenol                    |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2,4-dichlorophenol                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2,4-dimethylphenol                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 4,6-dinitro-o-cresol              |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2,4-dinitrophenol                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2-nitrophenol                     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 4-nitrophenol                     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Pentachlorophenol                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Phenol                            |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2,4,6-trichlorophenol             |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| <b>Base-Neutral Compounds</b>     |                         |       |                         |       |                   |                                |   |
| Acenaphthene                      |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Acenaphthylene                    |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Anthracene                        |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Benzidine                         |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Benzo(a)anthracene                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Benzo(a)pyrene                    |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 3,4-benzofluoranthene             |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |



|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

**TABLE C. EFFLUENT PARAMETERS FOR SELECTED POTWS**

| Pollutant                     | Maximum Daily Discharge |       | Average Daily Discharge |       |                   | Analytical Method <sup>1</sup> | ML or MDL<br>(include units)                                |
|-------------------------------|-------------------------|-------|-------------------------|-------|-------------------|--------------------------------|---|
|                               | Value                   | Units | Value                   | Units | Number of Samples |                                |   |
| Benzo(ghi)perylene            |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Benzo(k)fluoranthene          |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Bis (2-chloroethoxy) methane  |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Bis (2-chloroethyl) ether     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Bis (2-chloroisopropyl) ether |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Bis (2-ethylhexyl) phthalate  |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 4-bromophenyl phenyl ether    |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Butyl benzyl phthalate        |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2-chloronaphthalene           |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 4-chlorophenyl phenyl ether   |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Chrysene                      |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| di-n-butyl phthalate          |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| di-n-octyl phthalate          |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Dibenzo(a,h)anthracene        |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,2-dichlorobenzene           |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,3-dichlorobenzene           |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,4-dichlorobenzene           |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 3,3-dichlorobenzidine         |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Diethyl phthalate             |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Dimethyl phthalate            |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2,4-dinitrotoluene            |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 2,6-dinitrotoluene            |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |

|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

**TABLE C. EFFLUENT PARAMETERS FOR SELECTED POTWS**

| Pollutant                  | Maximum Daily Discharge |       | Average Daily Discharge |       |                   | Analytical Method <sup>1</sup> | ML or MDL<br>(include units)                                |
|----------------------------|-------------------------|-------|-------------------------|-------|-------------------|--------------------------------|---|
|                            | Value                   | Units | Value                   | Units | Number of Samples |                                |   |
| 1,2-diphenylhydrazine      |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Fluoranthene               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Fluorene                   |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Hexachlorobenzene          |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Hexachlorobutadiene        |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Hexachlorocyclo-pentadiene |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Hexachloroethane           |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Indeno(1,2,3-cd)pyrene     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Isophorone                 |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Naphthalene                |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Nitrobenzene               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| N-nitrosodi-n-propylamine  |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| N-nitrosodimethylamine     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| N-nitrosodiphenylamine     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Phenanthrene               |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| Pyrene                     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |
| 1,2,4-trichlorobenzene     |                         |       |                         |       |                   |                                | <input type="checkbox"/> ML<br><input type="checkbox"/> MDL |

<sup>1</sup> Sampling shall be conducted according to sufficiently sensitive test procedures (i.e., methods) approved under 40 CFR 136 for the analysis of pollutants or pollutant parameters or required under 40 CFR Chapter I, Subchapter N or O. See instructions and 40 CFR 122.21(e)(3).

---

This page intentionally left blank.



This page intentionally left blank.

|                           |                                  |   |                |   |
|---------------------------|----------------------------------|---|----------------|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|----------------|---|

# **TABLE E. EFFLUENT MONITORING FOR WHOLE EFFLUENT TOXICITY**

The table provides response space for one whole effluent toxicity sample. Copy the table to report additional test results.

## **Test Information**

|                           | Test Number _____ | Test Number _____ | Test Number _____ |
|---------------------------|-------------------|-------------------|-------------------|
| Test species              |                   |                   |                   |
| Age at initiation of test |                   |                   |                   |
| Outfall number            |                   |                   |                   |
| Date sample collected     |                   |                   |                   |
| Date test started         |                   |                   |                   |
| Duration                  |                   |                   |                   |

## **Toxicity Test Methods**

|  |  |  |  |
|--|--|--|--|
| Test method number                     |  |  |  |
| Manual title                           |  |  |  |
| Edition number and year of publication |  |  |  |
| Page number(s)                         |  |  |  |

## **Sample Type**

|            |   |   |   |
|------------|---|---|---|
| Check one: | <input type="checkbox"/> Grab<br><input type="checkbox"/> 24-hour composite | <input type="checkbox"/> Grab<br><input type="checkbox"/> 24-hour composite | <input type="checkbox"/> Grab<br><input type="checkbox"/> 24-hour composite |
|------------|---|---|---|

## **Sample Location**

|            |  |  |  |
|------------|--|--|--|
| Check one: | <input type="checkbox"/> Before Disinfection<br><input type="checkbox"/> After Disinfection<br><input type="checkbox"/> After Dechlorination | <input type="checkbox"/> Before Disinfection<br><input type="checkbox"/> After Disinfection<br><input type="checkbox"/> After Dechlorination | <input type="checkbox"/> Before disinfection<br><input type="checkbox"/> After disinfection<br><input type="checkbox"/> After dechlorination |
|------------|--|--|--|

## **Point in Treatment Process**

|  |  |  |  |
|--|--|--|--|
| Describe the point in the treatment process at which the sample was collected for each test. |  |  |  |
|--|--|--|--|

## **Toxicity Type**

|   |   |   |   |
|---|---|---|---|
| Indicate for each test whether the test was performed to assess acute or chronic toxicity, or both. (Check one response.) | <input type="checkbox"/> Acute<br><input type="checkbox"/> Chronic<br><input type="checkbox"/> Both | <input type="checkbox"/> Acute<br><input type="checkbox"/> Chronic<br><input type="checkbox"/> Both | <input type="checkbox"/> Acute<br><input type="checkbox"/> Chronic<br><input type="checkbox"/> Both |
|---|---|---|---|

|                           |                                  |   |                |
|---------------------------|----------------------------------|---|----------------|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number |
|---------------------------|----------------------------------|---|----------------|

Form Approved 03/05/19  
OMB No. 2040-0004

### TABLE E. EFFLUENT MONITORING FOR WHOLE EFFLUENT TOXICITY

The table provides response space for one whole effluent toxicity sample. Copy the table to report additional test results.

|  | Test Number _____   | Test Number _____   | Test Number _____   |
|--|---|---|---|
| <b>Test Type</b>   |   |   |   |
| Indicate the type of test performed. (Check one response.)   | <input type="checkbox"/> Static<br><input type="checkbox"/> Static-renewal<br><input type="checkbox"/> Flow-through | <input type="checkbox"/> Static<br><input type="checkbox"/> Static-renewal<br><input type="checkbox"/> Flow-through | <input type="checkbox"/> Static<br><input type="checkbox"/> Static-renewal<br><input type="checkbox"/> Flow-through |
| <b>Source of Dilution Water</b>  |   |   |   |
| Indicate the source of dilution water. (Check one response.)   | <input type="checkbox"/> Laboratory water<br><input type="checkbox"/> Receiving water                               | <input type="checkbox"/> Laboratory water<br><input type="checkbox"/> Receiving water                               | <input type="checkbox"/> Laboratory water<br><input type="checkbox"/> Receiving water                               |
| If laboratory water, specify type.   |   |   |   |
| If receiving water, specify source.  |   |   |   |
| <b>Type of Dilution Water</b>  |   |   |   |
| Indicate the type of dilution water. If salt water, specify "natural" or type of artificial sea salts or brine used. | <input type="checkbox"/> Fresh water<br><input type="checkbox"/> Salt water (specify)                               | <input type="checkbox"/> Fresh water<br><input type="checkbox"/> Salt water (specify)                               | <input type="checkbox"/> Fresh water<br><input type="checkbox"/> Salt water (specify)                               |
| <b>Percentage Effluent Used</b>  |   |   |   |
| Specify the percentage effluent used for all concentrations in the test series.                                      |   |   |   |
|  |   |   |   |
| <b>Parameters Tested</b>   |   |   |   |
| Check the parameters tested.   | <input type="checkbox"/> pH<br><input type="checkbox"/> Salinity<br><input type="checkbox"/> Temperature            | <input type="checkbox"/> Ammonia<br><input type="checkbox"/> Dissolved oxygen                                       | <input type="checkbox"/> pH<br><input type="checkbox"/> Salinity<br><input type="checkbox"/> Temperature            |
|  |   | <input type="checkbox"/> Ammonia<br><input type="checkbox"/> Dissolved oxygen                                       | <input type="checkbox"/> pH<br><input type="checkbox"/> Salinity<br><input type="checkbox"/> Temperature            |
| <b>Acute Test Results</b>  |   |   |   |
| Percent survival in 100% effluent  |   | %   | %   |
| LC <sub>50</sub>   |   |   |   |
| 95% confidence interval  |   | %   | %   |
| Control percent survival   |   | %   | %   |

|                           |                                  |   |                |   |
|---------------------------|----------------------------------|---|----------------|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Outfall Number | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|----------------|---|

**TABLE E. EFFLUENT MONITORING FOR WHOLE EFFLUENT TOXICITY**

The table provides response space for one whole effluent toxicity sample. Copy the table to report additional test results.

|   | Test Number _____  | Test Number _____  | Test Number _____  |
|---|--|--|--|
| <b>Acute Test Results Continued</b>                     |  |  |  |
| Other (describe)  |  |  |  |
| <b>Chronic Test Results</b>                             |  |  |  |
| NOEC  | %  | %  | %  |
| IC <sub>25</sub>  | %  | %  | %  |
| Control percent survival                                | %  | %  | %  |
| Other (describe)  |  |  |  |
| <b>Quality Control/Quality Assurance</b>                |  |  |  |
| Is reference toxicant data available?                   | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No |
| Was reference toxicant test within acceptable bounds?   | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No |
| What date was reference toxicant test run (MM/DD/YYYY)? |  |  |  |
| Other (describe)  |  |  |  |



This page intentionally left blank.

|                           |                                  |   |
|---------------------------|----------------------------------|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP |
|---------------------------|----------------------------------|---|

Form Approved 03/05/19  
OMB No. 2040-0004

# TABLE F. INDUSTRIAL DISCHARGE INFORMATION


Response space is provided for three SIUs. Copy the table to report information for additional SIUs.

|   | SIU ____   | SIU ____   | SIU ____   |
|---|--|--|--|
| Name of SIU   |  |  |  |
| Mailing address (street or P.O. box)  |  |  |  |
| City, state, and ZIP code   |  |  |  |
| Description of all industrial processes that affect or contribute to the discharge.             |  |  |  |
| List the principal products and raw materials that affect or contribute to the SIU's discharge. |  |  |  |
| Indicate the average daily volume of wastewater discharged by the SIU.                          | gpd  | gpd  | gpd  |
| How much of the average daily volume is attributable to process flow?                           | gpd  | gpd  | gpd  |
| How much of the average daily volume is attributable to non-process flow?                       | gpd  | gpd  | gpd  |
| Is the SIU subject to local limits?   | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No |
| Is the SIU subject to categorical standards?  | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No |

|                           |                                  |   |
|---------------------------|----------------------------------|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP |
|---------------------------|----------------------------------|---|

Form Approved 03/05/19  
OMB No. 2040-0004

| <b>TABLE F. INDUSTRIAL DISCHARGE INFORMATION</b>   |  |  |  |
|--|--|--|--|
| Response space is provided for three SIUs. Copy the table to report information for additional SIUs.                                 |  |  |  |
|  | SIU ____   | SIU ____   | SIU ____   |
| Under what categories and subcategories is the SIU subject?  |  |  |  |
| Has the POTW experienced problems (e.g., upsets, pass-through interferences) in the past 4.5 years that are attributable to the SIU? | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No | <input type="checkbox"/> Yes <input type="checkbox"/> No |
| If yes, describe.  |  |  |  |

|  |  |   |  |  |  |   |   |
|--|--|---|--|--|--|---|---|
| EPA Identification Number  |  | NPDES Permit Number<br>AL0055158  |  | Facility Name<br>Hunter's Crossing WWTP  |  | Form Approved 03/05/19<br>OMB No. 2040-0004 |   |
| Form<br>2S<br>NPDES  |  |    |  | <b>U.S Environmental Protection Agency</b><br><b>Application for NPDES Permit for Sewage Sludge Management</b><br><b>NEW AND EXISTING TREATMENT WORKS TREATING DOMESTIC SEWAGE</b> |  |   |   |
| <b>PRELIMINARY INFORMATION</b>   |  |   |  |  |  |   |   |
| Does your facility currently have an effective NPDES permit or have you been directed by your NPDES permitting authority to submit a full Form 2S permit application?                                    |  |   |  |  |  |   |   |
| <input checked="" type="checkbox"/> Yes → Complete Part 2 of application package (begins p. 7). <input type="checkbox"/> No → Complete Part 1 of application package (below).                            |  |   |  |  |  |   |   |
| <b>PART 1</b>  |  | <b>LIMITED BACKGROUND INFORMATION (40 CFR 122.21(c)(2)(ii))</b>   |  |  |  |   |   |
| Complete this part only if you are a "sludge-only" facility (i.e., a facility that does not currently have, and is not applying for, an NPDES permit for a direct discharge to a surface body of water). |  |   |  |  |  |   |   |
| <b>PART 1, SECTION 1. FACILITY INFORMATION (40 CFR 122.21(c)(2)(ii)(A))</b>  |  |   |  |  |  |   |   |
| <b>Facility Information</b>  | 1.1  | Facility name   |  |  |  |   |   |
|  |  | Mailing address (street or P.O. box)  |  |  |  |   |   |
|  |  | City or town  |  |  | State  | ZIP code                                    |   |
|  |  | Contact name (first and last)   |  | Title  | Phone number   | Email address                               |   |
|  |  | Location address (street, route number, or other specific identifier)   |  |  |  |   |   |
|  |  | <input type="checkbox"/> Same as mailing address  |  |  |  |   |   |
|  | City or town   |   |  | State  | ZIP code   |   |   |
| 1.2  | <b>Ownership Status</b>  |   |  |  |  |   |   |
|  | <input type="checkbox"/> Public—federal  |   | <input type="checkbox"/> Public—state          |  | <input checked="" type="checkbox"/> Other public (specify) _____ |   |   |
|  | <input type="checkbox"/> Private   |   | <input type="checkbox"/> Other (specify) _____ |  |  |   |   |
| <b>PART 1, SECTION 2. APPLICANT INFORMATION (40 CFR 122.21(c)(2)(ii)(B))</b>   |  |   |  |  |  |   |   |
| <b>Applicant Information</b>   | 2.1  | Is applicant different from entity listed under Item 1.1 above?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 2.3 (Part 1, Section 2).                               |  |  |  |   |   |
|  | 2.2  | Applicant name  |  |  |  |   |   |
|  |  | Applicant address (street or P.O. box)  |  |  |  |   |   |
|  |  | City or town  |  |  | State  | ZIP code                                    |   |
|  |  | Contact name (first and last)   |  | Title  | Phone number   | Email address                               |   |
|  | 2.3  | Is the applicant the facility's owner, operator, or both? (Check only one response.)<br><input type="checkbox"/> Owner <input type="checkbox"/> Operator <input checked="" type="checkbox"/> Both |  |  |  |   |   |
| 2.4  | To which entity should the NPDES permitting authority send correspondence? (Check only one response.)<br><input type="checkbox"/> Facility <input checked="" type="checkbox"/> Applicant <input type="checkbox"/> Facility and applicant (they are one and the same) |   |  |  |  |   |   |
| <b>PART 1, SECTION 3. SEWAGE SLUDGE AMOUNT (40 CFR 122.21(c)(2)(ii)(D))</b>  |  |   |  |  |  |   |   |
| <b>Sewage Sludge Amount</b>  | 3.1  | Provide the total dry metric tons per the latest 365-day period of sewage sludge generated, treated, used, and disposed of:   |  |  |  |   |   |
|  |  | <b>Practice</b>   |  |  |  |   | <b>Dry Metric Tons per<br/>365-Day Period</b> |
|  |  | Amount generated at the facility  |  |  |  |   |   |
|  |  | Amount treated at the facility  |  |  |  |   |   |
|  |  | Amount used (i.e., received from off site) at the facility  |  |  |  |   |   |
|  |  | Amount disposed of at the facility  |  |  |  |   |   |

RECEIVED  
 AUG 04 2022  
 MUNICIPAL SECTION

|                           |                     |                        |
|---------------------------|---------------------|------------------------|
| EPA Identification Number | NPDES Permit Number | Facility Name          |
|                           | AL0055158           | Hunter's Crossing WWTP |

Form Approved 03/05/19  
OMB No. 2040-0004

**PART 1, SECTION 4. POLLUTANT CONCENTRATIONS (40 CFR 122.21(c)(2)(iii)(E))**

| <b>Pollutant Concentrations</b> | 4.1  | <p>Using the table below or a separate attachment, provide existing sewage sludge monitoring data for the pollutants for which limits in sewage sludge have been established in 40 CFR 503 for your facility's expected use or disposal practices. If available, base data on three or more samples taken at least one month apart and no more than 4.5 years old.</p> <p><input type="checkbox"/> Check here if you have provided a separate attachment with this information.</p> |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|---------------------------------|--|---|-------------------|---------------------------------|-----------|-------------------------------------|-------------------|---------------------------------|---------|--|--|--|---------|--|--|--|----------|--|--|--|--------|--|--|--|------|--|--|--|---------|--|--|--|------------|--|--|--|--------|--|--|--|----------|--|--|--|------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|-----------------|--|--|--|
|                                 | <table border="1"> <thead> <tr> <th>Pollutant</th> <th>Concentration<br/>(mg/kg dry weight)</th> <th>Analytical Method</th> <th>Detection Level<br/>for Analysis</th> </tr> </thead> <tbody> <tr><td>Arsenic</td><td></td><td></td><td></td></tr> <tr><td>Cadmium</td><td></td><td></td><td></td></tr> <tr><td>Chromium</td><td></td><td></td><td></td></tr> <tr><td>Copper</td><td></td><td></td><td></td></tr> <tr><td>Lead</td><td></td><td></td><td></td></tr> <tr><td>Mercury</td><td></td><td></td><td></td></tr> <tr><td>Molybdenum</td><td></td><td></td><td></td></tr> <tr><td>Nickel</td><td></td><td></td><td></td></tr> <tr><td>Selenium</td><td></td><td></td><td></td></tr> <tr><td>Zinc</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> <tr><td>Other (specify)</td><td></td><td></td><td></td></tr> </tbody> </table> |   |                   |                                 | Pollutant | Concentration<br>(mg/kg dry weight) | Analytical Method | Detection Level<br>for Analysis | Arsenic |  |  |  | Cadmium |  |  |  | Chromium |  |  |  | Copper |  |  |  | Lead |  |  |  | Mercury |  |  |  | Molybdenum |  |  |  | Nickel |  |  |  | Selenium |  |  |  | Zinc |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  | Other (specify) |  |  |  |
|                                 | Pollutant  | Concentration<br>(mg/kg dry weight)   | Analytical Method | Detection Level<br>for Analysis |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Arsenic  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Cadmium  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Chromium   |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Copper   |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Lead   |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Mercury  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Molybdenum   |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Nickel   |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Selenium   |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Zinc   |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Other (specify)  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Other (specify)  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Other (specify)  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Other (specify)  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Other (specify)  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Other (specify)  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
|                                 | Other (specify)  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
| Other (specify)                 |  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |
| Other (specify)                 |  |   |                   |                                 |           |                                     |                   |                                 |         |  |  |  |         |  |  |  |          |  |  |  |        |  |  |  |      |  |  |  |         |  |  |  |            |  |  |  |        |  |  |  |          |  |  |  |      |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |                 |  |  |  |

| EPA Identification Number  | NPDES Permit Number<br>AL0055158   | Facility Name<br>Hunter's Crossing WWTP  | Form Approved 03/05/19<br>OMB No. 2040-0004  |   |   |
|--|--|--|--|---|---|
| <b>PART 1, SECTION 5. TREATMENT PROVIDED AT YOUR FACILITY (40 CFR 122.21(c)(2)(ii)(C))</b>     |  |  |  |   |   |
| <b>Treatment Provided at Your Facility</b>   | 5.1  | For each sewage sludge use or disposal practice, indicate the amount of sewage sludge used or disposed of, the applicable pathogen class and reduction alternative, and the applicable vector attraction reduction option. Attach additional pages, as necessary.  |  |   |   |
|  |  | <b>Use or Disposal Practice</b><br>(check one)   | <b>Amount</b><br>(dry metric tons)   | <b>Pathogen Class and Reduction Alternative</b> | <b>Vector Attraction Reduction Option</b> |
|  |  | <input type="checkbox"/> Land application of bulk sewage   |  | <input type="checkbox"/> Not applicable         | <input type="checkbox"/> Not applicable   |
|  |  | <input type="checkbox"/> Land application of biosolids (bulk)  |  | <input type="checkbox"/> Class A, Alternative 1 | <input type="checkbox"/> Option 1         |
|  |  | <input type="checkbox"/> Land application of biosolids (bags)  |  | <input type="checkbox"/> Class A, Alternative 2 | <input type="checkbox"/> Option 2         |
|  |  | <input type="checkbox"/> Surface disposal in a landfill  |  | <input type="checkbox"/> Class A, Alternative 3 | <input type="checkbox"/> Option 3         |
|  | <input type="checkbox"/> Other surface disposal  |  | <input type="checkbox"/> Class A, Alternative 4  | <input checked="" type="checkbox"/> Option 4    |   |
|  | <input type="checkbox"/> Incineration  |  | <input type="checkbox"/> Class A, Alternative 5  | <input type="checkbox"/> Option 5               |   |
|  |  |  | <input type="checkbox"/> Class A, Alternative 6  | <input type="checkbox"/> Option 6               |   |
|  |  |  | <input type="checkbox"/> Class B, Alternative 1  | <input type="checkbox"/> Option 7               |   |
|  |  |  | <input type="checkbox"/> Class B, Alternative 2  | <input type="checkbox"/> Option 8               |   |
|  |  |  | <input type="checkbox"/> Class B, Alternative 3  | <input type="checkbox"/> Option 9               |   |
|  |  |  | <input type="checkbox"/> Class B, Alternative 4  | <input type="checkbox"/> Option 10              |   |
|  |  |  | <input type="checkbox"/> Domestic septage, pH adjustment                                       | <input type="checkbox"/> Option 11              |   |
| 5.2  | For each of the use and disposal practices specified in Item 5.1, identify the treatment process(es) used at your facility to reduce pathogens in sewage sludge or reduce the vector attraction properties of sewage sludge. (Check all that apply.) |  |  |   |   |
|  | <input type="checkbox"/> Preliminary operations (e.g., sludge grinding and dewatering)   | <input type="checkbox"/>   | <input type="checkbox"/> Thickening (concentration)  |   |   |
|  | <input type="checkbox"/> Stabilization   | <input type="checkbox"/>   | <input type="checkbox"/> Anaerobic digestion   |   |   |
|  | <input type="checkbox"/> Composting  | <input type="checkbox"/>   | <input type="checkbox"/> Conditioning  |   |   |
|  | <input type="checkbox"/> Disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization)  | <input type="checkbox"/>   | <input type="checkbox"/> Dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons) |   |   |
|  | <input type="checkbox"/> Heat drying   | <input type="checkbox"/>   | <input type="checkbox"/> Thermal reduction   |   |   |
|  | <input type="checkbox"/> Methane or biogas capture and recovery  | <input type="checkbox"/>   | <input type="checkbox"/> Other (specify) _____   |   |   |
| <b>PART 1, SECTION 6. SEWAGE SLUDGE SENT TO OTHER FACILITIES (40 CFR 122.21(c)(2)(iii)(C))</b> |  |  |  |   |   |
| <b>Sewage Sludge Sent to Other Facilities</b>  | 6.1  | Does the sewage sludge from your facility meet the ceiling concentrations in Table 1 of 40 CFR 503.13, the pollutant concentrations in Table 3 of 40 CFR 503.13, Class A pathogen reduction requirements at 40 CFR 503.32(a), and one of the vector attraction reduction requirements at 40 CFR 503.33(b)(1)-(8)?<br><input type="checkbox"/> Yes → SKIP to Part 1, Section 8 (Certification). <input type="checkbox"/> No |  |   |   |
|  | 6.2  | Is sewage sludge from your facility provided to another facility for treatment, distribution, use, or disposal?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Part 1, Section 7.   |  |   |   |
|  | 6.3  | Receiving facility name  |  |   |   |
|  |  | Mailing address (street or P.O. box)   |  |   |   |
|  |  | City or town   | State  | ZIP code  |   |
|  |  | Contact name (first and last)  | Title  | Phone number      Email address                 |   |
|  | 6.4  | Which activities does the receiving facility provide? (Check all that apply.)  |  |   |   |
|  | <input type="checkbox"/> Treatment or blending   | <input type="checkbox"/>   | <input type="checkbox"/> Sale or give-away in bag or other container                           |   |   |
|  | <input type="checkbox"/> Land application  | <input type="checkbox"/>   | <input type="checkbox"/> Surface disposal  |   |   |
|  | <input type="checkbox"/> Incineration  | <input type="checkbox"/>   | <input type="checkbox"/> Other (describe)  |   |   |
|  | <input type="checkbox"/> Composting  |  |  |   |   |

|                           |                                  |   |
|---------------------------|----------------------------------|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP |
|---------------------------|----------------------------------|---|

Form Approved 03/05/19  
OMB No. 2040-0004

**PART 1, SECTION 7. USE AND DISPOSAL SITES (40 CFR 122.21(c)(2)(ii)(C))**

|                               |   |  |             |   |   |
|-------------------------------|---|--|-------------|---|---|
| <b>Use and Disposal Sites</b> | Provide the following information for each site on which sewage sludge from this facility is used or disposed of.<br><input type="checkbox"/> Check here if you have provided separate attachments with this information. |  |             |   |   |
|                               | 7.1   | Site name or number  |             |   |   |
|                               |   | Mailing address (street or P.O. box)   |             |   |   |
|                               |   | City or town   | State       | ZIP code  |   |
|                               |   | Contact name (first and last)  | Title       | Phone number                                      | Email address   |
|                               |   | Location address (street, route number, or other specific identifier)  |             |   | <input checked="" type="checkbox"/> Same as mailing address |
|                               |   | City or town   | State       | ZIP code  |   |
|                               |   | County   | County code | <input checked="" type="checkbox"/> Not available |   |
|                               | 7.2   | Site type (check all that apply)<br><input type="checkbox"/> Agricultural <input type="checkbox"/> Lawn or home garden <input type="checkbox"/> Forest<br><input type="checkbox"/> Surface disposal <input type="checkbox"/> Public contact <input type="checkbox"/> Incineration<br><input type="checkbox"/> Reclamation <input type="checkbox"/> Municipal solid waste landfill <input checked="" type="checkbox"/> Other (describe) |             |   |   |

**PART 1, SECTION 8. CHECKLIST AND CERTIFICATION STATEMENT (40 CFR 122.22(a) and (d))**

|  |                                     |  |  |
|--|-------------------------------------|--|--|
| <b>Checklist and Certification Statement</b> | 8.1                                 | In Column 1 below, mark the sections of Form 2S, Part 1, that you have completed and are submitting with your application. For each section, specify in Column 2 any attachments that you are enclosing to alert the permitting authority. Note that not all applicants are required to provide attachments. |  |
|  |                                     | <b>Column 1</b>  | <b>Column 2</b>                                    |
|  | <input checked="" type="checkbox"/> | Section 1: Facility Information  | <input checked="" type="checkbox"/> w/ attachments |
|  | <input checked="" type="checkbox"/> | Section 2: Applicant Information   | <input checked="" type="checkbox"/> w/ attachments |
|  | <input checked="" type="checkbox"/> | Section 3: Sewage Sludge Amount  | <input type="checkbox"/> w/ attachments            |
|  | <input checked="" type="checkbox"/> | Section 4: Pollutant Concentrations  | <input type="checkbox"/> w/ attachments            |
|  | <input checked="" type="checkbox"/> | Section 5: Treatment Provided at Your Facility   | <input type="checkbox"/> w/ attachments            |
|  | <input type="checkbox"/>            | Section 6: Sewage Sludge Sent to Other Facilities  | <input type="checkbox"/> w/ attachments            |
|  | <input type="checkbox"/>            | Section 7: Use and Disposal Sites  | <input type="checkbox"/> w/ attachments            |
|  | <input type="checkbox"/>            | Section 8: Checklist and Certification Statement   |  |

|  |     |  |   |   |
|--|-----|--|---|---|
| EPA Identification Number                          |     | NPDES Permit Number<br>AL0055158   | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
| Checklist and Certification Statement<br>Continued | 8.2 | <b>Certification Statement</b><br><i>I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.</i> |   |   |
|  |     | Name (print or type first and last name)   | Official title                          | Phone number                                |
|  |     | Signature  |   | Date signed                                 |

**PART 1 APPLICANTS STOP HERE.**

Submit completed application package to your NPDES permitting authority.



This page intentionally left blank.

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|   |  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
|---|--|--------------------------|------------------------------------|-------------------------------|--------------|---|--------------------------|------------------------------------|-------------------------|-------------|-------------------|
| <b>PART 2</b>   | <b>PERMIT APPLICATION INFORMATION (40 CFR 122.21(q))</b>   |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
| <p>Complete this part if you have an effective NPDES permit or have been directed by the NPDES permitting authority to submit a full permit application. In other words, complete this part if your facility has, or is applying for, an NPDES permit.</p> <p>Part 2 is divided into five sections. Section 1 pertains to all applicants. The applicability of Sections 2 to 5 depends on your facility's sewage sludge use or disposal practices. See the instructions to determine which sections you are required to complete.</p>   |  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
| <b>PART 2, SECTION 1. GENERAL INFORMATION (40 CFR 122.21(q)(1-7) AND (q)(13))</b>   |  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
| All Part 2 applicants must complete this section.   |  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
| <b>Facility Information</b>   |  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
| General Information   | <div style="border: 1px solid black; padding: 2px;"> <div>1.1 Facility name<br/>Hunter's Crossing WWTP</div> <div>Mailing address (street or P.O. box)<br/>PO Box 329</div> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%;">City or town<br/>Harvest</td> <td style="width: 15%;">State<br/>AI</td> <td style="width: 20%;">ZIP code<br/>35749</td> <td style="width: 32%;">Phone number</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%;">Contact name (first and last)<br/>Michael Oliver</td> <td style="width: 20%;">Title<br/>General Manager</td> <td style="width: 47%;">Email address<br/>mikeo@hmwater.org</td> </tr> </table> <div>Location address (street, route number, or other specific identifier) <input type="checkbox"/> Same as mailing address<br/>195 Marlboro Way</div> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%;">City or town<br/>Madison</td> <td style="width: 15%;">State<br/>AI</td> <td style="width: 52%;">ZIP code<br/>35757</td> </tr> </table> </div> | City or town<br>Harvest  | State<br>AI                        | ZIP code<br>35749             | Phone number | Contact name (first and last)<br>Michael Oliver | Title<br>General Manager | Email address<br>mikeo@hmwater.org | City or town<br>Madison | State<br>AI | ZIP code<br>35757 |
|   | City or town<br>Harvest  | State<br>AI              | ZIP code<br>35749                  | Phone number                  |              |   |                          |                                    |                         |             |                   |
|   | Contact name (first and last)<br>Michael Oliver  | Title<br>General Manager | Email address<br>mikeo@hmwater.org |                               |              |   |                          |                                    |                         |             |                   |
|   | City or town<br>Madison  | State<br>AI              | ZIP code<br>35757                  |                               |              |   |                          |                                    |                         |             |                   |
|   | 1.2 Is this facility a Class I sludge management facility?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
|   | 1.3 Facility Design Flow Rate 0.075 million gallons per day (mgd)  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
|   | 1.4 Total Population Served 200 homes  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
|   | 1.5 Ownership Status<br><input type="checkbox"/> Public—federal <input type="checkbox"/> Public—state <input checked="" type="checkbox"/> Other public (specify) <u>Public Utility</u><br><input type="checkbox"/> Private <input type="checkbox"/> Other (specify) _____  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
|   | <b>Applicant Information</b>   |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
|   | 1.6 Is applicant different from entity listed under Item 1.1 above?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 1.8 (Part 2, Section 1).   |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
| 1.7 Applicant name<br><div style="border: 1px solid black; padding: 2px;"> <div>Applicant mailing address (street or P.O. box)</div> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%;">City or town</td> <td style="width: 15%;">State</td> <td style="width: 52%;">ZIP code</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 25%;">Contact name (first and last)</td> <td style="width: 20%;">Title</td> <td style="width: 20%;">Phone number</td> <td style="width: 35%;">Email address</td> </tr> </table> </div> | City or town   | State                    | ZIP code                           | Contact name (first and last) | Title        | Phone number                                    | Email address            |                                    |                         |             |                   |
| City or town  | State  | ZIP code                 |                                    |                               |              |   |                          |                                    |                         |             |                   |
| Contact name (first and last)   | Title  | Phone number             | Email address                      |                               |              |   |                          |                                    |                         |             |                   |
| 1.8 Is the applicant the facility's owner, operator, or both? (Check only one response.)<br><input type="checkbox"/> Operator <input type="checkbox"/> Owner <input checked="" type="checkbox"/> Both   |  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |
| 1.9 To which entity should the NPDES permitting authority send correspondence? (Check only one response.)<br><input type="checkbox"/> Facility <input checked="" type="checkbox"/> Applicant <input type="checkbox"/> Facility and applicant (they are one and the same)  |  |                          |                                    |                               |              |   |                          |                                    |                         |             |                   |



|                           |  |                                  |  |   |  |   |  |
|---------------------------|--|----------------------------------|--|---|--|---|--|
| EPA Identification Number |  | NPDES Permit Number<br>AL0055158 |  | Facility Name<br>Hunter's Crossing WWTP |  | Form Approved 03/05/19<br>OMB No. 2040-0004 |  |
|---------------------------|--|----------------------------------|--|---|--|---|--|

|  |  |   |   |                          |  |   |  |
|--|--|---|---|--------------------------|--|---|--|
| <b>General Information Continued</b>   | 1.17<br>cont.  | Responsibilities of contractor  | Contractor 1<br>Hauling sludge and deposit to Madison Utilities | Contractor 2             | Contractor 3                                       | <div style="border: 1px solid black; padding: 5px; display: inline-block;"> <b>RECEIVED</b><br/> <b>AUG 23 2022</b><br/> MUNICIPAL SECTION </div> |  |
|  | <b>Pollutant Concentrations</b><br>Using the table below or a separate attachment, provide sewage sludge monitoring data for the pollutants for which limits in sewage sludge have been established in 40 CFR 503 for this facility's expected use or disposal practices. All data must be based on three or more samples taken at least one month apart and must be no more than 4.5 years old. |   |   |                          |  |   |  |
|  | <input type="checkbox"/> Check here if you have attached additional sheets to the application package.   |   |   |                          |  |   |  |
|  | 1.18   | <b>Pollutant</b>  | <b>Average Monthly Concentration</b><br>(mg/kg dry weight)      | <b>Analytical Method</b> | <b>Detection Level</b>                             |   |  |
|  |  | Arsenic   | ND  | WG1428426                | 0.100 mg/l   |   |  |
|  |  | Cadmium   | ND  | WG1428426                | 0.100 mg/l   |   |  |
|  |  | Chromium  | ND  | WG1428426                | 0.100 mg/l   |   |  |
|  |  | Copper  | ND  | WG1428426                | 0.100 mg/l   |   |  |
|  |  | Lead  | ND  | WG1428426                | 0.100 mg/l   |   |  |
|  |  | Mercury   | ND  | WG1428570                | 0.100 mg/l   |   |  |
|  | Molybdenum   | N/A   | N/A   | N/A                      |  |   |  |
|  | Nickel   | N/A   | N/A   | N/A                      |  |   |  |
|  | Selenium   | ND  | WG1428426   | 0.100 mg/l               |  |   |  |
|  | Zinc   | N/A   | N/A   | N/A                      |  |   |  |
| <b>Checklist and Certification Statement</b>   |  |   |   |                          |  |   |  |
|  | 1.19   | In Column 1 below, mark the sections of Form 2S, Part 2, that you have completed and are submitting with your application. For each section, specify in Column 2 any attachments that you are enclosing. Note that not all applicants are required to complete all sections or provide attachments. See Exhibit 2S-2 in the Instructions.   |   |                          |  |   |  |
|  |  | <b>Column 1</b>   |   |                          | <b>Column 2</b>                                    |   |  |
|  |  | <input checked="" type="checkbox"/> Section 1 (General Information)   |   |                          | <input checked="" type="checkbox"/> w/ attachments |   |  |
|  |  | <input checked="" type="checkbox"/> Section 2 (Generation of Sewage Sludge or Preparation of a Material Derived from Sewage Sludge)   |   |                          | <input checked="" type="checkbox"/> w/ attachments |   |  |
|  |  | <input checked="" type="checkbox"/> Section 3 (Land Application of Bulk Sewage Sludge)  |   |                          | <input type="checkbox"/> w/ attachments            |   |  |
|  |  | <input checked="" type="checkbox"/> Section 4 (Surface Disposal)  |   |                          | <input type="checkbox"/> w/ attachments            |   |  |
|  |  | <input checked="" type="checkbox"/> Section 5 (Incineration)  |   |                          | <input type="checkbox"/> w/ attachments            |   |  |
|  | 1.20   | <b>Certification Statement</b><br>I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. |   |                          |  |   |  |
|  |  | Name (print or type first and last name)<br>Michael Oliver  |   |                          | Official title<br>General Manager                  |   |  |
|  |  | Signature<br>   |   |                          | Date signed<br>08/04/2022                          |   |  |
|  |  | Telephone number<br>(256) 837-1132  |   |                          |  |   |  |
| Upon the request of the NPDES permitting authority, you must submit any other information the authority deems necessary to assess sewage sludge use or disposal practices at your facility and identify appropriate permitting requirements. |  |   |   |                          |  |   |  |



|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|  |  |   |  |
|--|--|---|--|
| <b>Generation of Sewage Sludge or Preparation of a Material Derived from Sewage Sludge Continued</b>   | <b>Treatment Provided at Your Facility</b>   |   |  |
|  | 2.8  | For each sewage sludge use or disposal practice, indicate the applicable pathogen class and reduction alternative and the applicable vector attraction reduction option provided at your facility. Attach additional pages, as necessary.   |  |
|  |  | <b>Use or Disposal Practice</b><br>(check one)  | <b>Pathogen Class and Reduction Alternative</b>  |
|  |  | <b>Vector Attraction Reduction Option</b>   |  |
|  |  | <input type="checkbox"/> Land application of bulk sewage<br><input checked="" type="checkbox"/> Land application of biosolids (bulk)<br><input type="checkbox"/> Land application of biosolids (bags)<br><input type="checkbox"/> Surface disposal in a landfill<br><input type="checkbox"/> Other surface disposal<br><input type="checkbox"/> Incineration  | <input type="checkbox"/> Not applicable<br><input type="checkbox"/> Class A, Alternative 1<br><input type="checkbox"/> Class A, Alternative 2<br><input type="checkbox"/> Class A, Alternative 3<br><input type="checkbox"/> Class A, Alternative 4<br><input type="checkbox"/> Class A, Alternative 5<br><input type="checkbox"/> Class A, Alternative 6<br><input checked="" type="checkbox"/> Class B, Alternative 1<br><input type="checkbox"/> Class B, Alternative 2<br><input type="checkbox"/> Class B, Alternative 3<br><input type="checkbox"/> Class B, Alternative 4<br><input type="checkbox"/> Domestic septage, pH adjustment |
|  |  | <input type="checkbox"/> Not applicable<br><input type="checkbox"/> Option 1<br><input type="checkbox"/> Option 2<br><input type="checkbox"/> Option 3<br><input checked="" type="checkbox"/> Option 4<br><input type="checkbox"/> Option 5<br><input type="checkbox"/> Option 6<br><input type="checkbox"/> Option 7<br><input type="checkbox"/> Option 8<br><input type="checkbox"/> Option 9<br><input type="checkbox"/> Option 10<br><input type="checkbox"/> Option 11 |  |
| 2.9  | Identify the treatment process(es) used at your facility to reduce pathogens in sewage sludge or reduce the vector attraction properties of sewage sludge? (Check all that apply.)<br><br><div style="display: flex; justify-content: space-between;"> <div style="width: 48%;"> <input type="checkbox"/> Preliminary operations (e.g., sludge grinding and degritting)<br/> <input checked="" type="checkbox"/> Stabilization<br/> <input type="checkbox"/> Composting<br/> <input type="checkbox"/> Disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization)<br/> <input type="checkbox"/> Heat drying<br/> <input type="checkbox"/> Methane or biogas capture and recovery           </div> <div style="width: 48%;"> <input checked="" type="checkbox"/> Thickening (concentration)<br/> <input type="checkbox"/> Anaerobic digestion<br/> <input type="checkbox"/> Conditioning<br/> <input type="checkbox"/> Dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons)<br/> <input type="checkbox"/> Thermal reduction           </div> </div> |   |  |
| 2.10   | Describe any other sewage sludge treatment or blending activities not identified in Items 2.8 and 2.9 (Part 2, Section 2) above.<br><br><input type="checkbox"/> Check here if you have attached the description to the application package.   |   |  |
| <b>Preparation of Sewage Sludge Meeting Ceiling and Pollutant Concentrations, Class A Pathogen Requirements, and One of Vector Attraction Reduction Options 1 to 8</b> |  |   |  |
| 2.11   | Does the sewage sludge from your facility meet the ceiling concentrations in Table 1 of 40 CFR 503.13, the pollutant concentrations in Table 3 of 40 CFR 503.13, Class A pathogen reduction requirements at 40 CFR 503.32(a), and one of the vector attraction reduction requirements at 40 CFR 503.33(b)(1)–(8) and is it land applied?<br><br><div style="display: flex; justify-content: space-between;"> <input type="checkbox"/> Yes           <input checked="" type="checkbox"/> No → SKIP to Item 2.14 (Part 2, Section 2) below.         </div>   |   |  |
| 2.12   | Total dry metric tons per 365-day period of sewage sludge subject to this subsection that is applied to the land:  |   |  |
| 2.13   | Is sewage sludge subject to this subsection placed in bags or other containers for sale or give-away for application to the land?<br><br><div style="display: flex; justify-content: space-between;"> <input type="checkbox"/> Yes           <input type="checkbox"/> No         </div>  |   |  |
| <input type="checkbox"/> Check here once you have completed Items 2.11 to 2.13, then → SKIP to Item 2.32 (Part 2, Section 2) below.                                    |  |   |  |

Page 12

|                           |  |                                  |   |   |
|---------------------------|--|----------------------------------|---|---|
| EPA Identification Number |  | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|--|----------------------------------|---|---|

|   |   |   |   |  |
|---|---|---|---|--|
| Generation of Sewage Sludge or Preparation of a Material Derived from Sewage Sludge Continued | 2.23  | Which treatment process(es) are used at the receiving facility to reduce pathogens in sewage sludge or reduce the vector attraction properties of sewage sludge from your facility? (Check all that apply.)   |   |  |
|   |   | <input type="checkbox"/> Preliminary operations (e.g., sludge grinding and degritting)  | <input checked="" type="checkbox"/> Thickening (concentration)  |  |
|   |   | <input checked="" type="checkbox"/> Stabilization   | <input type="checkbox"/> Anaerobic digestion  |  |
|   |   | <input type="checkbox"/> Composting   | <input type="checkbox"/> Conditioning   |  |
|   |   | <input type="checkbox"/> Disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization)   | <input checked="" type="checkbox"/> Dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons) |  |
|   |   | <input type="checkbox"/> Heat drying  | <input type="checkbox"/> Thermal reduction  |  |
|   |   | <input type="checkbox"/> Methane or biogas capture and recovery   | <input type="checkbox"/> Other (specify) _____  |  |
|   | 2.24  | Attach a copy of any information you provide the receiving facility to comply with the "notice and necessary information" requirement of 40 CFR 503.12(g).<br><input checked="" type="checkbox"/> Check here to indicate that you have attached material.               |   |  |
|   | 2.25  | Does the receiving facility place sewage sludge from your facility in a bag or other container for sale or give-away for application to the land?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 2.32 (Part 2, Section 2) below. |   |  |
|   | 2.26  | Attach a copy of all labels or notices that accompany the product being sold or given away.<br><input type="checkbox"/> Check here to indicate that you have attached material.   |   |  |
|   |   | <input type="checkbox"/> Check here once you have completed Items 2.17 to 2.26 (Part 2, Section 2), then → SKIP to Item 2.32 (Part 2, Section 2) below.   |   |  |
|   | <b>Land Application of Bulk Sewage Sludge</b>   |   |   |  |
| 2.27  | Is sewage sludge from your facility applied to the land?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 2.32 (Part 2, Section 2) below.   |   |   |  |
| 2.28  | Total dry metric tons per 365-day period of sewage sludge applied to all land application sites:  |   |   |  |
| 2.29  | Did you identify all land application sites in Part 2, Section 3 of this application?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → Submit a copy of the land application plan with your application.   |   |   |  |
| 2.30  | Are any land application sites located in states other than the state where you generate sewage sludge or derive a material from sewage sludge?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 2.32 (Part 2, Section 2) below.  |   |   |  |
| 2.31  | Describe how you notify the NPDES permitting authority for the states where the land application sites are located. Attach a copy of the notification.<br><input type="checkbox"/> Check here if you have attached the explanation to the application package.<br><input type="checkbox"/> Check here if you have attached the notification to the application package. |   |   |  |
| <b>Surface Disposal</b>   |   |   |   |  |
| 2.32  | Is sewage sludge from your facility placed on a surface disposal site?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Item 2.39 (Part 2, Section 2) below.  |   |   |  |
| 2.33  | Total dry metric tons of sewage sludge from your facility placed on all surface disposal sites per 365-day period:  |   |   |  |
| 2.34  | Do you own or operate all surface disposal sites to which you send sewage sludge for disposal?<br><input type="checkbox"/> Yes → SKIP to Item 2.39 (Part 2, Section 2) below. <input type="checkbox"/> No   |   |   |  |
| 2.35  | Indicate the total number of surface disposal sites to which you send your sewage sludge.<br>(Provide the information in Items 2.36 to 2.38 of Part 2, Section 2, for each facility.)<br><input type="checkbox"/> Check here if you have attached additional sheets to the application package.   |   |   |  |



|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|  |  |  |  |               |
|--|--|--|--|---------------|
| <b>Generation of Sewage Sludge or Preparation of a Material Derived from Sewage Sludge Continued</b> | 2.36   | Site name or number of surface disposal site you do not own or operate   |  |               |
|  |  | Mailing address (street or P.O. box)   |  |               |
|  |  | City or Town   | State  | ZIP Code      |
|  |  | Contact Name (first and last)  | Title  | Phone Number  |
|  |  |  |  | Email Address |
|  | 2.37   | Site Contact (Check all that apply.)   |  |               |
|  |  | <input type="checkbox"/> Owner <span style="margin-left: 150px;"><input type="checkbox"/> Operator</span>  |  |               |
|  | 2.38   | Total dry metric tons of sewage sludge from your facility placed on this surface disposal site per 365-day period:   |  |               |
|  | <b>Incineration</b>  |  |  |               |
|  | 2.39   | Is sewage sludge from your facility fired in a sewage sludge incinerator?  |  |               |
|  |  | <input type="checkbox"/> Yes <span style="margin-left: 100px;"><input checked="" type="checkbox"/> No → SKIP to Item 2.46 (Part 2, Section 2) below.</span>                    |  |               |
|  | 2.40   | Total dry metric tons of sewage sludge from your facility fired in all sewage sludge incinerators per 365-day period:  |  |               |
|  | 2.41   | Do you own or operate all sewage sludge incinerators in which sewage sludge from your facility is fired?   |  |               |
|  |  | <input type="checkbox"/> Yes → SKIP to Item 2.46 (Part 2, Section 2) below. <span style="margin-left: 100px;"><input type="checkbox"/> No</span>                               |  |               |
|  | 2.42   | Indicate the total number of sewage sludge incinerators used that you do not own or operate. (Provide the information in Items 2.43 to 2.45 directly below for each facility.) |  |               |
|  | <input type="checkbox"/> Check here if you have attached additional sheets to the application package.   |  |  |               |
| 2.43   | Incinerator name or number   |  |  |               |
|  | Mailing address (street or P.O. box)   |  |  |               |
|  | City or town   | State  | ZIP code   |               |
|  | Contact name (first and last)  | Title  | Phone number                                     |               |
|  |  |  | Email address                                    |               |
|  | Location address (street, route number, or other specific identifier)  |  | <input type="checkbox"/> Same as mailing address |               |
|  | City or town   | State  | ZIP code   |               |
| 2.44   | Contact (check all that apply)   |  |  |               |
|  | <input type="checkbox"/> Incinerator owner <span style="margin-left: 150px;"><input type="checkbox"/> Incinerator operator</span>                    |  |  |               |
| 2.45   | Total dry metric tons of sewage sludge from your facility fired in this sewage sludge incinerator per 365-day period:                                |  |  |               |
| <b>Disposal in a Municipal Solid Waste Landfill</b>  |  |  |  |               |
| 2.46   | Is sewage sludge from your facility placed on a municipal solid waste landfill?  |  |  |               |
|  | <input type="checkbox"/> Yes <span style="margin-left: 100px;"><input checked="" type="checkbox"/> No → SKIP to Part 2, Section 3.</span>            |  |  |               |
| 2.47   | Indicate the total number of municipal solid waste landfills used. (Provide the information in Items 2.48 to 2.52 directly below for each facility.) |  |  |               |
|  | <input type="checkbox"/> Check here if you have attached additional sheets to the application package.   |  |  |               |

|  |  |   |  |   |       |   |          |  |
|--|--|---|--|---|-------|---|----------|--|
| EPA Identification Number  |  | NPDES Permit Number<br>AL0055158  |  | Facility Name<br>Hunter's Crossing WWTP |       | Form Approved 03/05/19<br>OMB No. 2040-0004 |          |  |
| Generation of Sewage Sludge or Preparation of a Material Derived from Sewage Sludge<br>Continued | 2.48   | Name of landfill  |  |   |       |   |          |  |
|  |  | Mailing address (street or P.O. box)  |  |   |       |   |          |  |
|  |  | City or town  |  |   | State |   | ZIP code |  |
|  |  | Contact name (first and last)   |  | Title                                   |       | Phone number                                |          | Email address                                    |
|  |  | Location address (street, route number, or other specific identifier)   |  |   |       |   |          | <input type="checkbox"/> Same as mailing address |
|  |  | County  |  | County code                             |       |   |          | <input type="checkbox"/> Not available           |
|  |  | City or town  |  | State                                   |       |   | ZIP code |  |
|  | 2.49   | Total dry metric tons of sewage sludge from your facility placed in this municipal solid waste landfill per 365-day period:         |  |   |       |   |          |  |
|  | 2.50   | List the numbers of all other federal, state, and local permits that regulate the operation of this municipal solid waste landfill. |  |   |       |   |          |  |
|  |  | Permit Number   |  | Type of Permit                          |       |   |          |  |
|  |  |   |  |   |       |   |          |  |
|  |  |   |  |   |       |   |          |  |
|  |  |   |  |   |       |   |          |  |
| 2.51   | Attach to the application information to determine whether the sewage sludge meets applicable requirements for disposal of sewage sludge in a municipal solid waste landfill (e.g., results of paint filter liquids test and TCLP test).<br><input type="checkbox"/> Check here to indicate you have attached the requested information. |   |  |   |       |   |          |  |
| 2.52   | Does the municipal solid waste landfill comply with applicable criteria set forth in 40 CFR 258?<br><input type="checkbox"/> Yes <input type="checkbox"/> No   |   |  |   |       |   |          |  |

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

PART 2, SECTION 3 LAND APPLICATION OF BULK SEWAGE SLUDGE (40 CFR 122.21(q)(9))

|  |  |   |  |  |                 |                  |       |       |
|--|--|---|--|--|-----------------|------------------|-------|-------|
| Land Application of Bulk Sewage Sludge | 3.1  | Does your facility apply sewage sludge to land?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Part 2, Section 4.   |  |  |                 |                  |       |       |
|  | 3.2  | Do any of the following conditions apply? <ul style="list-style-type: none"> <li>The sewage sludge meets the ceiling concentrations in Table 1 of 40 CFR 503.12, the pollutant concentrations in Table 3 of 40 CFR 503.13, Class A pathogen reduction requirements at 40 CFR 503.32(a), and one of the vector attraction reduction requirements at 40 CFR 503.33(b)(1)-(8);</li> <li>The sewage sludge is sold or given away in a bag or other container for application to the land; or</li> <li>You provide the sewage sludge to another facility for treatment or blending.</li> </ul> <input type="checkbox"/> Yes → SKIP to Part 2, Section 4. <input type="checkbox"/> No   |  |  |                 |                  |       |       |
|  | 3.3  | Complete Section 3 for every site on which the sewage sludge is applied.<br><input type="checkbox"/> Check here if you have attached sheets to the application package for one or more land application sites.  |  |  |                 |                  |       |       |
|  | <b>Identification of Land Application Site</b> |   |  |  |                 |                  |       |       |
|  | 3.4  | Site name or number<br>Location address (street, route number, or other specific identifier) <input type="checkbox"/> Same as mailing address<br>County <span style="float: right;">County code <input type="checkbox"/> Not available</span><br>City or town <span style="float: right;">State <span style="margin-left: 20px;">ZIP code</span></span><br><b>Latitude/Longitude of Land Application Site (see instructions)</b><br><table style="width: 100%; border: none;"> <tr> <td style="width: 50%; text-align: center; border-bottom: 1px solid black;"><b>Latitude</b></td> <td style="width: 50%; text-align: center; border-bottom: 1px solid black;"><b>Longitude</b></td> </tr> <tr> <td style="text-align: center; border-bottom: 1px solid black;">. . .</td> <td style="text-align: center; border-bottom: 1px solid black;">. . .</td> </tr> </table> <b>Method of Determination</b><br><input type="checkbox"/> USGS map <input type="checkbox"/> Field survey <input type="checkbox"/> Other (specify) _____ |  |  | <b>Latitude</b> | <b>Longitude</b> | . . . | . . . |
|  | <b>Latitude</b>                                | <b>Longitude</b>  |  |  |                 |                  |       |       |
|  | . . .  | . . .   |  |  |                 |                  |       |       |
|  | 3.5  | Provide a topographic map (or other appropriate map if a topographic map is unavailable) that shows the site location.<br><input type="checkbox"/> Check here to indicate you have attached a topographic map for this site.  |  |  |                 |                  |       |       |
|  | <b>Owner Information</b>                       |   |  |  |                 |                  |       |       |
|  | 3.6  | Are you the owner of this land application site?<br><input type="checkbox"/> Yes → SKIP to Item 3.8 (Part 2, Section 3) below. <input type="checkbox"/> No  |  |  |                 |                  |       |       |
|  | 3.7  | Owner name<br>Mailing address (street or P.O. box)<br>City or town <span style="float: right;">State <span style="margin-left: 20px;">ZIP code</span></span><br>Contact name (first and last) <span style="float: right;">Title <span style="margin-left: 20px;">Phone number <span style="margin-left: 20px;">Email address</span></span></span>   |  |  |                 |                  |       |       |
|  | <b>Applier Information</b>                     |   |  |  |                 |                  |       |       |
|  | 3.8  | Are you the person who applies, or who is responsible for application of, sewage sludge to this land application site?<br><input type="checkbox"/> Yes → SKIP to Item 3.10 (Part 2, Section 3) below. <input type="checkbox"/> No   |  |  |                 |                  |       |       |
|  | 3.9  | Applier's name<br>Mailing address (street or P.O. box)<br>City or town <span style="float: right;">State <span style="margin-left: 20px;">ZIP code</span></span><br>Contact name (first and last) <span style="float: right;">Title <span style="margin-left: 20px;">Phone number <span style="margin-left: 20px;">Email address</span></span></span>   |  |  |                 |                  |       |       |

|                           |                                  |   |   |  |
|---------------------------|----------------------------------|---|---|--|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |  |
|---------------------------|----------------------------------|---|---|--|

Land Application of Bulk Sewage Sludge Continued

|   |   |       |              |               |                                 |  |                |  |                  |  |               |  |
|---|---|-------|--------------|---------------|---------------------------------|--|----------------|--|------------------|--|---------------|--|
| <b>Site Type</b>                                    |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.10  | Type of land application:<br><div style="display: flex; justify-content: space-between;"> <div> <input type="checkbox"/> Agricultural land<br/> <input type="checkbox"/> Reclamation site<br/> <input type="checkbox"/> Other (describe)         </div> <div> <input type="checkbox"/> Forest<br/> <input type="checkbox"/> Public contact site         </div> </div>   |       |              |               |                                 |  |                |  |                  |  |               |  |
| <b>Crop or Other Vegetation Grown on Site</b>       |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.11  | What type of crop or other vegetation is grown on this site?  |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.12  | What is the nitrogen requirement for this crop or vegetation?   |       |              |               |                                 |  |                |  |                  |  |               |  |
| <b>Vector Attraction Reduction</b>                  |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.13  | Are the vector attraction reduction requirements at 40 CFR 503.33(b)(9) and (b)(10) met when sewage sludge is applied to the land application site?<br><br><div style="display: flex; justify-content: space-between;"> <input type="checkbox"/> Yes         <input type="checkbox"/> No → SKIP to Item 3.16 (Part 2, Section 3) below.         </div>  |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.14  | Indicate which vector attraction reduction option is met. (Check only one response.)<br><div style="display: flex; justify-content: space-between;"> <input type="checkbox"/> Option 9 (injection below land surface)         <input type="checkbox"/> Option 10 (incorporation into soil within 6 hours)         </div>  |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.15  | Describe any treatment processes used at the land application site to reduce vector attraction properties of sewage sludge.<br><input type="checkbox"/> Check here if you have attached your description to the application package.  |       |              |               |                                 |  |                |  |                  |  |               |  |
| <b>Cumulative Loadings and Remaining Allotments</b> |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.16  | Is the sewage sludge applied to this site since July 20, 1993, subject to the cumulative pollutant loading rates (CPLRs) in 40 CFR 503.13(b)(2)?<br><br><div style="display: flex; justify-content: space-between;"> <input type="checkbox"/> Yes         <input type="checkbox"/> No → SKIP to Part 2, Section 4.         </div>   |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.17  | Have you contacted the NPDES permitting authority in the state where the bulk sewage sludge subject to CPLRs will be applied to ascertain whether bulk sewage sludge subject to CPLRs has been applied to this site on or since July 20, 1993?<br><br><div style="display: flex; justify-content: space-between;"> <input type="checkbox"/> Yes         <input type="checkbox"/> No → Sewage sludge subject to CPLRs may not be applied to this site. SKIP to Part 2, Section 4.         </div> |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.18  | Provide the following information about your NPDES permitting authority:<br><table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td style="width: 40%;">NPDES permitting authority name</td><td></td></tr> <tr><td>Contact person</td><td></td></tr> <tr><td>Telephone number</td><td></td></tr> <tr><td>Email address</td><td></td></tr> </table>   |       |              |               | NPDES permitting authority name |  | Contact person |  | Telephone number |  | Email address |  |
| NPDES permitting authority name                     |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| Contact person                                      |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| Telephone number                                    |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| Email address                                       |   |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.19  | Based on your inquiry, has bulk sewage sludge subject to CPLRs been applied to this site since July 20, 1993?<br><div style="display: flex; justify-content: space-between;"> <input type="checkbox"/> Yes         <input type="checkbox"/> No → SKIP to Part 2, Section 4.         </div>  |       |              |               |                                 |  |                |  |                  |  |               |  |
| 3.20  | Provide the following information for every facility other than yours that is sending, or has sent, bulk sewage sludge subject to CPLRs to this site since July 20, 1993. If more than one such facility sends sewage sludge to this site, attach additional pages as necessary.<br><input type="checkbox"/> Check here to indicate that additional pages are attached.   |       |              |               |                                 |  |                |  |                  |  |               |  |
|   | Facility name   |       |              |               |                                 |  |                |  |                  |  |               |  |
|   | Mailing address (street or P.O. box)  |       |              |               |                                 |  |                |  |                  |  |               |  |
|   | City or town  | State | ZIP code     |               |                                 |  |                |  |                  |  |               |  |
|   | Contact name (first and last)   | Title | Phone number | Email address |                                 |  |                |  |                  |  |               |  |

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

PART 2, SECTION 4 SURFACE DISPOSAL (40 CFR 122.21(q)(10))

|                  |  |   |             |  |
|------------------|--|---|-------------|--|
| Surface Disposal | 4.1  | Do you own or operate a surface disposal site?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to Part 2, Section 5.  |             |  |
|                  | 4.2  | Complete all items in Section 4 for each active sewage sludge unit that you own or operate.<br><input type="checkbox"/> Check here to indicate that you have attached material to the application package for one or more active sewage sludge units. |             |  |
|                  | Information on Active Sewage Sludge Units  |   |             |  |
|                  | 4.3  | Unit name or number   |             |  |
|                  |  | Mailing address (street or P.O. box)  |             |  |
|                  |  | City or town  | State       | ZIP code   |
|                  |  | Contact name (first and last)   | Title       | Phone number      Email address                  |
|                  |  | Location address (street, route number, or other specific identifier)   |             | <input type="checkbox"/> Same as mailing address |
|                  |  | County  | County code | <input type="checkbox"/> Not available           |
|                  |  | City or town  | State       | ZIP code   |
|                  |  | Latitude/Longitude of Active Sewage Sludge Unit (see instructions)  |             |  |
|                  |  | Latitude  | Longitude   |  |
|                  |  | Method of Determination   |             |  |
|                  |  | <input type="checkbox"/> USGS map <input type="checkbox"/> Field survey <input type="checkbox"/> Other (specify) _____  |             |  |
|                  | 4.4  | Provide a topographic map (or other appropriate map if a topographic map is unavailable) that shows the site location.<br><input type="checkbox"/> Check here to indicate that you have completed and attached a topographic map.                     |             |  |
| 4.5              | Total dry metric tons of sewage sludge placed on the active sewage sludge unit per 365-day period:   |   |             |  |
| 4.6              | Total dry metric tons of sewage sludge placed on the active sewage sludge unit over the life of the unit:  |   |             |  |
| 4.7              | Does the active sewage sludge unit have a liner with a maximum permeability of $1 \times 10^{-7}$ centimeters per second (cm/sec)?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 4.9 (Part 2, Section 4) below.   |   |             |  |
| 4.8              | Describe the liner.<br><input type="checkbox"/> Check here to indicate that you have attached a description to the application package.  |   |             |  |
| 4.9              | Does the active sewage sludge unit have a leachate collection system?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 4.11 (Part 2, Section 4) below.   |   |             |  |
| 4.10             | Describe the leachate collection system and the method used for leachate disposal and provide the numbers of any federal, state, or local permit(s) for leachate disposal.<br><input type="checkbox"/> Check here to indicate that you have attached the description to the application package. |   |             |  |

|                           |                                  |   |   |  |
|---------------------------|----------------------------------|---|---|--|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |  |
|---------------------------|----------------------------------|---|---|--|

|                            |   |  |  |                 |
|----------------------------|---|--|--|-----------------|
| Surface Disposal Continued | 4.11  | Is the boundary of the active sewage sludge unit less than 150 meters from the property line of the surface disposal site?   |  |                 |
|                            | <input type="checkbox"/> Yes  |  | <input type="checkbox"/> No → SKIP to Item 4.13 (Part 2, Section 4) below.   |                 |
|                            | 4.12  | Provide the actual distance in meters:   |  | meters          |
|                            | 4.13  | Remaining capacity of active sewage sludge unit in dry metric tons:  |  | dry metric tons |
|                            | 4.14  | Anticipated closure date for active sewage sludge unit, if known (MM/DD/YYYY):   |  |                 |
|                            | 4.15  | Attach a copy of any closure plan that has been developed for this active sewage sludge unit.<br><input type="checkbox"/> Check here to indicate that you have attached a copy of the closure plan to the application package.   |  |                 |
|                            | <b>Sewage Sludge from Other Facilities</b>  |  |  |                 |
|                            | 4.16  | Is sewage sludge sent to this active sewage sludge unit from any facilities other than your facility?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 4.21 (Part 2, Section 4) below.   |  |                 |
|                            | 4.17  | Indicate the total number of facilities (other than your facility) that send sewage sludge to this active sewage sludge unit. (Complete Items 4.18 to 4.20 directly below for each such facility.)<br><input type="checkbox"/> Check here to indicate that you have attached responses for each facility to the application package. |  |                 |
|                            | 4.18  | Facility name  |  |                 |
|                            |   | Mailing address (street or P.O. box)   |  |                 |
|                            |   | City or town   | State  | ZIP code        |
|                            | Contact name (first and last)   | Title  | Phone number   |                 |
|                            |   |  | Email address  |                 |
| 4.19                       | Indicate the pathogen class and reduction alternative and the vector attraction reduction option met for the sewage sludge before leaving the other facility.   |  |  |                 |
|                            | <b>Pathogen Class and Reduction Alternative</b>   |  | <b>Vector Attraction Reduction Option</b>  |                 |
|                            | <input type="checkbox"/> Not applicable<br><input type="checkbox"/> Class A, Alternative 1<br><input type="checkbox"/> Class A, Alternative 2<br><input type="checkbox"/> Class A, Alternative 3<br><input type="checkbox"/> Class A, Alternative 4<br><input type="checkbox"/> Class A, Alternative 5<br><input type="checkbox"/> Class A, Alternative 6<br><input type="checkbox"/> Class B, Alternative 1<br><input type="checkbox"/> Class B, Alternative 2<br><input type="checkbox"/> Class B, Alternative 3<br><input type="checkbox"/> Class B, Alternative 4<br><input type="checkbox"/> Domestic septage, pH adjustment |  | <input type="checkbox"/> Not applicable<br><input type="checkbox"/> Option 1<br><input type="checkbox"/> Option 2<br><input type="checkbox"/> Option 3<br><input type="checkbox"/> Option 4<br><input type="checkbox"/> Option 5<br><input type="checkbox"/> Option 6<br><input type="checkbox"/> Option 7<br><input type="checkbox"/> Option 8<br><input type="checkbox"/> Option 9<br><input type="checkbox"/> Option 10<br><input type="checkbox"/> Option 11 |                 |
| 4.20                       | Which treatment process(es) are used at the other facility to reduce pathogens in sewage sludge or reduce the vector attraction properties of sewage sludge before leaving the other facility? (Check all that apply.)  |  |  |                 |
|                            | <input type="checkbox"/> Preliminary operations (e.g., sludge grinding and degritting)<br><input type="checkbox"/> Stabilization<br><input type="checkbox"/> Composting<br><input type="checkbox"/> Disinfection (e.g., beta ray irradiation, gamma ray irradiation, pasteurization)<br><input type="checkbox"/> Heat drying<br><input type="checkbox"/> Methane or biogas capture and recovery   |  | <input type="checkbox"/> Thickening (concentration)<br><input type="checkbox"/> Anaerobic digestion<br><input type="checkbox"/> Conditioning<br><input type="checkbox"/> Dewatering (e.g., centrifugation, sludge drying beds, sludge lagoons)<br><input type="checkbox"/> Thermal reduction<br><input type="checkbox"/> Other (specify) _____   |                 |

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|   |  |   |   |
|---|--|---|---|
| Surface Disposal Continued  | <b>Vector Attraction Reduction</b>   |   |   |
|   | 4.21   | Which vector attraction reduction option, if any, is met when sewage sludge is placed on this active sewage sludge unit?  |   |
|   | <input type="checkbox"/> Option 9 (Injection below and surface)  |   | <input type="checkbox"/> Option 11 (Covering active sewage sludge unit daily) |
|   | <input type="checkbox"/> Option 10 (Incorporation into soil within 6 hours)  |   | <input type="checkbox"/> None   |
|   | 4.22   | Describe any treatment processes used at the active sewage sludge unit to reduce vector attraction properties of sewage sludge.   |   |
|   | <input type="checkbox"/> Check here if you have attached your description to the application package.  |   |   |
|   | <b>Groundwater Monitoring</b>  |   |   |
|   | 4.23   | Is groundwater monitoring currently conducted at this active sewage sludge unit, or are groundwater monitoring data otherwise available for this active sewage sludge unit? |   |
|   | <input type="checkbox"/> Yes   |   | <input type="checkbox"/> No → SKIP to Item 4.26 (Part 2, Section 4) below.    |
|   | 4.24   | Provide a copy of available groundwater monitoring data.  |   |
|   | <input type="checkbox"/> Check here to indicate you have attached the monitoring data.   |   |   |
|   | 4.25   | Describe the well locations, the approximate depth to groundwater, and the groundwater monitoring procedures used to obtain these data.                                     |   |
|   | <input type="checkbox"/> Check here if you have attached your description to the application package.  |   |   |
|   | 4.26   | Has a groundwater monitoring program been prepared for this active sewage sludge unit?  |   |
| <input type="checkbox"/> Yes  |  | <input type="checkbox"/> No → SKIP to Item 4.28 (Part 2, Section 4) below.  |   |
| 4.27  | Submit a copy of the groundwater monitoring program with this permit application.  |   |   |
| <input type="checkbox"/> Check here to indicate you have attached the monitoring program.                       |  |   |   |
| 4.28  | Have you obtained a certification from a qualified groundwater scientist that the aquifer below the active sewage sludge unit has not been contaminated? |   |   |
| <input type="checkbox"/> Yes  |  | <input type="checkbox"/> No → SKIP to Item 4.30 (Part 2, Section 4) below.  |   |
| 4.29  | Submit a copy of the certification with this permit application.   |   |   |
| <input type="checkbox"/> Check here to indicate you have attached the certification to the application package. |  |   |   |
| <b>Site-Specific Limits</b>   |  |   |   |
| 4.30  | Are you seeking site-specific pollutant limits for the sewage sludge placed on the active sewage sludge unit?  |   |   |
| <input type="checkbox"/> Yes  |  | <input type="checkbox"/> No → SKIP to Part 2, Section 5.  |   |
| 4.31  | Submit information to support the request for site-specific pollutant limits with this application.  |   |   |
| <input type="checkbox"/> Check here to indicate you have attached the requested information.                    |  |   |   |

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

PART 2, SECTION 5 INCINERATION (40 CFR 122.21(g)(11))

|              |   |   |  |
|--------------|---|---|--|
| Incineration | <b>Incinerator Information</b>  |   |  |
|              | 5.1   | Do you fire sewage sludge in a sewage sludge incinerator?<br><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No → SKIP to END.   |  |
|              | 5.2   | Indicate the total number of incinerators used at your facility. (Complete the remainder of Section 5 for each such incinerator.)<br><input type="checkbox"/> Check here to indicate that you have attached information for one or more incinerators. |  |
|              | 5.3   | Incinerator name or number  |  |
|              |   | Location address (street, route number, or other specific identifier)   |  |
|              |   | County  | County code <input type="checkbox"/> Not available |
|              |   | City or town  | State      ZIP code                                |
|              |   | <b>Latitude/Longitude of Incinerator (see instructions)</b>   |  |
|              |   | Latitude  | Longitude  |
|              |   | °   '   "   | °   '   "  |
|              |   | <b>Method of Determination</b>  |  |
|              |   | <input type="checkbox"/> USGS map <input type="checkbox"/> Field survey <input type="checkbox"/> Other (specify) _____  |  |
|              |   | <b>Amount Fired</b>   |  |
|              | 5.4   | Dry metric tons per 365-day period of sewage sludge fired in the sewage sludge incinerator:   |  |
|              |   | <b>Beryllium NESHAP</b>   |  |
| 5.5          | Submit information, test data, and a description of measures taken that demonstrate whether the sewage sludge incinerated is beryllium-containing waste and will continue to remain as such.<br><input type="checkbox"/> Check here to indicate that you have attached this material to the application package.  |   |  |
| 5.6          | Is the sewage sludge fired in this incinerator "beryllium-containing waste" as defined at 40 CFR 61.31?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 5.8 (Part 2, Section 5) below.   |   |  |
| 5.7          | Submit with this application a complete report of the latest beryllium emission rate testing and documentation of ongoing incinerator operating parameters indicating that the NESHAP emission rate limit for beryllium has been and will continue to be met.<br><input type="checkbox"/> Check here to indicate that you have attached this information. |   |  |
|              | <b>Mercury NESHAP</b>   |   |  |
| 5.8          | Is compliance with the mercury NESHAP being demonstrated via stack testing?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 5.11 (Part 2, Section 5) below.  |   |  |
| 5.9          | Submit a complete report of stack testing and documentation of ongoing incinerator operating parameters indicating that the incinerator has met and will continue to meet the mercury NESHAP emission rate limit.<br><input type="checkbox"/> Check here to indicate that you have attached this information.   |   |  |
| 5.10         | Provide copies of mercury emission rate tests for the two most recent years in which testing was conducted.<br><input type="checkbox"/> Check here to indicate that you have attached this information.   |   |  |
| 5.11         | Do you demonstrate compliance with the mercury NESHAP by sewage sludge sampling?<br><input type="checkbox"/> Yes <input type="checkbox"/> No → SKIP to Item 5.13 (Part 2, Section 5) below.   |   |  |
| 5.12         | Submit a complete report of sewage sludge sampling and documentation of ongoing incinerator operating parameters indicating that the incinerator has met and will continue to meet the mercury NESHAP emission rate limit.<br><input type="checkbox"/> Check here to indicate that you have attached this information.                                    |   |  |



|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

Incineration Continued

**Dispersion Factor**

5.13 Dispersion factor in micrograms/cubic meter per gram/second:

5.14 Name and type of dispersion model:

5.15 Submit a copy of the modeling results and supporting documentation.  
☐ Check here to indicate that you have attached this information.

**Control Efficiency**

5.16 Provide the control efficiency, in hundredths, for each of the pollutants listed below.

| Pollutant | Control Efficiency, in Hundredths |
|-----------|-----------------------------------|
| Arsenic   |                                   |
| Cadmium   |                                   |
| Chromium  |                                   |
| Lead      |                                   |
| Nickel    |                                   |

5.17 Attach a copy of the results or performance testing and supporting documentation (including testing dates).  
☐ Check here to indicate that you have attached this information.

**Risk-Specific Concentration for Chromium**

5.18 Provide the risk-specific concentration (RSC) used for chromium in micrograms per cubic meter:

5.19 Was the RSC determined via Table 2 in 40 CFR 503.43?  
☐ Yes ☐ No → SKIP to Item 5.21 (Part 2, Section 5) below.

5.20 Identify the type of incinerator used as the basis.  
☐ Fluidized bed with wet scrubber ☐ Other types with wet scrubber  
☐ Fluidized bed with wet scrubber and wet electrostatic precipitator ☐ Other types with wet scrubber and wet electrostatic precipitator

5.21 Was the RSC determined via Table 6 in 40 CFR 503.43 (site-specific determination)?  
☐ Yes ☐ No → SKIP to Item 5.23 (Part 2, Section 5) below.

5.22 Provide the decimal fraction of hexavalent chromium concentration to total chromium concentration in stack exit gas:

5.23 Attach the results of incinerator stack tests for hexavalent and total chromium concentrations, including the date(s) of any test(s), with this application.  
☐ Check here to indicate that you have attached this information. ☐ Not applicable

**Incinerator Parameters**

5.24 Do you monitor total hydrocarbons (THC) in the exit gas of the sewage sludge incinerator?  
☐ Yes ☐ No

5.25 Do you monitor carbon monoxide (CO) in the exit gas of the sewage sludge incinerator?  
☐ Yes ☐ No

5.26 Indicate the type of sewage sludge incinerator.

5.27 Incinerator stack height in meters:

5.28 Indicate whether the value submitted in Item 5.27 is (check only one response):  
☐ Actual stack height ☐ Creditable stack height

|                           |                                  |   |   |
|---------------------------|----------------------------------|---|---|
| EPA Identification Number | NPDES Permit Number<br>AL0055158 | Facility Name<br>Hunter's Crossing WWTP | Form Approved 03/05/19<br>OMB No. 2040-0004 |
|---------------------------|----------------------------------|---|---|

|                               |   |   |  |
|-------------------------------|---|---|--|
| <b>Incineration Continued</b> | <b>Performance Test Operating Parameters</b>  |   |  |
|                               | 5.29  | Maximum performance test combustion temperature:  |  |
|                               | 5.30  | Performance test sewage sludge feed rate, in dry metric tons/day  |  |
|                               | 5.31  | Indicate whether value submitted in Item 5.30 is (check only one response):<br><input type="checkbox"/> Average use <input type="checkbox"/> Maximum design   |  |
|                               | 5.32  | Attach supporting documents describing how the feed rate was calculated.<br><input type="checkbox"/> Check here to indicate that you have attached this information.  |  |
|                               | 5.33  | Submit information documenting the performance test operating parameters for the air pollution control device(s) used for this sewage sludge incinerator.<br><input type="checkbox"/> Check here to indicate that you have attached this information. |  |
|                               | <b>Monitoring Equipment</b>   |   |  |
|                               | 5.34  | List the equipment in place to monitor the listed parameters.   |  |
|                               |   | <b>Parameter</b>  | <b>Equipment in Place for Monitoring</b> |
|                               |   | Total hydrocarbons or carbon monoxide   |  |
|                               |   | Percent oxygen  |  |
|                               |   | Percent moisture  |  |
|                               |   | Combustion temperature  |  |
|                               |   | Other (describe)  |  |
|                               | <b>Air Pollution Control Equipment</b>  |   |  |
| 5.35                          | List all air pollution control equipment used with this sewage sludge incinerator.<br><input type="checkbox"/> Check here if you have attached the list to the application package for the noted incinerator. |   |  |

**END of PART 2**

Submit completed application package to your NPDES permitting authority.

Example

## Harvest-Monrovia Water and Sewer Authority

Waste sludge generated by Harvest Monrovia Water and Sewer Authority. This sludge becomes the property of the hauler upon leaving the grounds of the Waste Water Treatment Plant.

Hauling 1 of 2 loads to  
Madison WWTP

- Location of originating WWTP: Hunter's Crossing WWTP

- o PH= 6.8
- o ORP=
- o Solids in percent%= 1.1%
- o Gallons= 4000

SOUR, Fecal Coliform, and TCLP available from outside laboratory.

WWTP Operator signature:

Brent Klancic 6/4/22

Hauler must use South Landess Circle to enter and exit. Any additional pumping of material due to inappropriate efforts of the hauler will be the responsibility of said hauler.

# Hunter's Crossing WWTP Sludge Practices



RECEIVED  
AUG 04 2022  
MUNICIPAL SECTION



# HUNTER'S CROSSING COLLECTION SYSTEM



AUG 04 2022

MUNICIPAL SECTION